

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204066

Luminaire Tested: **LE\_6B20D010 EC6B10209030 6LBNMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204066  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B20D010 EC6B10209030 6LBNMW1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
NARROW DISTRIBUTION WITH MATTE WHITE TRIM  
WATTAGE D010TR-21.86 W DE010-20.46 W D5LT-21.24 W DMX-20.89 W DL2-22.5 W  
DL3-21.8 6 W DLE-22.46 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1570.8 lumens  
Efficiency: N/A  
Efficacy: 75.5 lumens/watt  
Spacing Criteria (0/90/45): 0.99 / 0.99 / 0.97  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 20.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204066

CATALOG NUMBER: LE\_6B20D010 EC6B10209030 6LBNMW1

### Luminous Intensity Polar Plot

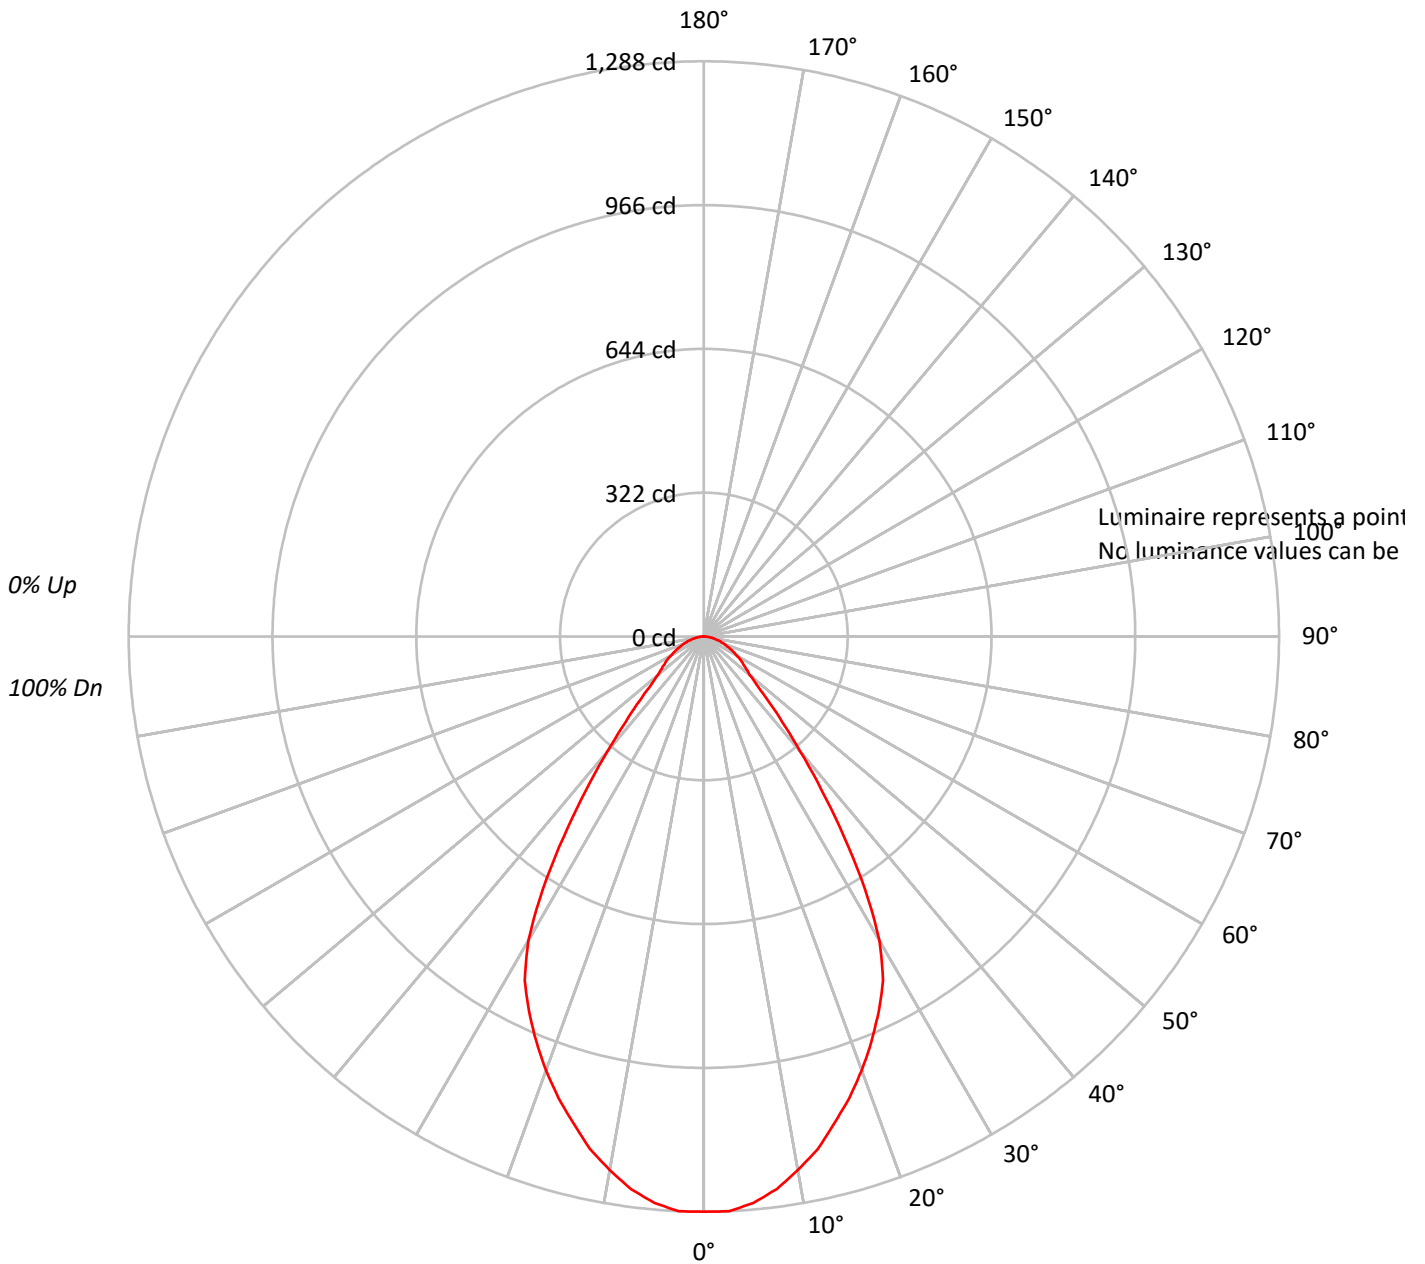



TEST NUMBER: P204066

CATALOG NUMBER: LE\_6B20D010 EC6B10209030 6LBNMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	108	105	103	109	106	103	101	102	100	98	98	97	95	95	93	92	90			
2	105	99	94	90	102	97	92	89	94	90	87	91	87	85	88	85	83	81			
3	98	90	84	79	96	89	83	79	86	81	77	84	80	76	81	78	75	73			
4	92	83	76	71	90	82	76	71	80	74	70	77	73	69	75	71	68	66			
5	87	77	70	64	85	76	69	64	74	68	64	72	67	63	70	66	62	61			
6	81	71	64	59	80	70	63	59	68	63	58	67	62	58	66	61	57	56			
7	77	66	59	54	75	65	59	54	64	58	54	63	57	53	61	57	53	51			
8	72	61	55	50	71	61	54	50	60	54	49	59	53	49	58	53	49	47			
9	69	58	51	46	67	57	51	46	56	50	46	55	50	46	54	49	46	44			
10	65	54	47	43	64	54	47	43	53	47	43	52	46	43	51	46	43	41			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204066

CATALOG NUMBER: LE\_6B20D010 EC6B10209030 6LBNMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	119.6	7.6
10°-20°	317.1	20.2
20°-30°	423.3	26.9
30°-40°	341.5	21.7
40°-50°	163.7	10.4
50°-60°	97.1	6.2
60°-70°	64.5	4.1
70°-80°	34.6	2.2
80°-90°	9.5	0.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	859.9	54.7
0°-40°	1201.5	76.5
0°-60°	1462.2	93.1
0°-90°	1570.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1570.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1288	
5°	1273	120
15°	1128	317
25°	926	423
35°	547	342
45°	202	164
55°	107	97
65°	65	64
75°	32	35
85°	8	10
90°	0	



TEST NUMBER: P204066

CATALOG NUMBER: LE\_6B20D010 EC6B10209030 6LBNMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1288.1
2.5°	1288.1
5°	1273.1
7.5°	1248.1
10°	1213.2
12.5°	1175.8
15°	1128.4
17.5°	1083.4
20°	1033.5
22.5°	981.0
25°	926.1
27.5°	868.8
30°	786.4
32.5°	671.5
35°	546.8
37.5°	431.9
40°	334.5
42.5°	259.6
45°	202.2
47.5°	159.8
50°	134.8
52.5°	119.9
55°	107.4
57.5°	97.4
60°	84.9
62.5°	74.9
65°	64.9
67.5°	54.9
70°	47.4
72.5°	40.0
75°	32.5
77.5°	25.0
80°	20.0
82.5°	15.0
85°	7.5
87.5°	2.5
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)