

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P202522

Luminaire Tested: **LE\_6B20D010 EC6B10209035 6LBSWMH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P202522  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B20D010 EC6B10209035 6LBSWMH1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH WARM HAZE TRIM  
WATTAGE D010TR-21.86 W DE010-20.46 W D5LT-21.24 W DMX-20.89 W DL2-22.5 W  
DL3-21.8 6 W DLE-22.46 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2311.2 lumens  
Efficiency: N/A  
Efficacy: 111.1 lumens/watt  
Spacing Criteria (0/90/45): 0.97 / 0.97 / 1.1  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 20.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P202522

CATALOG NUMBER: LE\_6B20D010 EC6B10209035 6LBSWMH1

### Luminous Intensity Polar Plot

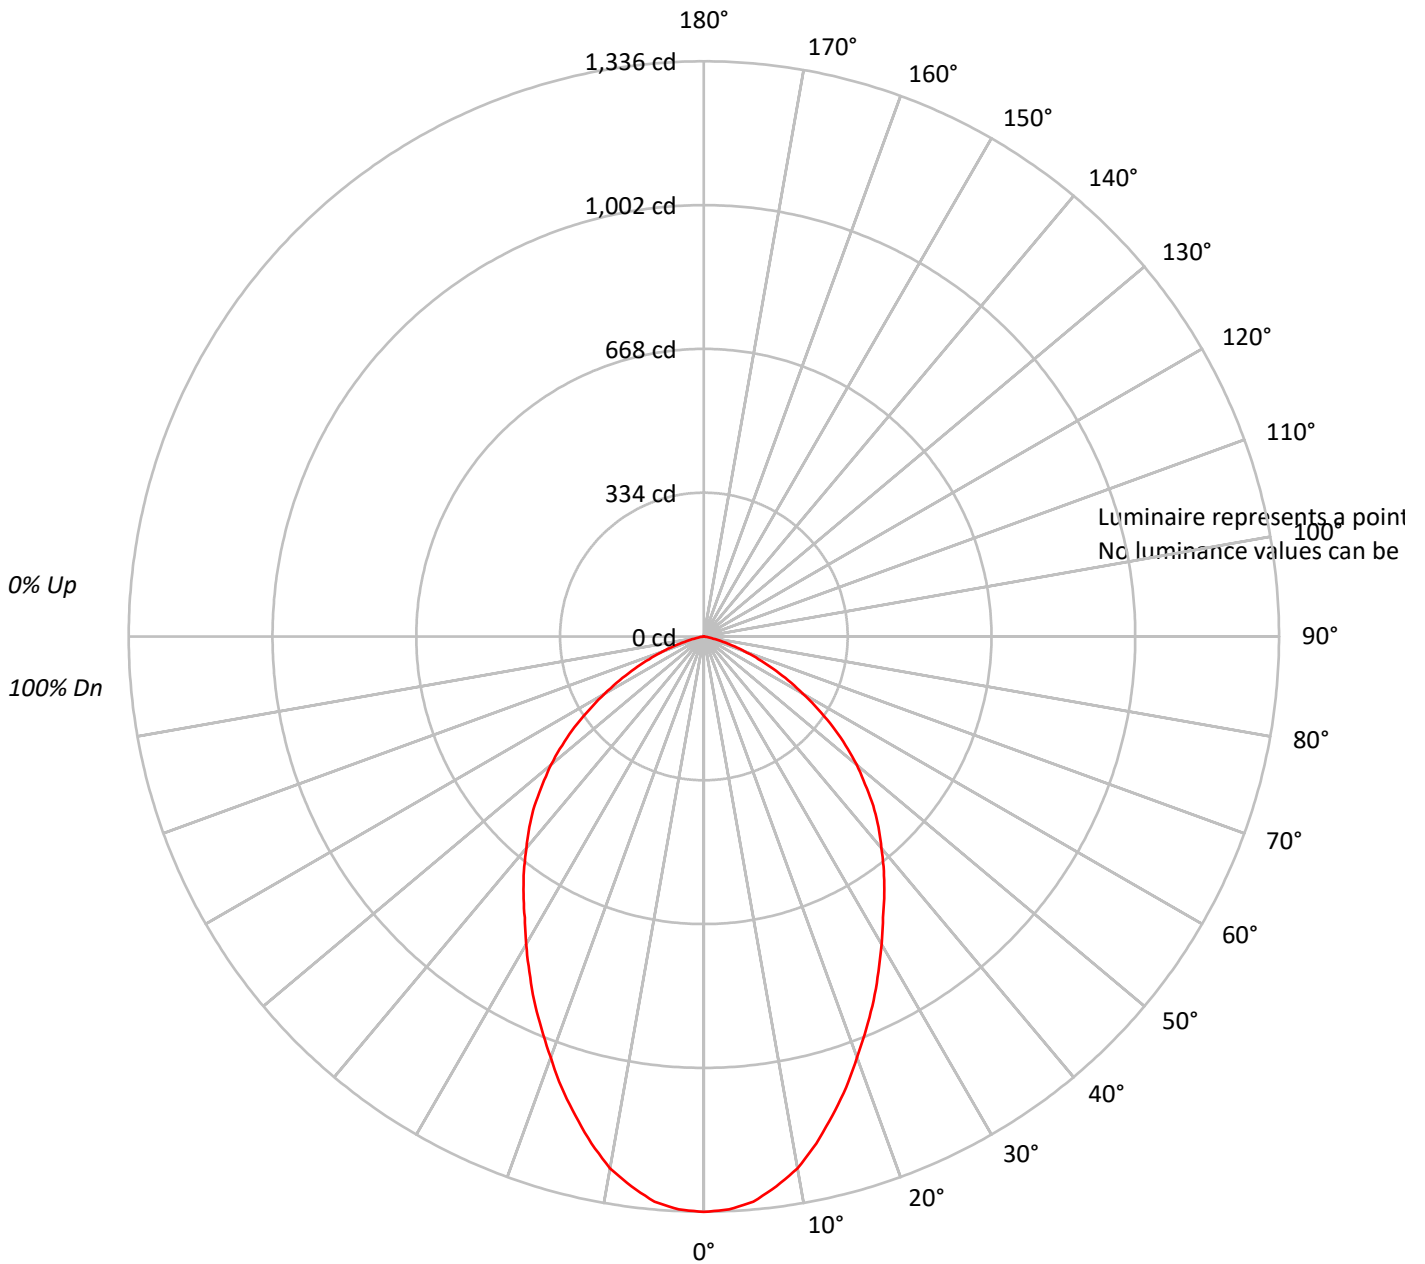



TEST NUMBER: P202522

CATALOG NUMBER: LE\_6B20D010 EC6B10209035 6LBSWMH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	88			
2	103	96	90	85	100	94	89	84	91	86	82	87	84	81	84	81	79	77			
3	95	86	79	73	92	84	78	73	81	76	71	79	74	70	76	72	69	67			
4	88	77	70	64	86	76	69	63	74	67	62	71	66	62	69	65	61	59			
5	81	70	62	56	79	69	61	56	67	60	55	65	59	55	63	58	54	52			
6	76	64	56	50	74	63	55	50	61	54	49	59	53	49	58	53	48	47			
7	70	58	50	45	69	57	50	45	56	49	44	55	48	44	53	48	44	42			
8	66	54	46	40	64	53	45	40	52	45	40	50	44	40	49	44	40	38			
9	62	49	42	37	61	49	42	37	48	41	37	47	41	36	46	40	36	35			
10	58	46	39	34	57	45	38	34	45	38	34	44	38	33	43	37	33	32			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P202522

CATALOG NUMBER: LE\_6B20D010 EC6B10209035 6LBSWMH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	123.7	5.4
10°-20°	323.2	14.0
20°-30°	428.6	18.5
30°-40°	457.1	19.8
40°-50°	427.3	18.5
50°-60°	325.8	14.1
60°-70°	177.3	7.7
70°-80°	47.5	2.1
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	875.5	37.9
0°-40°	1332.6	57.7
0°-60°	2085.8	90.2
0°-90°	2311.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2311.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1336	
5°	1318	124
15°	1152	323
25°	933	429
35°	730	457
45°	556	427
55°	367	326
65°	177	177
75°	41	48
85°	0	1
90°	0	



TEST NUMBER: P202522

CATALOG NUMBER: LE\_6B20D010 EC6B10209035 6LBSWMH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1336.5
2.5°	1332.2
5°	1318.1
7.5°	1288.4
10°	1254.4
12.5°	1206.2
15°	1152.4
17.5°	1098.6
20°	1040.6
22.5°	985.4
25°	933.0
27.5°	877.8
30°	825.4
32.5°	774.4
35°	730.5
37.5°	686.6
40°	641.4
42.5°	600.2
45°	556.4
47.5°	508.2
50°	463.0
52.5°	414.9
55°	366.6
57.5°	314.2
60°	266.1
62.5°	220.9
65°	177.0
67.5°	137.4
70°	100.5
72.5°	69.4
75°	41.0
77.5°	18.4
80°	4.2
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)