

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P202523

Luminaire Tested: **LE_6B20D010 EC6B10209040 6LBSWMH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P202523
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B20D010 EC6B10209040 6LBSWMH1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH WARM HAZE TRIM
WATTAGE D010TR-21.86 W DE010-20.46 W D5LT-21.24 W DMX-20.89 W DL2-22.5 W
DL3-21.8 6 W DLE-22.46 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2314.3 lumens
Efficiency: N/A
Efficacy: 111.3 lumens/watt
Spacing Criteria (0/90/45): 0.97 / 0.97 / 1.1
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 20.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P202523

CATALOG NUMBER: LE_6B20D010 EC6B10209040 6LBSWMH1

Luminous Intensity Polar Plot

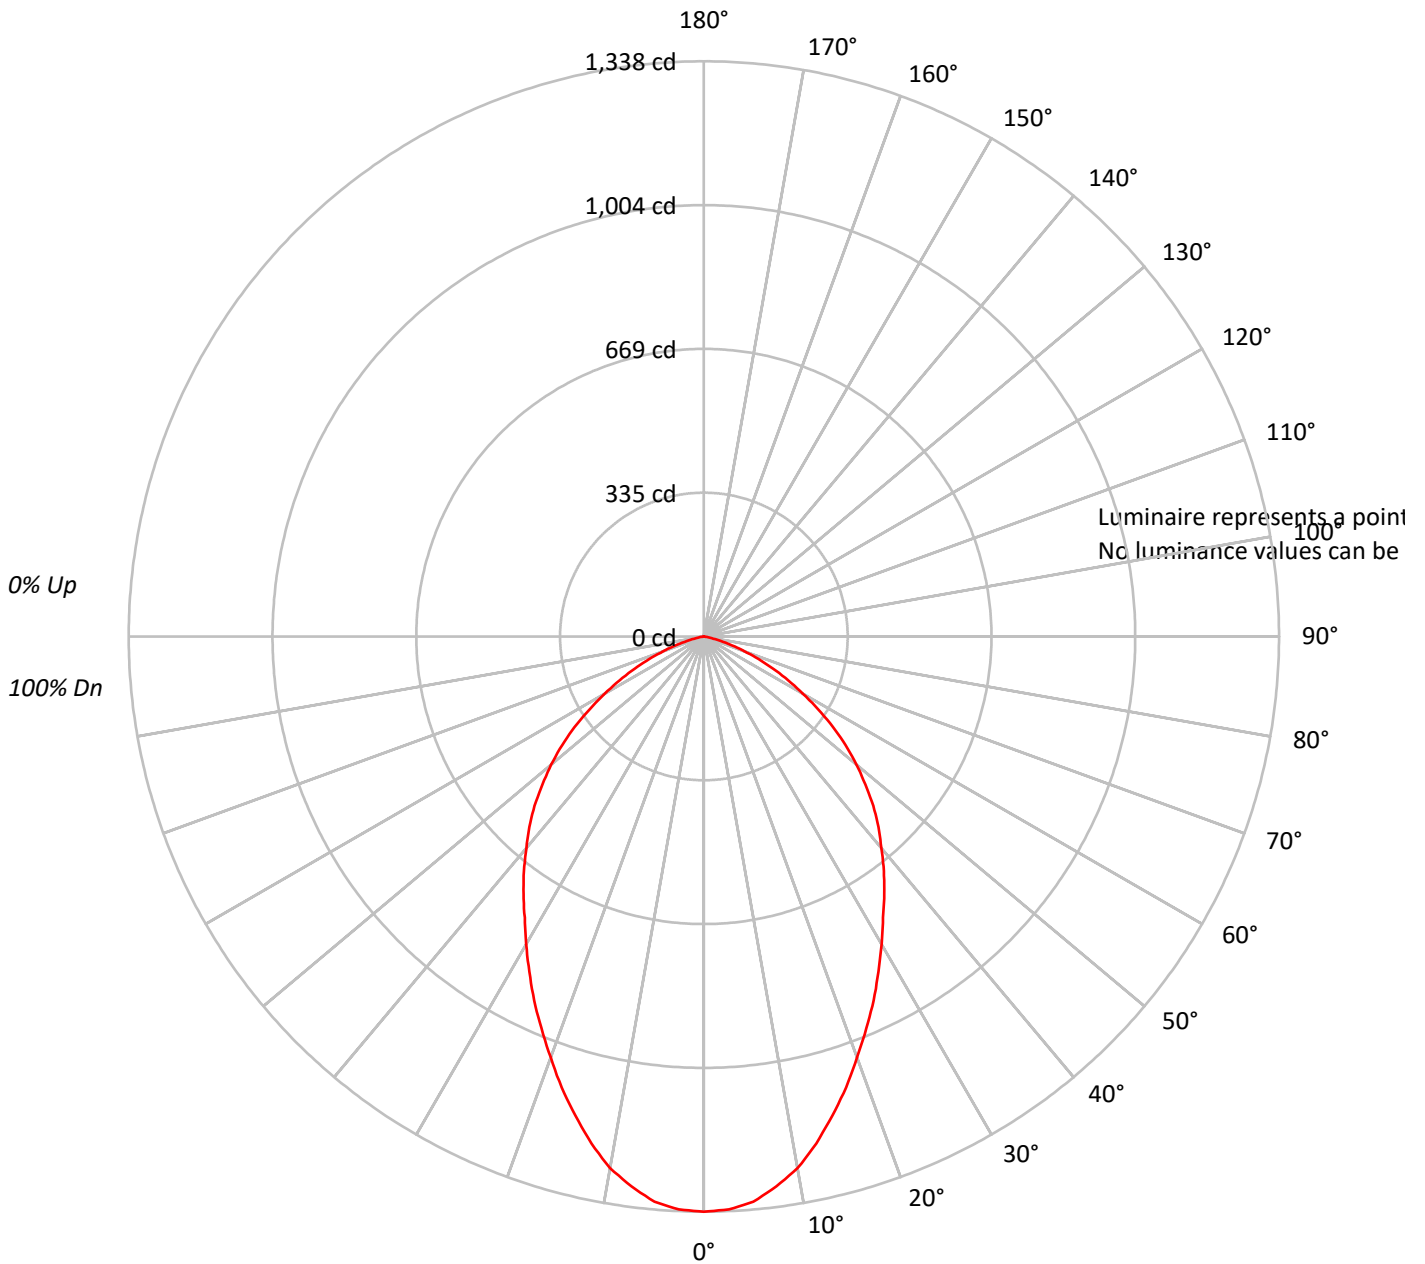



TEST NUMBER: P202523

CATALOG NUMBER: LE_6B20D010 EC6B10209040 6LBSWMH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | |
| RCR | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | 100 |
| 1 | 111 | 107 | 104 | 101 | 108 | 105 | 102 | 99 | 101 | 98 | 96 | 97 | 95 | 93 | 94 | 92 | 90 | 88 | | | | 88 |
| 2 | 103 | 96 | 90 | 85 | 100 | 94 | 89 | 84 | 91 | 86 | 82 | 87 | 84 | 81 | 84 | 81 | 79 | 77 | | | | 77 |
| 3 | 95 | 86 | 79 | 73 | 92 | 84 | 78 | 73 | 81 | 76 | 71 | 79 | 74 | 70 | 76 | 72 | 69 | 67 | | | | 67 |
| 4 | 88 | 77 | 70 | 64 | 86 | 76 | 69 | 63 | 74 | 67 | 62 | 71 | 66 | 62 | 69 | 65 | 61 | 59 | | | | 59 |
| 5 | 81 | 70 | 62 | 56 | 79 | 69 | 61 | 56 | 67 | 60 | 55 | 65 | 59 | 55 | 63 | 58 | 54 | 52 | | | | 52 |
| 6 | 76 | 64 | 56 | 50 | 74 | 63 | 55 | 50 | 61 | 54 | 49 | 59 | 53 | 49 | 58 | 53 | 48 | 47 | | | | 47 |
| 7 | 70 | 58 | 50 | 45 | 69 | 57 | 50 | 45 | 56 | 49 | 44 | 55 | 48 | 44 | 53 | 48 | 44 | 42 | | | | 42 |
| 8 | 66 | 54 | 46 | 40 | 64 | 53 | 45 | 40 | 52 | 45 | 40 | 50 | 44 | 40 | 49 | 44 | 40 | 38 | | | | 38 |
| 9 | 62 | 49 | 42 | 37 | 61 | 49 | 42 | 37 | 48 | 41 | 37 | 47 | 41 | 36 | 46 | 40 | 36 | 35 | | | | 35 |
| 10 | 58 | 46 | 39 | 34 | 57 | 45 | 38 | 34 | 45 | 38 | 34 | 44 | 38 | 33 | 43 | 37 | 33 | 32 | | | | 32 |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P202523

CATALOG NUMBER: LE_6B20D010 EC6B10209040 6LBSWMH1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 123.8 | 5.4 |
| 10°-20° | 323.7 | 14.0 |
| 20°-30° | 429.2 | 18.5 |
| 30°-40° | 457.8 | 19.8 |
| 40°-50° | 427.9 | 18.5 |
| 50°-60° | 326.3 | 14.1 |
| 60°-70° | 177.5 | 7.7 |
| 70°-80° | 47.6 | 2.1 |
| 80°-90° | 0.6 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 876.7 | 37.9 |
| 0°-40° | 1334.5 | 57.7 |
| 0°-60° | 2088.7 | 90.3 |
| 0°-90° | 2314.3 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 2314.3 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1338 | |
| 5° | 1320 | 124 |
| 15° | 1154 | 324 |
| 25° | 934 | 429 |
| 35° | 732 | 458 |
| 45° | 557 | 428 |
| 55° | 367 | 326 |
| 65° | 177 | 177 |
| 75° | 41 | 48 |
| 85° | 0 | 1 |
| 90° | 0 | |



TEST NUMBER: P202523

CATALOG NUMBER: LE_6B20D010 EC6B10209040 6LBSWMH1

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 1338.2 |
| 2.5° | 1334.0 |
| 5° | 1319.9 |
| 7.5° | 1290.1 |
| 10° | 1256.1 |
| 12.5° | 1207.9 |
| 15° | 1154.0 |
| 17.5° | 1100.1 |
| 20° | 1042.0 |
| 22.5° | 986.8 |
| 25° | 934.2 |
| 27.5° | 879.0 |
| 30° | 826.5 |
| 32.5° | 775.5 |
| 35° | 731.5 |
| 37.5° | 687.6 |
| 40° | 642.2 |
| 42.5° | 601.1 |
| 45° | 557.1 |
| 47.5° | 509.0 |
| 50° | 463.6 |
| 52.5° | 415.4 |
| 55° | 367.1 |
| 57.5° | 314.8 |
| 60° | 266.5 |
| 62.5° | 221.1 |
| 65° | 177.2 |
| 67.5° | 137.5 |
| 70° | 100.6 |
| 72.5° | 69.5 |
| 75° | 41.1 |
| 77.5° | 18.4 |
| 80° | 4.2 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)