

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P205309

Luminaire Tested: **LE_6B30D010 EC6B30509024 6LBNLI1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P205309
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B30D010 EC6B30509024 6LBNLI1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
NARROW DISTRIBUTION WITH SPECULAR CLEAR TRIM
WATTAGE D010TR-27.4 W DE010-27.95 W D5LT-27.65 W DMX-27.73 W DL2-29.56 W
DL3-29.67 W DLE-29.73 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2122.2 lumens
Efficiency: N/A
Efficacy: 75.8 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 28
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P205309

CATALOG NUMBER: LE_6B30D010 EC6B30509024 6LBNLI1

Luminous Intensity Polar Plot

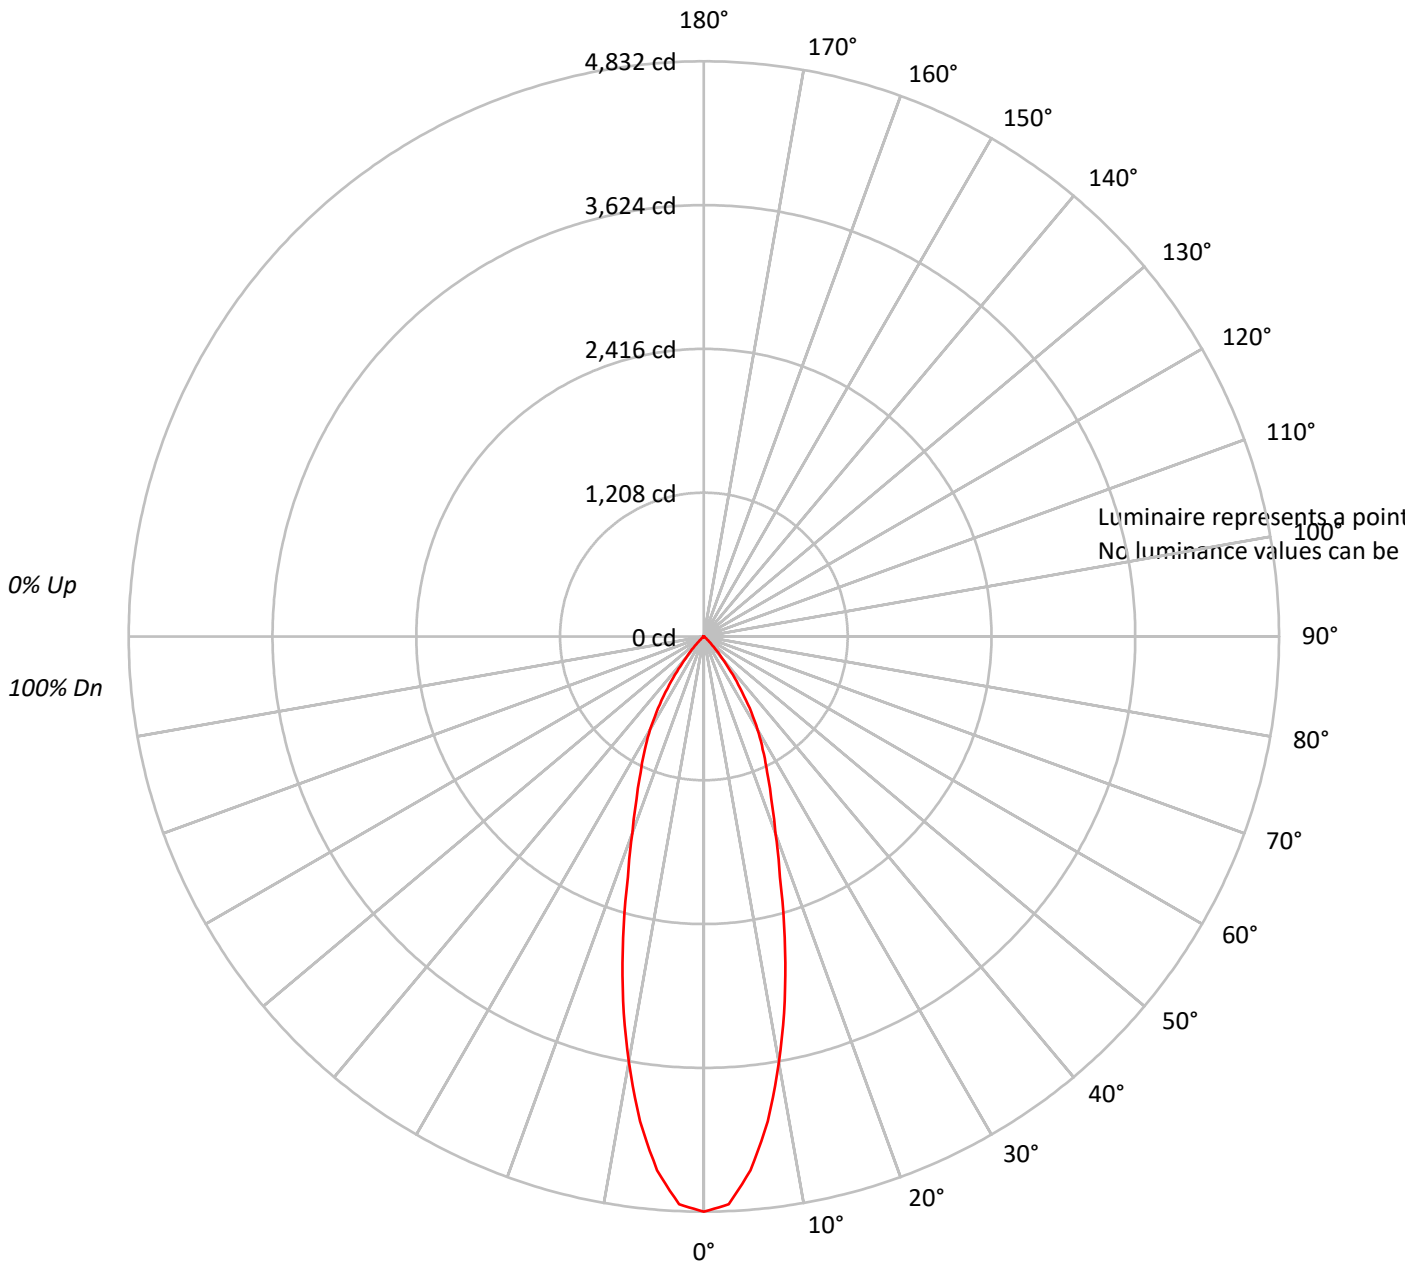



TEST NUMBER: P205309

CATALOG NUMBER: LE_6B30D010 EC6B30509024 6LBNLI1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	109	107	106	105	104	102	102	101	99	98	97	96	95																			
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	89																			
3	105	99	94	91	103	97	93	90	95	91	89	93	90	87	90	88	86	85																			
4	100	93	88	85	98	92	88	84	90	86	83	88	85	82	86	84	81	80																			
5	96	88	83	79	94	87	83	79	86	82	78	84	81	78	83	80	77	76																			
6	92	84	79	75	90	83	78	75	82	77	74	80	76	74	79	76	73	72																			
7	88	80	74	71	87	79	74	71	78	73	70	77	73	70	76	72	69	68																			
8	84	76	71	67	83	75	70	67	74	70	67	73	69	66	73	69	66	65																			
9	81	73	67	64	80	72	67	64	71	67	63	70	66	63	70	66	63	62																			
10	78	69	64	61	77	69	64	61	68	64	61	67	63	60	67	63	60	59																			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P205309

CATALOG NUMBER: LE_6B30D010 EC6B30509024 6LBNLI1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	401.7	18.9
10°-20°	721.1	34.0
20°-30°	583.0	27.5
30°-40°	335.9	15.8
40°-50°	71.0	3.3
50°-60°	6.1	0.3
60°-70°	3.0	0.1
70°-80°	0.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1705.9	80.4
0°-40°	2041.8	96.2
0°-60°	2118.8	99.8
0°-90°	2122.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2122.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4832	
5°	4502	402
15°	2620	721
25°	1258	583
35°	532	336
45°	76	71
55°	6	6
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P205309

CATALOG NUMBER: LE_6B30D010 EC6B30509024 6LBNLI1

CANDELA DISTRIBUTION (FULL):

	0°
0°	4832.0
2.5°	4773.9
5°	4501.5
7.5°	4109.9
10°	3629.4
12.5°	3136.8
15°	2619.5
17.5°	2120.8
20°	1756.5
22.5°	1478.1
25°	1257.8
27.5°	1071.1
30°	902.8
32.5°	716.1
35°	532.5
37.5°	370.2
40°	241.8
42.5°	146.9
45°	76.5
47.5°	30.6
50°	9.1
52.5°	9.1
55°	6.1
57.5°	6.1
60°	3.0
62.5°	3.0
65°	3.0
67.5°	3.0
70°	3.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)