

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204077

Luminaire Tested: **LE_6B30D010 EC6B30509024 6LBNMW1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204077
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B30D010 EC6B30509024 6LBNMW1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
NARROW DISTRIBUTION WITH MATTE WHITE TRIM
WATTAGE D010TR-27.4 W DE010-27.95 W D5LT-27.65 W DMX-27.73 W DL2-29.56 W
DL3-29.67 W DLE-29.73 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1926.5 lumens
Efficiency: N/A
Efficacy: 68.8 lumens/watt
Spacing Criteria (0/90/45): 0.99 / 0.99 / 0.97
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 28
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204077

CATALOG NUMBER: LE_6B30D010 EC6B30509024 6LBNMW1

Luminous Intensity Polar Plot

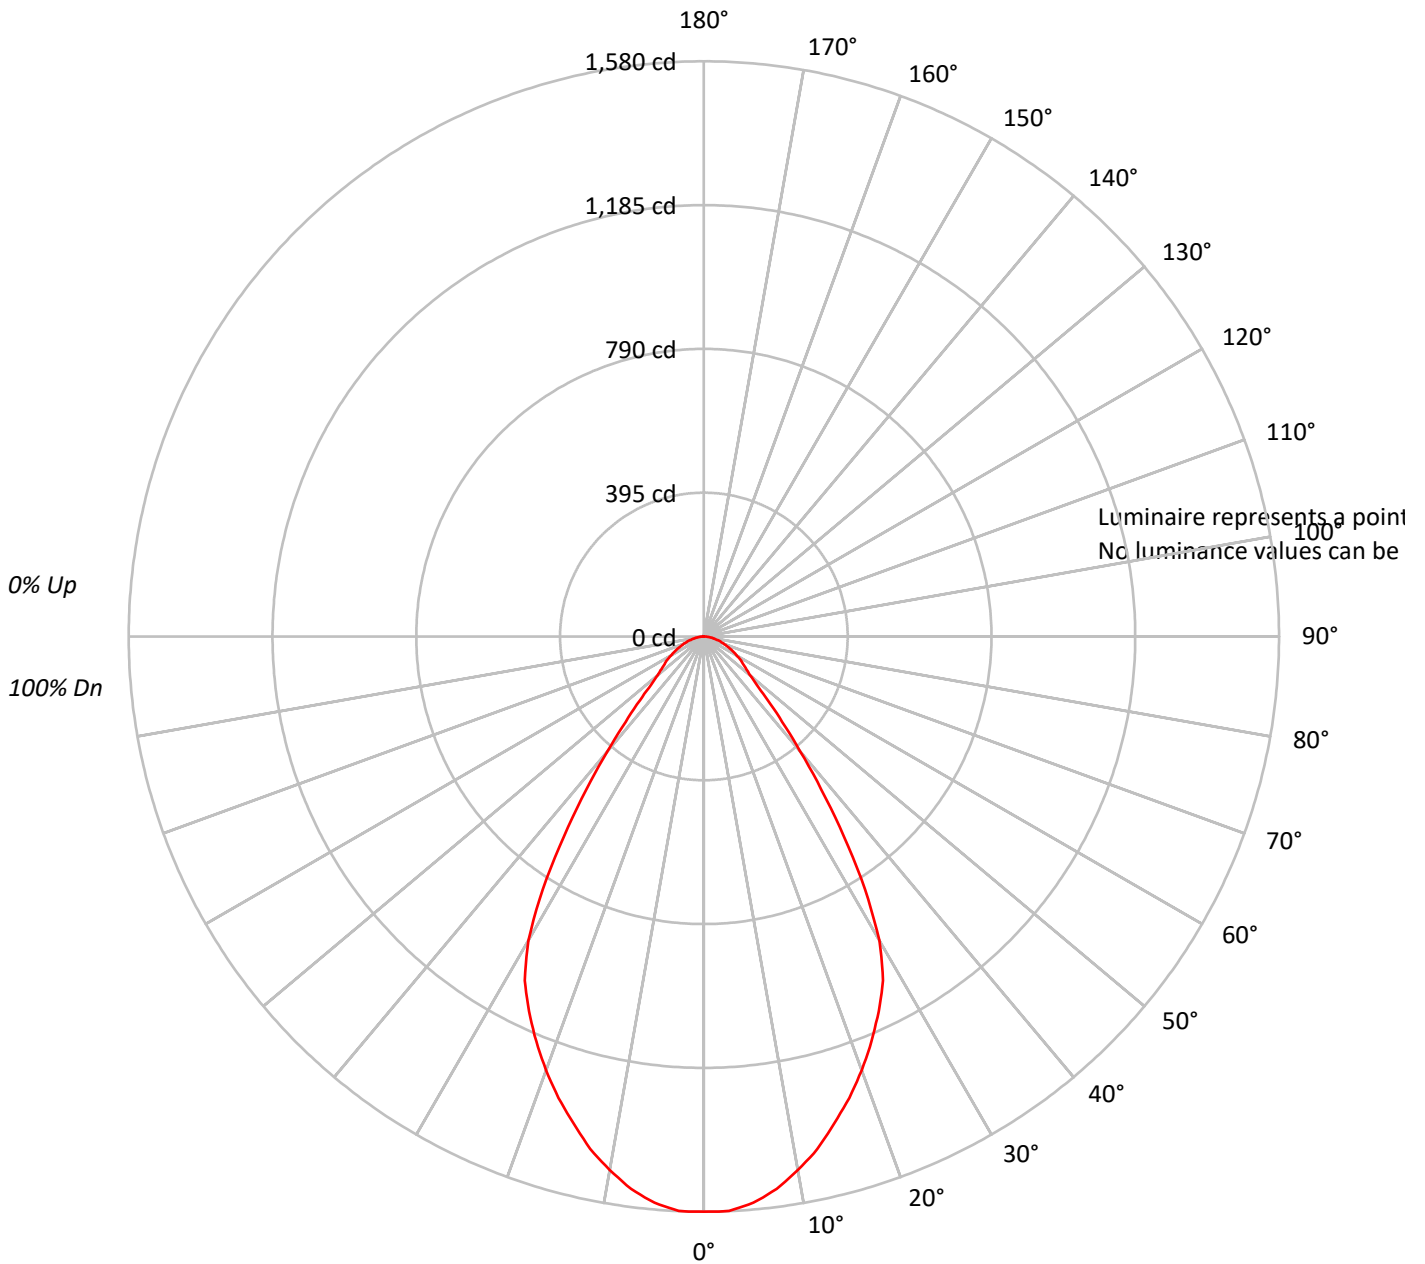



TEST NUMBER: P204077

CATALOG NUMBER: LE_6B30D010 EC6B30509024 6LBNMW1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	108	105	103	109	106	103	101	102	100	98	98	97	95	95	93	92	90			
2	105	99	94	90	102	97	92	89	94	90	87	91	87	85	88	85	83	81			
3	98	90	84	79	96	89	83	79	86	81	77	84	80	76	81	78	75	73			
4	92	83	76	71	90	82	76	71	80	74	70	77	73	69	75	71	68	66			
5	87	77	70	65	85	76	69	64	74	68	64	72	67	63	70	66	62	61			
6	81	71	64	59	80	70	63	59	68	63	58	67	62	58	66	61	57	56			
7	77	66	59	54	75	65	59	54	64	58	54	63	57	53	61	57	53	51			
8	72	61	55	50	71	61	54	50	60	54	49	59	53	49	58	53	49	47			
9	69	58	51	46	67	57	51	46	56	50	46	55	50	46	54	49	46	44			
10	65	54	47	43	64	54	47	43	53	47	43	52	46	43	51	46	43	41			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204077

CATALOG NUMBER: LE_6B30D010 EC6B30509024 6LBNMW1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	146.7	7.6
10°-20°	388.9	20.2
20°-30°	519.2	27.0
30°-40°	418.9	21.7
40°-50°	200.8	10.4
50°-60°	119.0	6.2
60°-70°	79.1	4.1
70°-80°	42.4	2.2
80°-90°	11.6	0.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1054.8	54.8
0°-40°	1473.7	76.5
0°-60°	1793.4	93.1
0°-90°	1926.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1926.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1580	
5°	1562	147
15°	1384	389
25°	1136	519
35°	671	419
45°	248	201
55°	132	119
65°	80	79
75°	40	42
85°	9	12
90°	0	



TEST NUMBER: P204077

CATALOG NUMBER: LE_6B30D010 EC6B30509024 6LBNMW1

CANDELA DISTRIBUTION (FULL):

	0°
0°	1580.0
2.5°	1580.0
5°	1561.6
7.5°	1531.0
10°	1488.1
12.5°	1442.2
15°	1384.0
17.5°	1328.9
20°	1267.6
22.5°	1203.4
25°	1136.0
27.5°	1065.6
30°	964.5
32.5°	823.6
35°	670.6
37.5°	529.8
40°	410.2
42.5°	318.5
45°	248.0
47.5°	196.0
50°	165.4
52.5°	147.0
55°	131.6
57.5°	119.4
60°	104.1
62.5°	91.9
65°	79.6
67.5°	67.4
70°	58.1
72.5°	49.0
75°	39.8
77.5°	30.6
80°	24.5
82.5°	18.4
85°	9.1
87.5°	3.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)