

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P205310

Luminaire Tested: **LE\_6B30D010 EC6B30509027 6LBNLI1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P205310  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B30D010 EC6B30509027 6LBNLI1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
NARROW DISTRIBUTION WITH SPECULAR CLEAR TRIM  
WATTAGE D010TR-27.4 W DE010-27.95 W D5LT-27.65 W DMX-27.73 W DL2-29.56 W  
DL3-29.67 W DLE-29.73 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2412.4 lumens  
Efficiency: N/A  
Efficacy: 86.2 lumens/watt  
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct

Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P205310  
CATALOG NUMBER: LE\_6B30D010 EC6B30509027 6LBNLI1

### Luminous Intensity Polar Plot

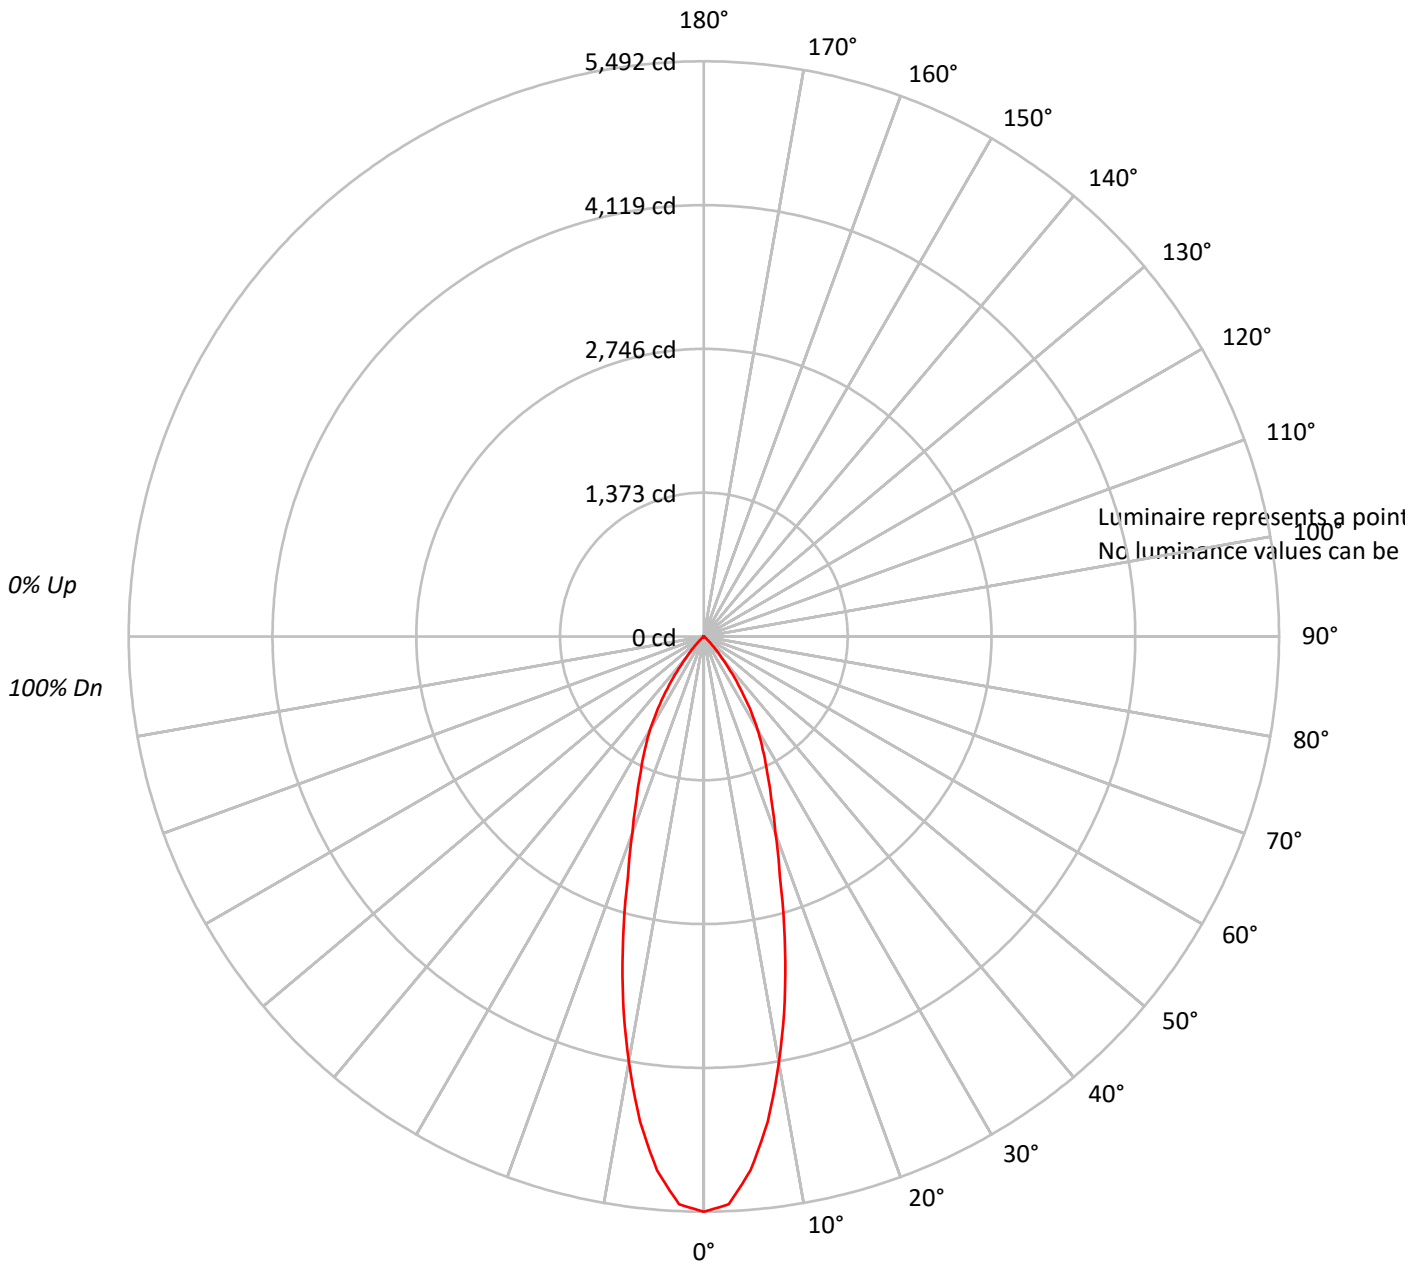



TEST NUMBER: P205310

CATALOG NUMBER: LE\_6B30D010 EC6B30509027 6LBNLI1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF  | 20  |     |     |     |     |     |     |     |     | 20  |     |     |     |     |     |     |     |     | 20 |    |   |  |  |  |  |  |  | 20 |  |  |  |  |  |  |  |  |   |
| RC  | 80  |     |     |     |     |     |     |     |     | 50  |     |     |     |     |     |     |     |     | 30 |    |   |  |  |  |  |  |  | 10 |  |  |  |  |  |  |  |  | 0 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0 |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 1   | 114 | 112 | 109 | 107 | 112 | 109 | 107 | 106 | 105 | 104 | 102 | 102 | 101 | 99  | 98  | 97  | 96  | 95  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 2   | 109 | 105 | 101 | 98  | 107 | 103 | 100 | 97  | 100 | 97  | 95  | 97  | 95  | 93  | 94  | 93  | 91  | 89  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 3   | 105 | 99  | 94  | 91  | 103 | 97  | 93  | 90  | 95  | 91  | 89  | 93  | 90  | 87  | 90  | 88  | 86  | 85  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 4   | 100 | 93  | 88  | 85  | 98  | 92  | 88  | 84  | 90  | 86  | 83  | 88  | 85  | 82  | 86  | 84  | 81  | 80  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 5   | 96  | 88  | 83  | 79  | 94  | 87  | 83  | 79  | 86  | 82  | 78  | 84  | 81  | 78  | 83  | 80  | 77  | 76  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 6   | 92  | 84  | 79  | 75  | 90  | 83  | 78  | 75  | 82  | 77  | 74  | 80  | 76  | 74  | 79  | 76  | 73  | 72  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 7   | 88  | 80  | 74  | 71  | 87  | 79  | 74  | 71  | 78  | 73  | 70  | 77  | 73  | 70  | 76  | 72  | 69  | 68  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 8   | 84  | 76  | 71  | 67  | 83  | 75  | 70  | 67  | 74  | 70  | 67  | 73  | 69  | 66  | 73  | 69  | 66  | 65  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 9   | 81  | 73  | 67  | 64  | 80  | 72  | 67  | 64  | 71  | 67  | 63  | 70  | 66  | 63  | 70  | 66  | 63  | 62  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 10  | 78  | 69  | 64  | 61  | 77  | 69  | 64  | 61  | 68  | 64  | 61  | 67  | 63  | 60  | 67  | 63  | 60  | 59  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P205310

CATALOG NUMBER: LE\_6B30D010 EC6B30509027 6LBNLI1

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 456.7  | 18.9      |
| 10°-20°   | 819.7  | 34.0      |
| 20°-30°   | 662.7  | 27.5      |
| 30°-40°   | 381.8  | 15.8      |
| 40°-50°   | 80.7   | 3.3       |
| 50°-60°   | 7.0    | 0.3       |
| 60°-70°   | 3.5    | 0.1       |
| 70°-80°   | 0.5    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 1939.0 | 80.4      |
| 0°-40°    | 2320.8 | 96.2      |
| 0°-60°    | 2408.5 | 99.8      |
| 0°-90°    | 2412.4 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 2412.4 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 5492 |      |
| 5°  | 5117 | 457  |
| 15° | 2978 | 820  |
| 25° | 1430 | 663  |
| 35° | 605  | 382  |
| 45° | 87   | 81   |
| 55° | 7    | 7    |
| 65° | 4    | 3    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P205310

CATALOG NUMBER: LE\_6B30D010 EC6B30509027 6LBNLI1

**CANDELA DISTRIBUTION (FULL):**

|       | 0°     |
|-------|--------|
| 0°    | 5492.5 |
| 2.5°  | 5426.5 |
| 5°    | 5116.9 |
| 7.5°  | 4671.6 |
| 10°   | 4125.5 |
| 12.5° | 3565.5 |
| 15°   | 2977.6 |
| 17.5° | 2410.6 |
| 20°   | 1996.6 |
| 22.5° | 1680.1 |
| 25°   | 1429.6 |
| 27.5° | 1217.5 |
| 30°   | 1026.1 |
| 32.5° | 814.0  |
| 35°   | 605.2  |
| 37.5° | 420.9  |
| 40°   | 274.8  |
| 42.5° | 167.0  |
| 45°   | 87.0   |
| 47.5° | 34.8   |
| 50°   | 10.4   |
| 52.5° | 10.4   |
| 55°   | 7.0    |
| 57.5° | 7.0    |
| 60°   | 3.5    |
| 62.5° | 3.5    |
| 65°   | 3.5    |
| 67.5° | 3.5    |
| 70°   | 3.5    |
| 72.5° | 0.0    |
| 75°   | 0.0    |
| 77.5° | 0.0    |
| 80°   | 0.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)