

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204804

Luminaire Tested: **LE\_6B30D010 EC6B30509040 6LBCSMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204804  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B30D010 EC6B30509040 6LBCSMW1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH CAST MATTE WHITE TRIM  
WATTAGE D010TR-27.4 W DE010-27.95 W D5LT-27.65 W DMX-27.73 W DL2-29.56 W  
DL3-29.67 W DLE-29.73 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3520.4 lumens  
Efficiency: N/A  
Efficacy: 125.7 lumens/watt  
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204804

CATALOG NUMBER: LE\_6B30D010 EC6B30509040 6LBCSMW1

### Luminous Intensity Polar Plot

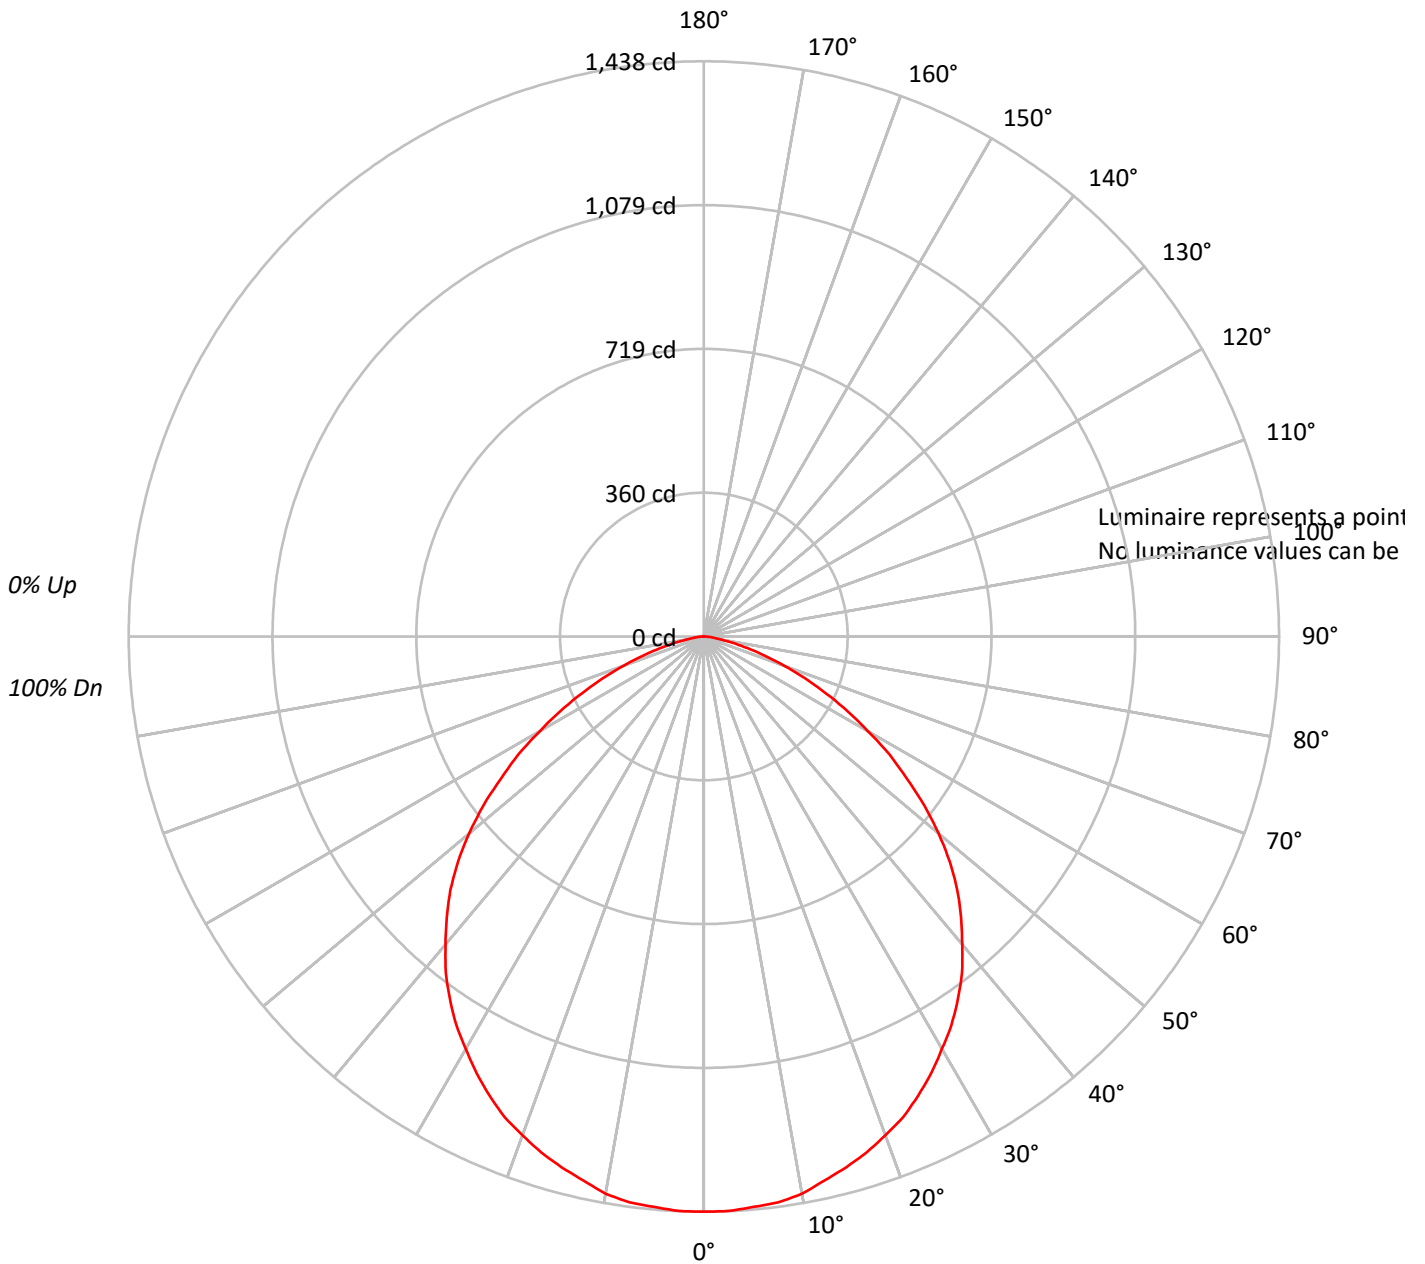



TEST NUMBER: P204804

CATALOG NUMBER: LE\_6B30D010 EC6B30509040 6LBCSMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	110	106	102	99	108	104	100	97	100	97	94	96	93	91	92	90	89	87				87
2	101	94	87	82	99	92	86	81	88	84	79	85	81	78	82	79	76	74				74
3	93	83	75	70	90	81	74	69	79	73	68	76	71	67	73	69	65	63				63
4	85	74	66	60	83	73	65	59	70	64	58	68	62	58	66	61	57	55				55
5	79	66	58	52	77	65	57	51	63	56	51	61	55	50	60	54	50	48				48
6	73	60	52	45	71	59	51	45	57	50	45	56	49	44	54	49	44	42				42
7	68	55	46	40	66	54	46	40	52	45	40	51	44	40	50	44	39	37				37
8	63	50	42	36	61	49	41	36	48	41	36	47	40	36	46	40	35	33				33
9	59	46	38	33	57	45	38	32	44	37	32	43	37	32	42	36	32	30				30
10	55	42	35	30	54	42	34	30	41	34	29	40	34	29	39	33	29	27				27

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204804

CATALOG NUMBER: LE\_6B30D010 EC6B30509040 6LBCSMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	136.2	3.9
10°-20°	387.8	11.0
20°-30°	583.4	16.6
30°-40°	691.4	19.6
40°-50°	688.1	19.5
50°-60°	554.7	15.8
60°-70°	335.6	9.5
70°-80°	124.6	3.5
80°-90°	18.5	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1107.5	31.5
0°-40°	1798.9	51.1
0°-60°	3041.7	86.4
0°-90°	3520.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3520.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1438	
5°	1432	136
15°	1374	388
25°	1267	583
35°	1107	691
45°	896	688
55°	619	555
65°	337	336
75°	113	125
85°	15	19
90°	0	



TEST NUMBER: P204804

CATALOG NUMBER: LE\_6B30D010 EC6B30509040 6LBCSMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1437.9
2.5°	1437.9
5°	1431.5
7.5°	1427.1
10°	1414.4
12.5°	1393.0
15°	1373.9
17.5°	1352.5
20°	1326.9
22.5°	1301.2
25°	1267.1
27.5°	1230.9
30°	1190.4
32.5°	1152.0
35°	1107.1
37.5°	1060.2
40°	1004.8
42.5°	951.5
45°	896.0
47.5°	834.1
50°	765.9
52.5°	695.5
55°	618.6
57.5°	550.4
60°	473.6
62.5°	405.4
65°	337.0
67.5°	273.0
70°	213.4
72.5°	160.0
75°	113.1
77.5°	72.5
80°	42.6
82.5°	25.6
85°	14.9
87.5°	6.4
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)