

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203669

Luminaire Tested: **LE_6B30D010 EC6B30509040 6LBNH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203669
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B30D010 EC6B30509040 6LBNH1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
NARROW DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM
WATTAGE D010TR-27.4 W DE010-27.95 W D5LT-27.65 W DMX-27.73 W DL2-29.56 W
DL3-29.67 W DLE-29.73 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2016.0 lumens
Efficiency: N/A
Efficacy: 72.0 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 28
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203669

CATALOG NUMBER: LE_6B30D010 EC6B30509040 6LBNH1

Luminous Intensity Polar Plot

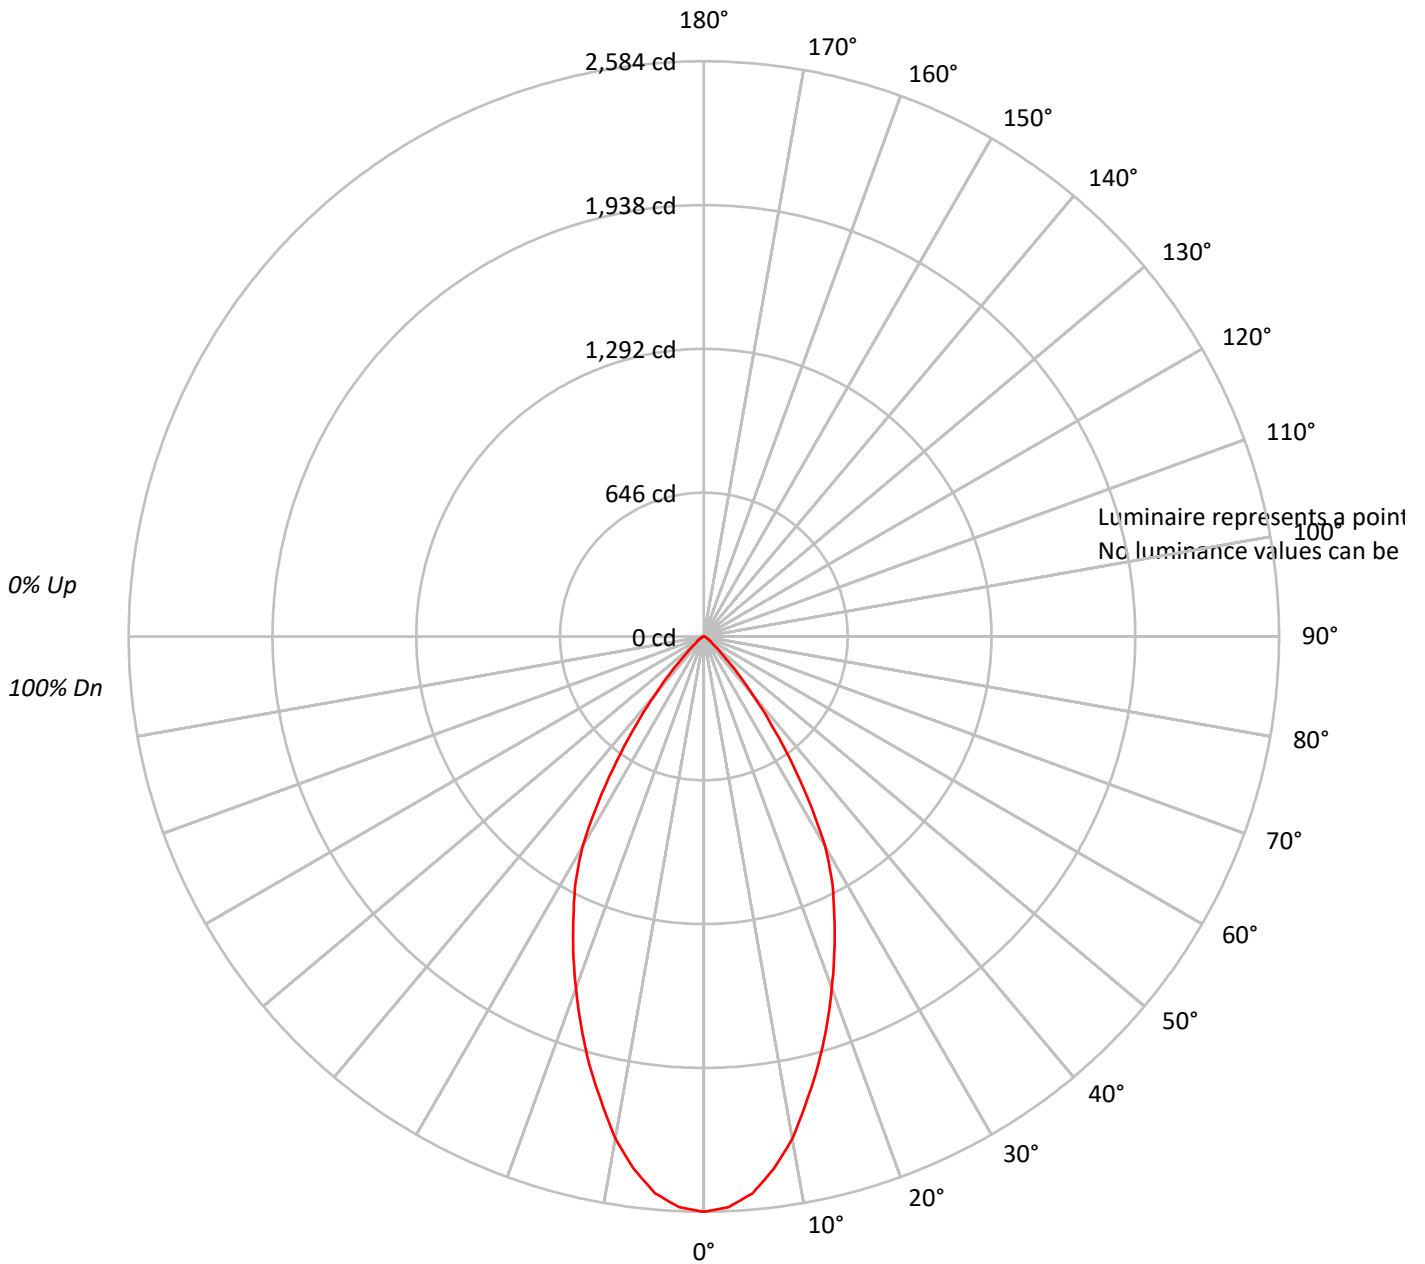



TEST NUMBER: P203669

CATALOG NUMBER: LE_6B30D010 EC6B30509040 6LBNH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 113 | 111 | 108 | 106 | 111 | 109 | 106 | 104 | 105 | 103 | 101 | 101 | 99 | 98 | 97 | 96 | 95 | 93 | | | | | | | | | | | | | | | | | | | |
| 2 | 108 | 103 | 99 | 96 | 106 | 101 | 98 | 94 | 98 | 95 | 92 | 95 | 93 | 90 | 92 | 90 | 89 | 87 | | | | | | | | | | | | | | | | | | | |
| 3 | 102 | 96 | 91 | 87 | 100 | 95 | 90 | 86 | 92 | 88 | 85 | 90 | 86 | 84 | 87 | 85 | 82 | 81 | | | | | | | | | | | | | | | | | | | |
| 4 | 97 | 90 | 84 | 80 | 95 | 89 | 83 | 79 | 86 | 82 | 78 | 84 | 81 | 78 | 83 | 79 | 77 | 75 | | | | | | | | | | | | | | | | | | | |
| 5 | 92 | 84 | 78 | 74 | 91 | 83 | 78 | 73 | 81 | 76 | 73 | 80 | 75 | 72 | 78 | 74 | 72 | 70 | | | | | | | | | | | | | | | | | | | |
| 6 | 88 | 79 | 73 | 69 | 86 | 78 | 72 | 68 | 77 | 72 | 68 | 75 | 71 | 67 | 74 | 70 | 67 | 65 | | | | | | | | | | | | | | | | | | | |
| 7 | 83 | 74 | 68 | 64 | 82 | 73 | 68 | 64 | 72 | 67 | 63 | 71 | 66 | 63 | 70 | 66 | 63 | 61 | | | | | | | | | | | | | | | | | | | |
| 8 | 79 | 70 | 64 | 60 | 78 | 69 | 64 | 60 | 68 | 63 | 59 | 67 | 63 | 59 | 66 | 62 | 59 | 58 | | | | | | | | | | | | | | | | | | | |
| 9 | 76 | 66 | 60 | 56 | 75 | 66 | 60 | 56 | 65 | 59 | 56 | 64 | 59 | 56 | 63 | 59 | 55 | 54 | | | | | | | | | | | | | | | | | | | |
| 10 | 72 | 62 | 57 | 53 | 71 | 62 | 57 | 53 | 61 | 56 | 53 | 60 | 56 | 52 | 60 | 55 | 52 | 51 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203669

CATALOG NUMBER: LE_6B30D010 EC6B30509040 6LBNH1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 232.4 | 11.5 |
| 10°-20° | 554.2 | 27.5 |
| 20°-30° | 634.9 | 31.5 |
| 30°-40° | 426.6 | 21.2 |
| 40°-50° | 121.9 | 6.0 |
| 50°-60° | 29.8 | 1.5 |
| 60°-70° | 11.4 | 0.6 |
| 70°-80° | 4.3 | 0.2 |
| 80°-90° | 0.5 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1421.5 | 70.5 |
| 0°-40° | 1848.1 | 91.7 |
| 0°-60° | 1999.8 | 99.2 |
| 0°-90° | 2016.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 2016.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2584 | |
| 5° | 2511 | 232 |
| 15° | 1989 | 554 |
| 25° | 1386 | 635 |
| 35° | 680 | 427 |
| 45° | 140 | 122 |
| 55° | 33 | 30 |
| 65° | 11 | 11 |
| 75° | 4 | 4 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P203669

CATALOG NUMBER: LE_6B30D010 EC6B30509040 6LBNH1

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 2584.4 |
| 2.5° | 2565.9 |
| 5° | 2510.8 |
| 7.5° | 2411.5 |
| 10° | 2290.2 |
| 12.5° | 2135.9 |
| 15° | 1988.8 |
| 17.5° | 1834.4 |
| 20° | 1680.0 |
| 22.5° | 1533.0 |
| 25° | 1385.9 |
| 27.5° | 1249.9 |
| 30° | 1091.8 |
| 32.5° | 882.2 |
| 35° | 680.1 |
| 37.5° | 496.2 |
| 40° | 341.9 |
| 42.5° | 224.2 |
| 45° | 139.8 |
| 47.5° | 84.5 |
| 50° | 51.5 |
| 52.5° | 40.4 |
| 55° | 33.1 |
| 57.5° | 25.8 |
| 60° | 18.4 |
| 62.5° | 14.8 |
| 65° | 11.0 |
| 67.5° | 7.4 |
| 70° | 7.4 |
| 72.5° | 3.6 |
| 75° | 3.6 |
| 77.5° | 3.6 |
| 80° | 3.6 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)