

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204494

Luminaire Tested: **LE\_6B30D010 EC6B30509050 6LBSB1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204494  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B30D010 EC6B30509050 6LBSB1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH SPECULAR BLACK TRIM  
WATTAGE D010TR-27.4 W DE010-27.95 W D5LT-27.65 W DMX-27.73 W DL2-29.56 W  
DL3-29.67 W DLE-29.73 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2946.7 lumens  
Efficiency: N/A  
Efficacy: 105.2 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.3  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 28  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204494

CATALOG NUMBER: LE\_6B30D010 EC6B30509050 6LBSB1

### Luminous Intensity Polar Plot

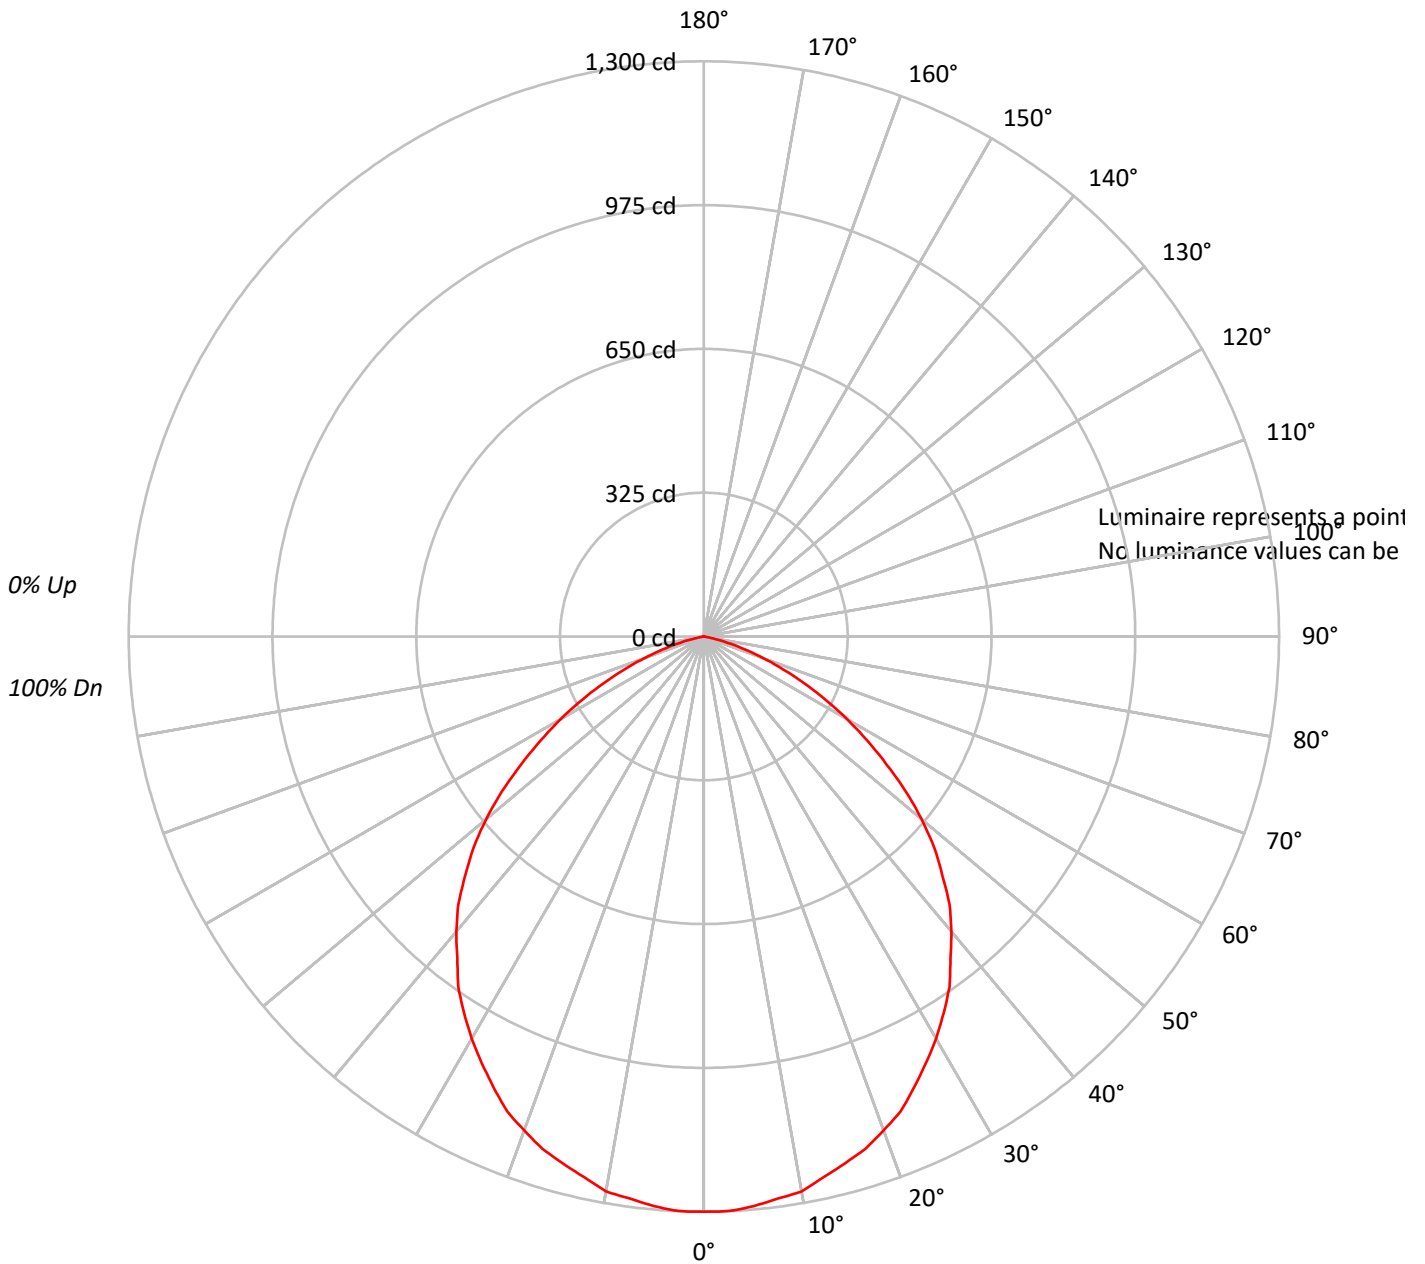



TEST NUMBER: P204494

CATALOG NUMBER: LE\_6B30D010 EC6B30509050 6LBSB1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	107	103	100	108	105	101	98	100	98	95	97	94	93	93	91	90	88				88
2	102	95	89	84	100	93	88	83	90	85	81	86	83	79	84	80	78	76				76
3	94	84	77	72	91	83	76	71	80	74	70	77	73	69	75	71	67	65				65
4	86	76	68	62	84	74	67	61	72	65	60	70	64	60	68	63	59	57				57
5	80	68	60	54	78	67	59	53	65	58	53	63	57	52	61	56	52	50				50
6	74	62	53	47	72	61	53	47	59	52	47	57	51	46	56	50	46	44				44
7	69	56	48	42	67	55	48	42	54	47	42	52	46	41	51	45	41	39				39
8	64	51	43	38	63	51	43	38	49	42	37	48	42	37	47	41	37	35				35
9	60	47	39	34	59	47	39	34	46	39	34	45	38	34	44	38	34	32				32
10	56	44	36	31	55	43	36	31	42	36	31	41	35	31	40	35	31	29				29

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204494

CATALOG NUMBER: LE\_6B30D010 EC6B30509050 6LBSB1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	122.7	4.2
10°-20°	348.1	11.8
20°-30°	517.9	17.6
30°-40°	602.6	20.5
40°-50°	587.4	19.9
50°-60°	451.7	15.3
60°-70°	249.7	8.5
70°-80°	66.1	2.2
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	988.7	33.6
0°-40°	1591.3	54.0
0°-60°	2630.4	89.3
0°-90°	2946.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2946.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1300	
5°	1292	123
15°	1233	348
25°	1124	518
35°	968	603
45°	762	587
55°	504	452
65°	250	250
75°	56	66
85°	0	1
90°	0	



TEST NUMBER: P204494

CATALOG NUMBER: LE\_6B30D010 EC6B30509050 6LBSB1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1300.0
2.5°	1300.0
5°	1292.5
7.5°	1281.2
10°	1273.8
12.5°	1251.4
15°	1232.8
17.5°	1214.0
20°	1187.9
22.5°	1161.8
25°	1124.4
27.5°	1087.0
30°	1049.6
32.5°	1008.6
35°	967.5
37.5°	915.2
40°	870.4
42.5°	821.8
45°	762.0
47.5°	706.0
50°	642.5
52.5°	575.2
55°	504.2
57.5°	437.0
60°	373.5
62.5°	310.0
65°	250.2
67.5°	194.2
70°	142.0
72.5°	97.1
75°	56.0
77.5°	26.1
80°	3.8
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)