

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203575

Luminaire Tested: **LE_6B40D010 EC6B30509024 6LBMMW1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203575
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509024 6LBMMW1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
MEDIUM DISTRIBUTION WITH MATTE WHITE TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3026.4 lumens
Efficiency: N/A
Efficacy: 72.4 lumens/watt
Spacing Criteria (0/90/45): 1 / 1 / 0.97
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203575

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBMMW1

Luminous Intensity Polar Plot

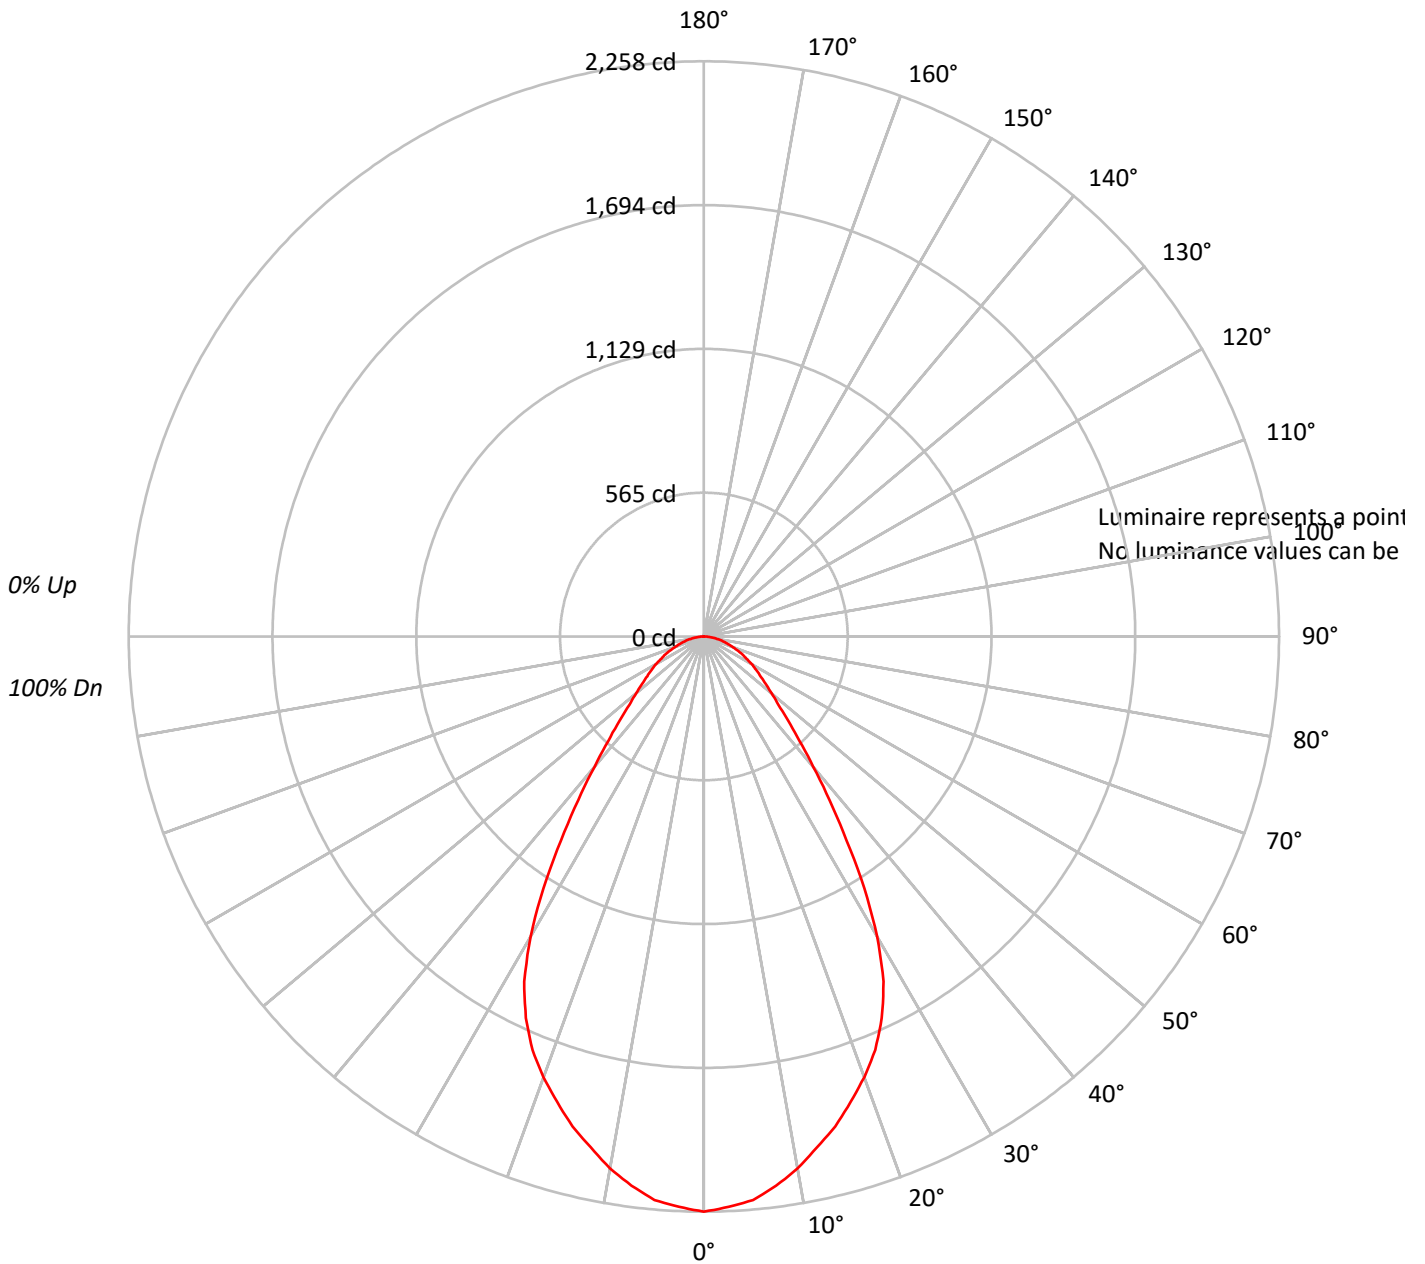



TEST NUMBER: P203575

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBMMW1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	108	104	101	109	105	103	100	101	99	97	98	96	94	94	92	91	89			
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79			
3	97	88	82	77	95	87	81	76	84	79	75	82	77	74	79	76	73	71			
4	90	81	74	68	88	80	73	68	77	72	67	75	70	66	73	69	65	64			
5	85	74	67	61	83	73	66	61	71	65	61	69	64	60	68	63	59	58			
6	79	68	61	56	78	68	61	56	66	60	55	64	59	55	63	58	54	53			
7	75	63	56	51	73	63	56	51	61	55	50	60	54	50	59	54	50	48			
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44			
9	66	55	48	43	65	54	48	43	53	47	43	52	47	43	51	46	43	41			
10	63	51	45	40	62	51	44	40	50	44	40	49	44	40	48	43	40	38			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203575

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBMMW1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	208.6	6.9
10°-20°	558.7	18.5
20°-30°	750.2	24.8
30°-40°	615.4	20.3
40°-50°	369.6	12.2
50°-60°	245.6	8.1
60°-70°	164.6	5.4
70°-80°	88.6	2.9
80°-90°	25.0	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1517.6	50.1
0°-40°	2133.0	70.5
0°-60°	2748.2	90.8
0°-90°	3026.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3026.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2258	
5°	2221	209
15°	1991	559
25°	1653	750
35°	977	615
45°	468	370
55°	271	246
65°	167	165
75°	84	89
85°	21	25
90°	0	



TEST NUMBER: P203575

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBMMW1

CANDELA DISTRIBUTION (FULL):

	0°
0°	2258.1
2.5°	2241.4
5°	2220.6
7.5°	2174.6
10°	2120.4
12.5°	2053.6
15°	1991.0
17.5°	1915.9
20°	1840.8
22.5°	1757.2
25°	1652.9
27.5°	1527.6
30°	1360.8
32.5°	1172.9
35°	976.8
37.5°	809.8
40°	667.9
42.5°	555.1
45°	467.5
47.5°	396.5
50°	346.5
52.5°	304.8
55°	271.2
57.5°	242.1
60°	217.0
62.5°	187.9
65°	167.0
67.5°	141.9
70°	121.0
72.5°	100.1
75°	83.5
77.5°	66.8
80°	50.1
82.5°	37.6
85°	20.9
87.5°	8.4
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)