

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203987

Luminaire Tested: **LE_6B40D010 EC6B30509024 6LBNB1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203987
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509024 6LBNB1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
NARROW DISTRIBUTION WITH SPECULAR BLACK TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1647.2 lumens
Efficiency: N/A
Efficacy: 39.4 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.83
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203987

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBNB1

Luminous Intensity Polar Plot

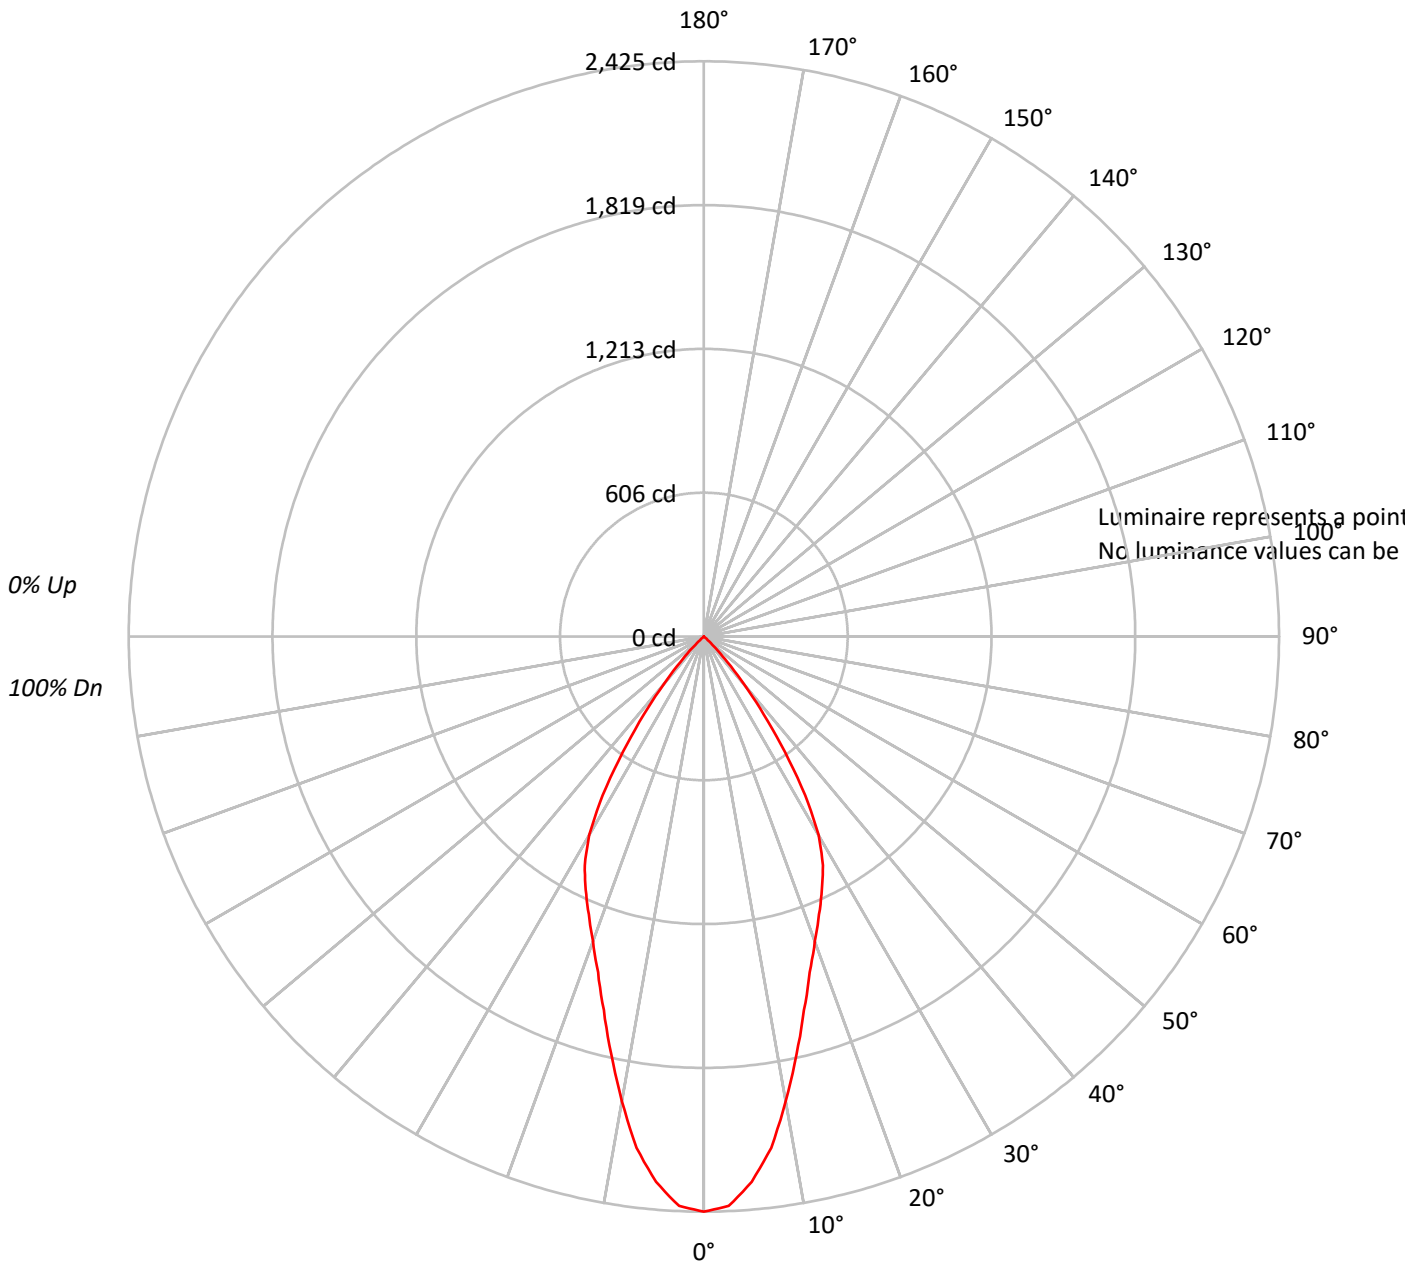



TEST NUMBER: P203987

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBNB1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	109	107	111	109	107	105	105	103	102	101	100	99	98	97	96	94																			
2	108	104	100	97	106	102	99	96	99	96	93	96	94	91	93	91	90	88																			
3	103	97	92	88	101	96	91	88	93	89	86	91	88	85	88	86	84	82																			
4	98	91	86	82	96	90	85	81	88	84	80	86	82	79	84	81	78	77																			
5	93	85	80	76	92	85	79	75	83	78	75	81	77	74	80	76	73	72																			
6	89	80	75	71	88	80	74	70	78	73	70	77	73	69	75	72	69	67																			
7	85	76	70	66	83	75	70	66	74	69	65	73	68	65	72	68	65	63																			
8	81	72	66	62	80	71	66	62	70	65	61	69	64	61	68	64	61	60																			
9	77	68	62	58	76	67	62	58	66	61	58	65	61	58	65	61	58	56																			
10	74	64	59	55	73	64	58	55	63	58	55	62	58	55	62	57	54	53																			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203987

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBNB1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	210.4	12.8
10°-20°	458.4	27.8
20°-30°	538.7	32.7
30°-40°	370.9	22.5
40°-50°	68.7	4.2
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1207.6	73.3
0°-40°	1578.5	95.8
0°-60°	1647.2	100.0
0°-90°	1647.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1647.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2425	
5°	2308	210
15°	1631	458
25°	1178	539
35°	595	371
45°	69	69
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P203987

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBNB1

CANDELA DISTRIBUTION (FULL):

	0°
0°	2424.9
2.5°	2403.2
5°	2308.4
7.5°	2174.6
10°	1989.1
12.5°	1803.5
15°	1631.0
17.5°	1484.2
20°	1367.8
22.5°	1268.5
25°	1177.9
27.5°	1087.2
30°	966.5
32.5°	793.9
35°	595.4
37.5°	414.2
40°	263.2
42.5°	146.8
45°	69.0
47.5°	21.6
50°	0.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)