

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203781

Luminaire Tested: **LE_6B40D010 EC6B30509024 6LBNWH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203781
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509024 6LBNWH1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
NARROW DISTRIBUTION WITH WHEAT TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2542.2 lumens
Efficiency: N/A
Efficacy: 60.8 lumens/watt
Spacing Criteria (0/90/45): 0.56 / 0.56 / 0.64
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203781

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBNWH1

Luminous Intensity Polar Plot

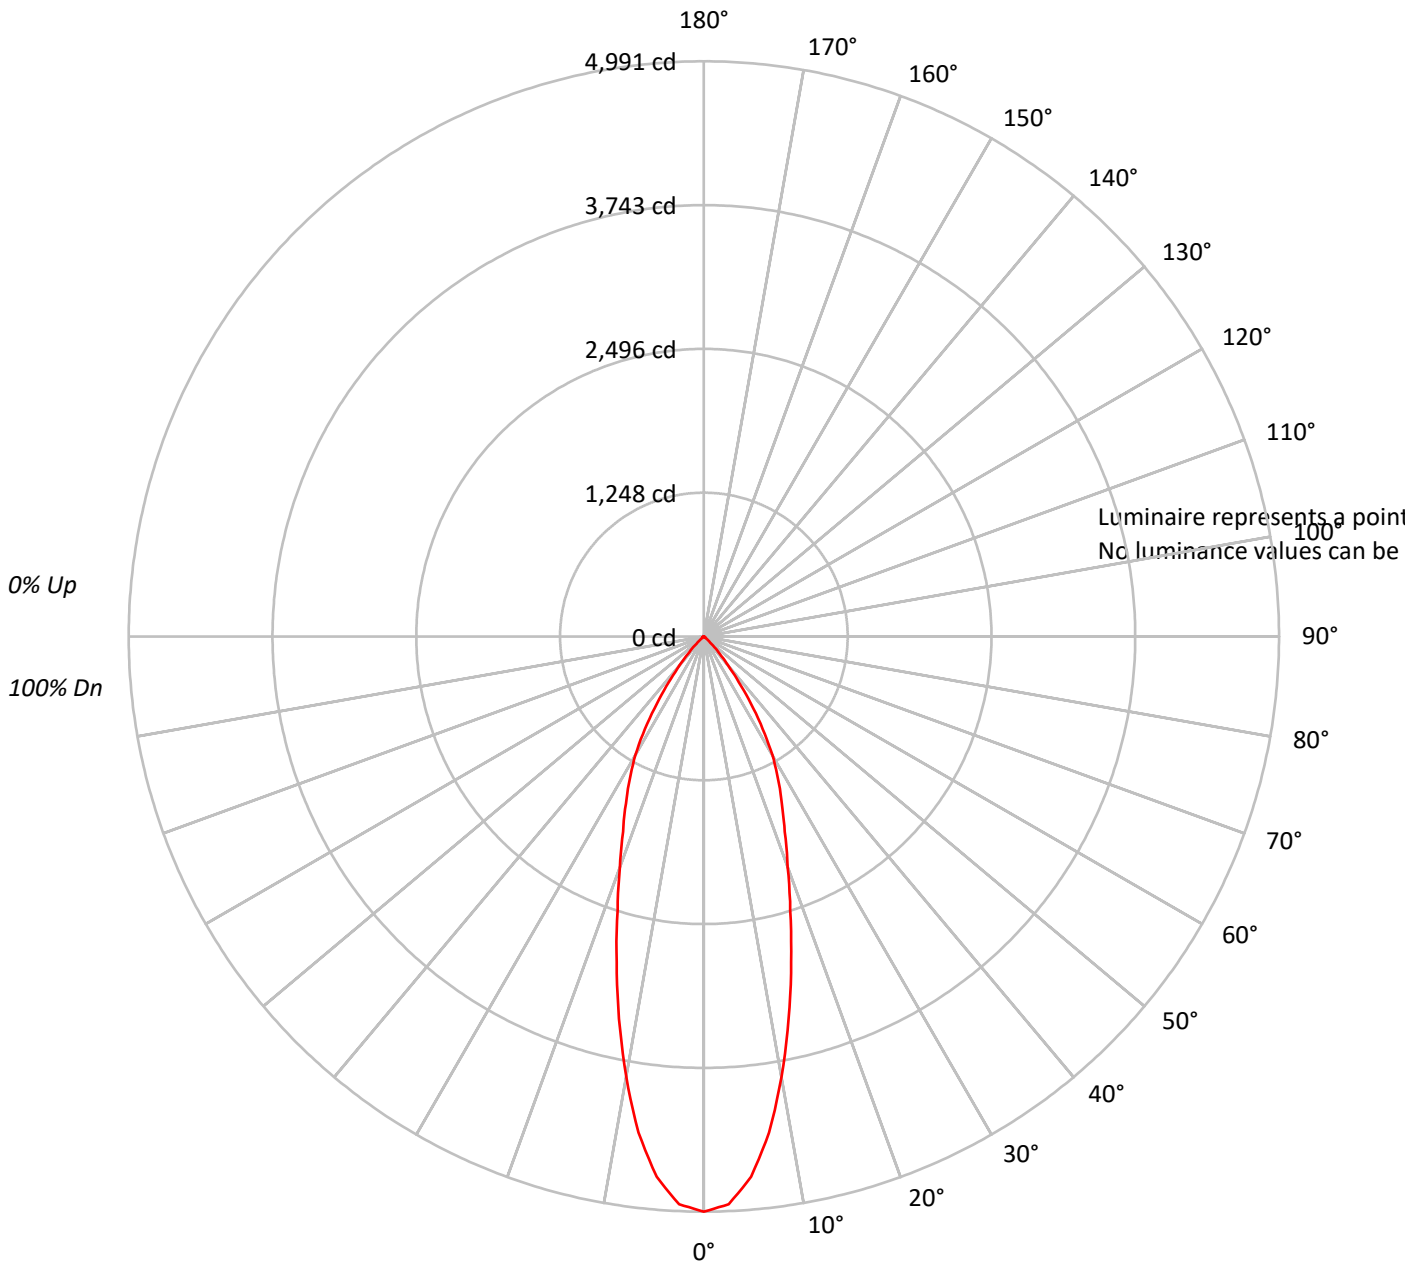



TEST NUMBER: P203781

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBNWH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	109	107	112	109	107	105	105	104	102	101	100	99	98	97	96	94		
2	109	104	101	97	107	103	99	96	99	97	94	96	94	92	94	92	90	89		
3	104	98	93	90	102	97	92	89	94	91	88	92	89	86	89	87	85	83		
4	99	92	87	83	97	91	86	83	89	85	82	87	84	81	85	82	80	79		
5	95	87	82	78	93	86	81	77	84	80	77	83	79	76	81	78	75	74		
6	91	82	77	73	89	82	76	73	80	76	72	79	75	72	78	74	71	70		
7	87	78	73	69	85	77	72	69	76	72	68	75	71	68	74	70	67	66		
8	83	74	69	65	82	74	68	65	73	68	65	72	67	64	71	67	64	63		
9	79	71	65	62	78	70	65	61	69	65	61	68	64	61	68	64	61	60		
10	76	67	62	58	75	67	62	58	66	61	58	65	61	58	65	61	58	57		

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203781

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBNWH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	422.5	16.6
10°-20°	811.8	31.9
20°-30°	738.0	29.0
30°-40°	447.4	17.6
40°-50°	101.9	4.0
50°-60°	13.0	0.5
60°-70°	5.9	0.2
70°-80°	1.7	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1972.4	77.6
0°-40°	2419.7	95.2
0°-60°	2534.6	99.7
0°-90°	2542.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2542.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4991	
5°	4706	422
15°	2924	812
25°	1600	738
35°	709	447
45°	112	102
55°	13	13
65°	4	6
75°	0	2
85°	0	0
90°	0	



TEST NUMBER: P203781

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBNWH1

CANDELA DISTRIBUTION (FULL):

	0°
0°	4991.0
2.5°	4930.4
5°	4705.5
7.5°	4342.2
10°	3879.5
12.5°	3399.4
15°	2923.6
17.5°	2491.1
20°	2127.9
22.5°	1833.8
25°	1600.2
27.5°	1392.6
30°	1189.4
32.5°	951.5
35°	709.2
37.5°	497.4
40°	328.8
42.5°	203.2
45°	112.5
47.5°	51.9
50°	21.6
52.5°	17.2
55°	13.0
57.5°	13.0
60°	8.6
62.5°	8.6
65°	4.4
67.5°	4.4
70°	4.4
72.5°	4.4
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)