

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P202957

Luminaire Tested: **LE_6B40D010 EC6B30509024 6LBWGPH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P202957
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509024 6LBWGPH1
Description: PORTFOLIO 6 INCH 60 DEGREE CUTOFF RECESSED DOWNLIGHT
WIDE DISTRIBUTIONWITH GRAPHITE HAZE TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2511.8 lumens
Efficiency: N/A
Efficacy: 60.1 lumens/watt
Spacing Criteria (0/90/45): 1.11 / 1.11 / 1.11
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P202957

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBWGPH1

Luminous Intensity Polar Plot

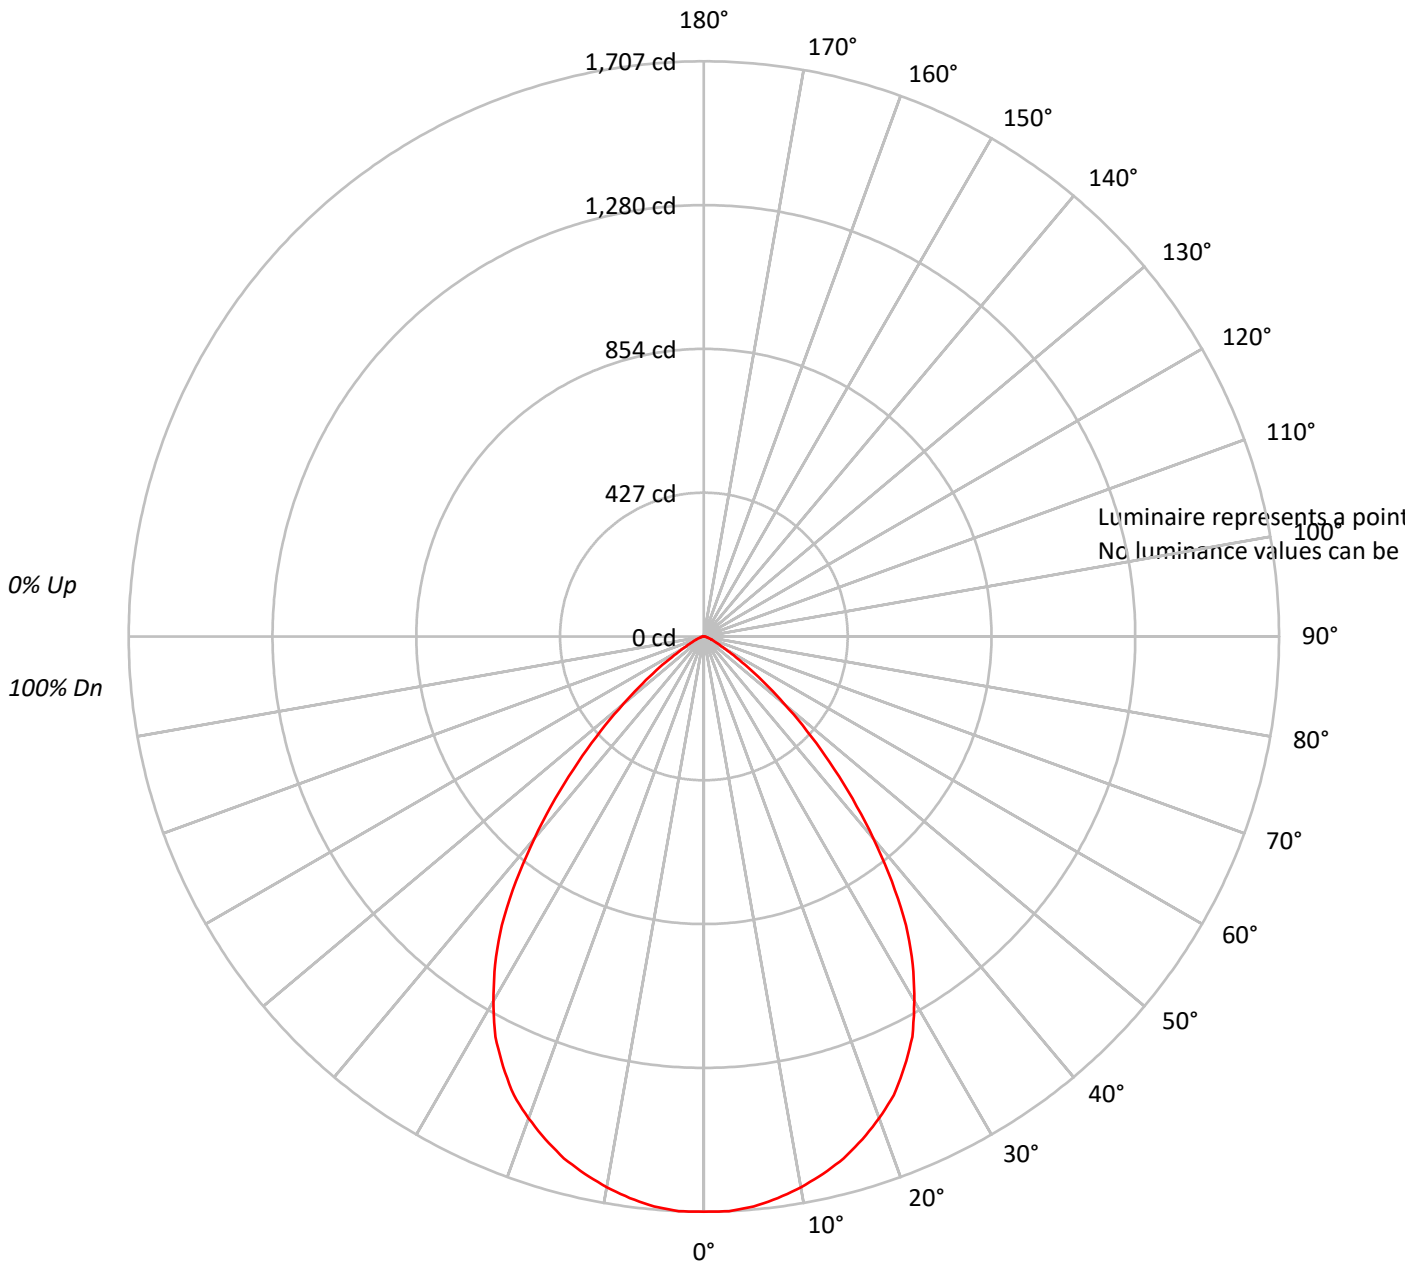



TEST NUMBER: P202957

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBWGPH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	86	84	82			
3	99	91	85	81	97	90	84	80	87	82	79	85	81	77	82	79	76	74			
4	93	84	77	72	91	82	76	72	80	75	71	78	74	70	76	72	69	67			
5	87	77	70	65	85	76	69	65	74	68	64	72	67	63	71	66	63	61			
6	81	71	64	59	80	70	63	59	68	62	58	67	62	58	65	61	57	56			
7	76	65	58	53	75	65	58	53	63	57	53	62	57	53	61	56	52	51			
8	72	61	54	49	70	60	53	49	59	53	49	58	52	48	57	52	48	47			
9	68	57	50	45	66	56	49	45	55	49	45	54	48	45	53	48	44	43			
10	64	53	46	42	63	52	46	42	51	45	41	51	45	41	50	45	41	40			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P202957

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBWGPH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	160.8	6.4
10°-20°	451.0	18.0
20°-30°	645.3	25.7
30°-40°	643.1	25.6
40°-50°	409.6	16.3
50°-60°	151.1	6.0
60°-70°	37.8	1.5
70°-80°	11.4	0.5
80°-90°	1.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1257.1	50.0
0°-40°	1900.3	75.7
0°-60°	2460.9	98.0
0°-90°	2511.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2511.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1707	
5°	1698	161
15°	1604	451
25°	1409	645
35°	1046	643
45°	527	410
55°	160	151
65°	35	38
75°	9	11
85°	0	2
90°	0	



TEST NUMBER: P202957

CATALOG NUMBER: LE_6B40D010 EC6B30509024 6LBWGPH1

CANDELA DISTRIBUTION (FULL):

	0°
0°	1707.2
2.5°	1707.2
5°	1698.5
7.5°	1681.2
10°	1659.6
12.5°	1633.8
15°	1603.5
17.5°	1564.6
20°	1521.4
22.5°	1473.8
25°	1409.0
27.5°	1339.9
30°	1249.1
32.5°	1154.0
35°	1045.9
37.5°	916.2
40°	782.2
42.5°	652.6
45°	527.2
47.5°	414.9
50°	311.1
52.5°	229.1
55°	159.9
57.5°	103.8
60°	69.1
62.5°	47.5
65°	34.6
67.5°	25.9
70°	21.6
72.5°	13.0
75°	8.6
77.5°	8.6
80°	4.4
82.5°	4.4
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)