

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204808

Luminaire Tested: **LE\_6B40D010 EC6B30508027 6LBCSMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204808  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508027 6LBCSMW1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH CAST MATTE WHITE TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5486.7 lumens  
Efficiency: N/A  
Efficacy: 131.3 lumens/watt  
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204808

CATALOG NUMBER: LE\_6B40D010 EC6B30508027 6LBCSMW1

### Luminous Intensity Polar Plot

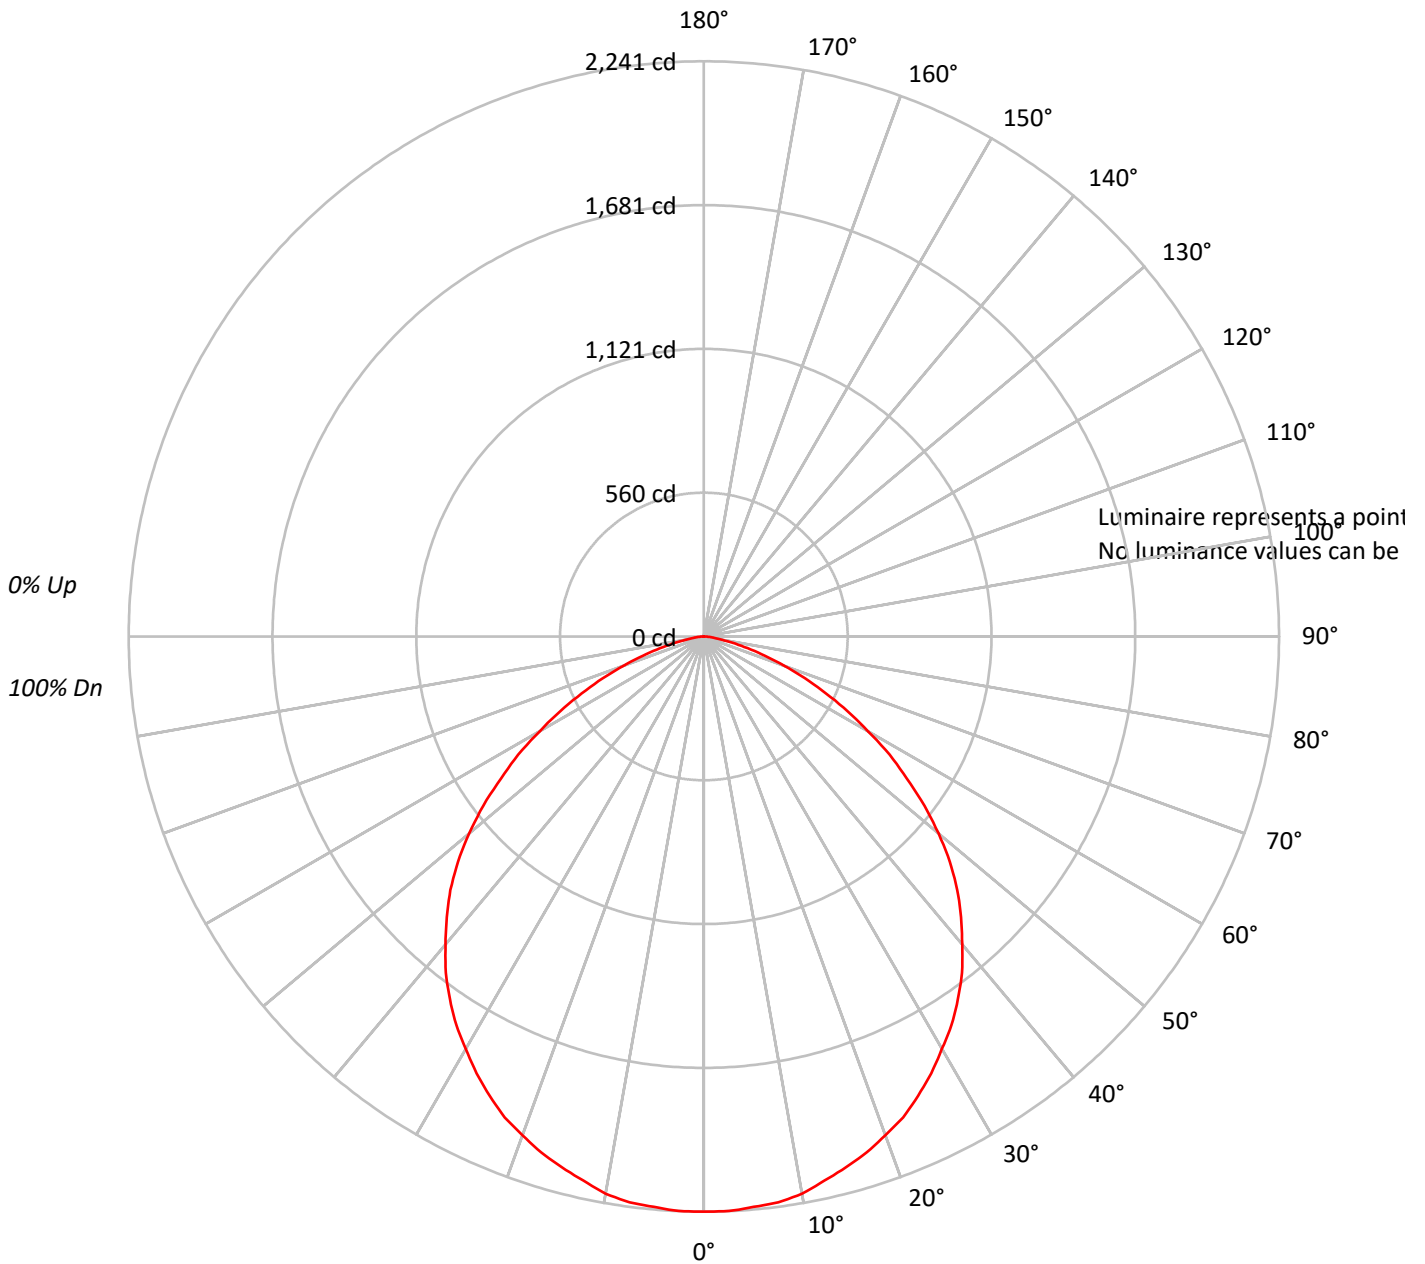



TEST NUMBER: P204808

CATALOG NUMBER: LE\_6B40D010 EC6B30508027 6LBCSMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	110	106	102	99	108	104	100	97	100	97	94	96	93	91	92	90	89	87				87
2	101	94	87	82	99	92	86	81	88	84	79	85	81	78	82	79	76	74				74
3	93	83	75	70	90	81	74	69	79	73	68	76	71	67	73	69	65	63				63
4	85	74	66	60	83	73	65	59	70	64	58	68	62	58	66	61	57	55				55
5	79	66	58	52	77	65	57	51	63	56	51	61	55	50	60	54	50	48				48
6	73	60	52	45	71	59	51	45	57	50	45	56	49	44	54	49	44	42				42
7	68	55	46	40	66	54	46	40	52	45	40	51	44	40	50	44	39	37				37
8	63	50	42	36	61	49	41	36	48	41	36	47	40	36	46	40	35	33				33
9	59	46	38	33	57	45	38	32	44	37	32	43	37	32	42	36	32	30				30
10	55	42	35	30	54	42	34	30	41	34	29	40	34	29	39	33	29	27				27

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204808

CATALOG NUMBER: LE\_6B40D010 EC6B30508027 6LBCSMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	212.3	3.9
10°-20°	604.4	11.0
20°-30°	909.3	16.6
30°-40°	1077.6	19.6
40°-50°	1072.4	19.5
50°-60°	864.5	15.8
60°-70°	523.0	9.5
70°-80°	194.2	3.5
80°-90°	28.9	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1726.0	31.5
0°-40°	2803.7	51.1
0°-60°	4740.6	86.4
0°-90°	5486.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5486.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2241	
5°	2231	212
15°	2141	604
25°	1975	909
35°	1726	1078
45°	1396	1072
55°	964	865
65°	525	523
75°	176	194
85°	23	29
90°	0	



TEST NUMBER: P204808

CATALOG NUMBER: LE\_6B40D010 EC6B30508027 6LBCSMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2240.9
2.5°	2240.9
5°	2231.0
7.5°	2224.2
10°	2204.4
12.5°	2171.1
15°	2141.1
17.5°	2107.9
20°	2068.0
22.5°	2028.1
25°	1975.0
27.5°	1918.4
30°	1855.2
32.5°	1795.4
35°	1725.6
37.5°	1652.4
40°	1566.0
42.5°	1482.9
45°	1396.4
47.5°	1300.0
50°	1193.6
52.5°	1083.9
55°	964.2
57.5°	857.8
60°	738.1
62.5°	631.8
65°	525.4
67.5°	425.6
70°	332.5
72.5°	249.4
75°	176.2
77.5°	113.0
80°	66.5
82.5°	39.9
85°	23.2
87.5°	10.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)