

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203879

Luminaire Tested: **LE\_6B40D010 EC6B30508027 6LBNGPH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203879  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508027 6LBNGPH1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
NARROW DISTRIBUTION WITH GRAPHITE HAZE TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2512.6 lumens  
Efficiency: N/A  
Efficacy: 60.1 lumens/watt  
Spacing Criteria (0/90/45): 0.84 / 0.84 / 0.88  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203879

CATALOG NUMBER: LE\_6B40D010 EC6B30508027 6LBNGPH1

### Luminous Intensity Polar Plot

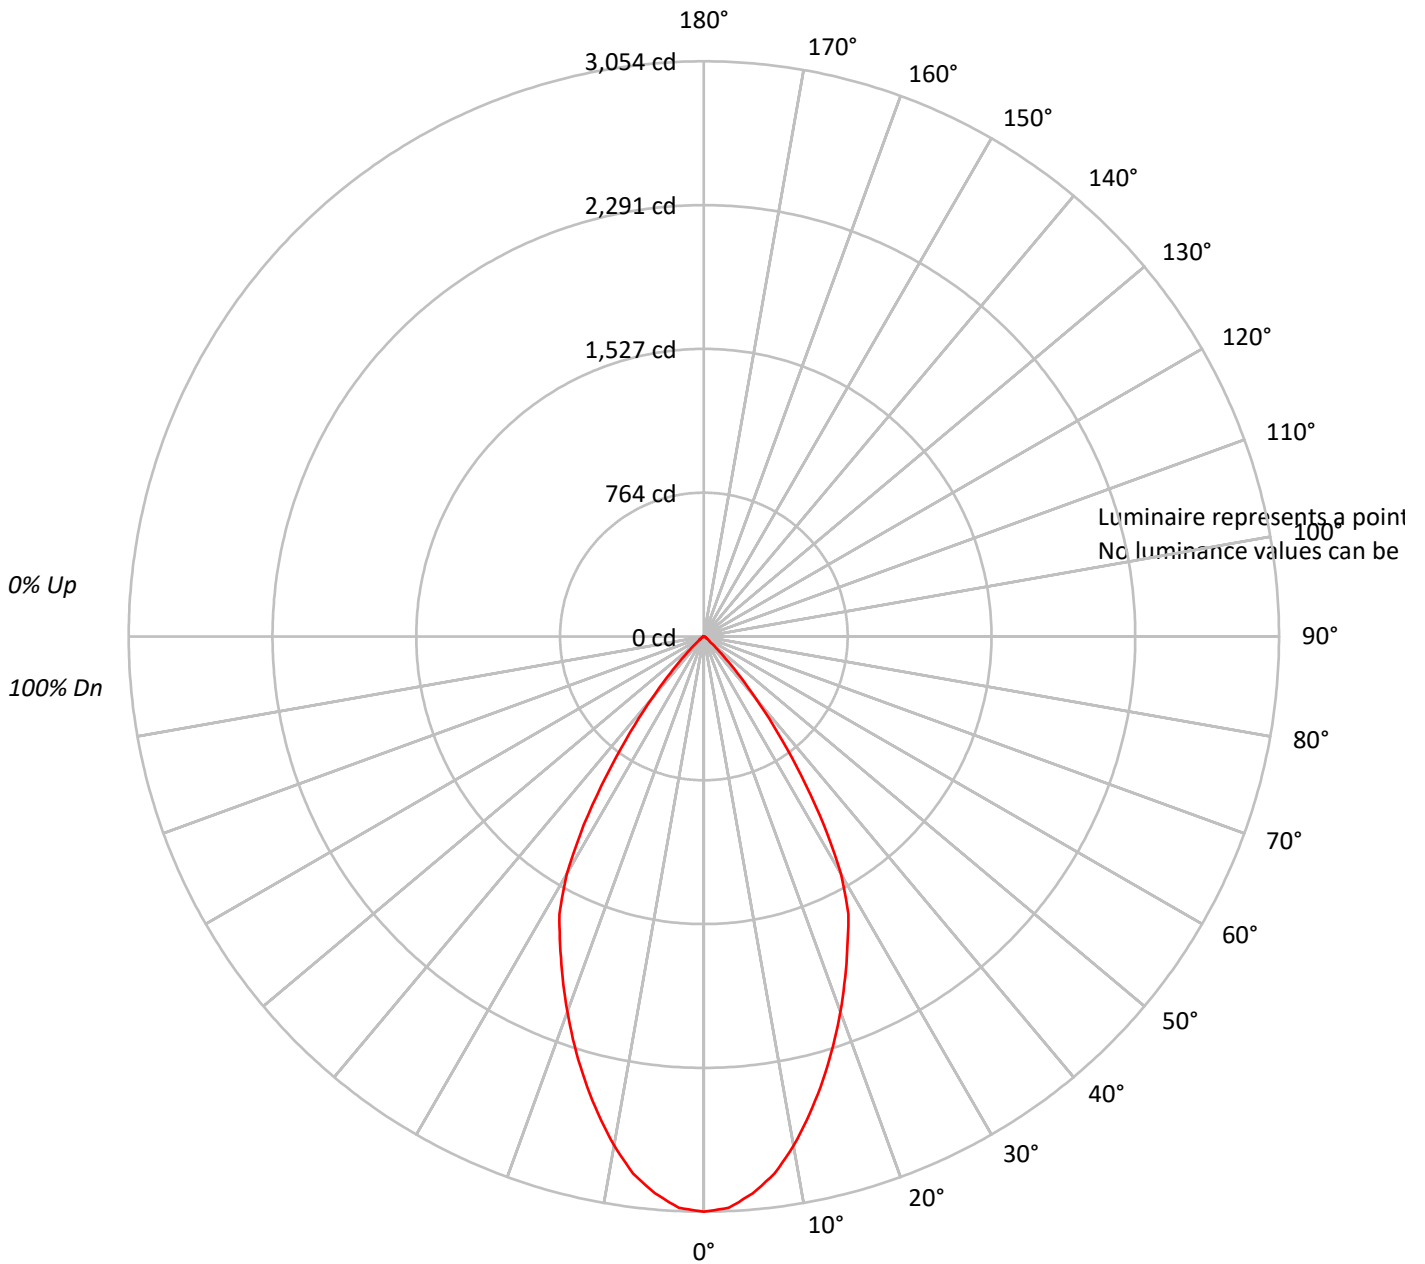



TEST NUMBER: P203879

CATALOG NUMBER: LE\_6B40D010 EC6B30508027 6LBNGPH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	92	91	89	87			
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	88	85	83	81			
4	97	90	84	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76			
5	93	84	78	74	91	83	78	74	82	77	73	80	76	73	78	75	72	70			
6	88	79	73	69	86	78	73	69	77	72	68	75	71	68	74	70	67	66			
7	84	74	68	64	82	74	68	64	72	67	64	71	67	63	70	66	63	62			
8	79	70	64	60	78	69	64	60	68	63	60	67	63	59	66	62	59	58			
9	76	66	60	56	75	66	60	56	65	60	56	64	59	56	63	59	56	54			
10	72	63	57	53	71	62	57	53	61	56	53	61	56	53	60	55	52	51			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203879

CATALOG NUMBER: LE\_6B40D010 EC6B30508027 6LBNGPH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	276.5	11.0
10°-20°	681.9	27.1
20°-30°	826.1	32.9
30°-40°	563.0	22.4
40°-50°	134.1	5.3
50°-60°	21.0	0.8
60°-70°	7.8	0.3
70°-80°	2.3	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1784.4	71.0
0°-40°	2347.4	93.4
0°-60°	2502.5	99.6
0°-90°	2512.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2512.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3054	
5°	2968	276
15°	2441	682
25°	1805	826
35°	900	563
45°	143	134
55°	23	21
65°	6	8
75°	0	2
85°	0	0
90°	0	



TEST NUMBER: P203879

CATALOG NUMBER: LE\_6B40D010 EC6B30508027 6LBNGPH1

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	3054.0
2.5°	3036.8
5°	2968.0
7.5°	2876.4
10°	2744.5
12.5°	2595.6
15°	2440.9
17.5°	2280.5
20°	2120.0
22.5°	1959.6
25°	1804.9
27.5°	1661.6
30°	1455.4
32.5°	1186.0
35°	899.6
37.5°	641.8
40°	424.0
42.5°	263.6
45°	143.2
47.5°	74.5
50°	40.1
52.5°	28.6
55°	22.9
57.5°	17.2
60°	11.5
62.5°	11.5
65°	5.8
67.5°	5.8
70°	5.8
72.5°	5.8
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)