

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P205419

Luminaire Tested: **LE_6B40D010 EC6B30508027 6LBSLI1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P205419
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30508027 6LBSLI1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH SPECULAR CLEAR TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5385.5 lumens
Efficiency: N/A
Efficacy: 128.8 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 1.04
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P205419

CATALOG NUMBER: LE_6B40D010 EC6B30508027 6LBSLI1

Luminous Intensity Polar Plot

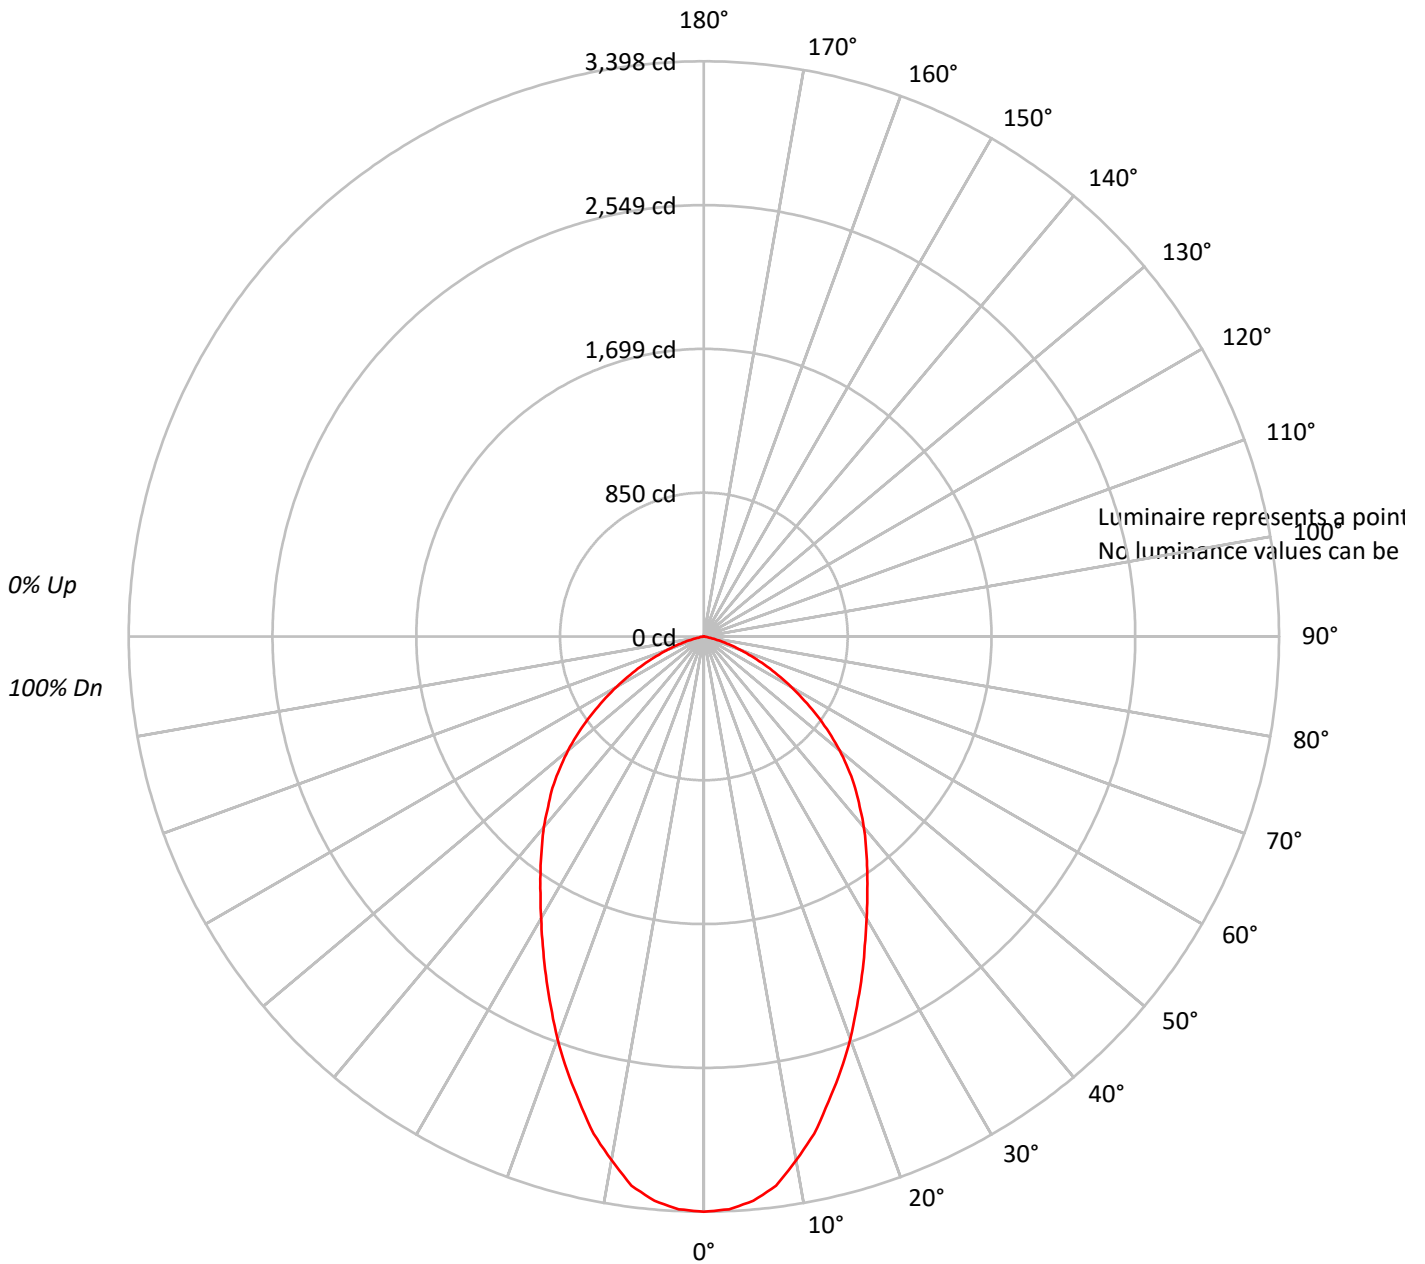



TEST NUMBER: P205419

CATALOG NUMBER: LE_6B40D010 EC6B30508027 6LBSLI1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	109	105	102	99	101	99	96	97	95	93	94	92	91	89			
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77			
3	95	86	79	74	93	85	78	73	82	76	72	79	75	71	77	73	70	68			
4	88	78	70	64	86	77	69	64	74	68	63	72	67	62	70	65	62	60			
5	82	71	63	57	80	70	62	57	67	61	56	66	60	55	64	59	55	53			
6	76	64	56	51	74	63	56	51	62	55	50	60	54	50	59	53	49	47			
7	71	59	51	46	70	58	51	45	57	50	45	55	49	45	54	49	45	43			
8	67	54	47	41	65	54	46	41	52	46	41	51	45	41	50	45	41	39			
9	63	50	43	38	61	50	43	38	49	42	38	48	42	37	47	41	37	36			
10	59	47	40	35	58	46	39	35	45	39	35	45	39	34	44	38	34	33			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P205419

CATALOG NUMBER: LE_6B40D010 EC6B30508027 6LBSLI1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	313.2	5.8
10°-20°	797.3	14.8
20°-30°	1016.7	18.9
30°-40°	1054.3	19.6
40°-50°	971.5	18.0
50°-60°	730.8	13.6
60°-70°	394.4	7.3
70°-80°	105.8	2.0
80°-90°	1.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2127.1	39.5
0°-40°	3181.4	59.1
0°-60°	4883.7	90.7
0°-90°	5385.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5385.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3398	
5°	3347	313
15°	2844	797
25°	2208	1017
35°	1682	1054
45°	1264	972
55°	818	731
65°	395	394
75°	92	106
85°	0	2
90°	0	



TEST NUMBER: P205419

CATALOG NUMBER: LE_6B40D010 EC6B30508027 6LBSLI1

CANDELA DISTRIBUTION (FULL):

	0°
0°	3398.5
2.5°	3387.1
5°	3347.0
7.5°	3272.6
10°	3141.0
12.5°	3009.5
15°	2843.5
17.5°	2689.1
20°	2528.9
22.5°	2363.0
25°	2208.5
27.5°	2059.8
30°	1922.4
32.5°	1796.5
35°	1682.1
37.5°	1573.4
40°	1470.4
42.5°	1361.8
45°	1264.4
47.5°	1155.8
50°	1047.0
52.5°	932.6
55°	818.1
57.5°	703.8
60°	595.0
62.5°	492.0
65°	394.8
67.5°	303.2
70°	223.1
72.5°	154.5
75°	91.5
77.5°	40.0
80°	11.5
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)