

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204814

Luminaire Tested: **LE_6B40D010 EC6B30509027 6LBCSMW1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204814
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509027 6LBCSMW1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH CAST MATTE WHITE TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4711.1 lumens
Efficiency: N/A
Efficacy: 112.7 lumens/watt
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204814

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBCSMW1

Luminous Intensity Polar Plot

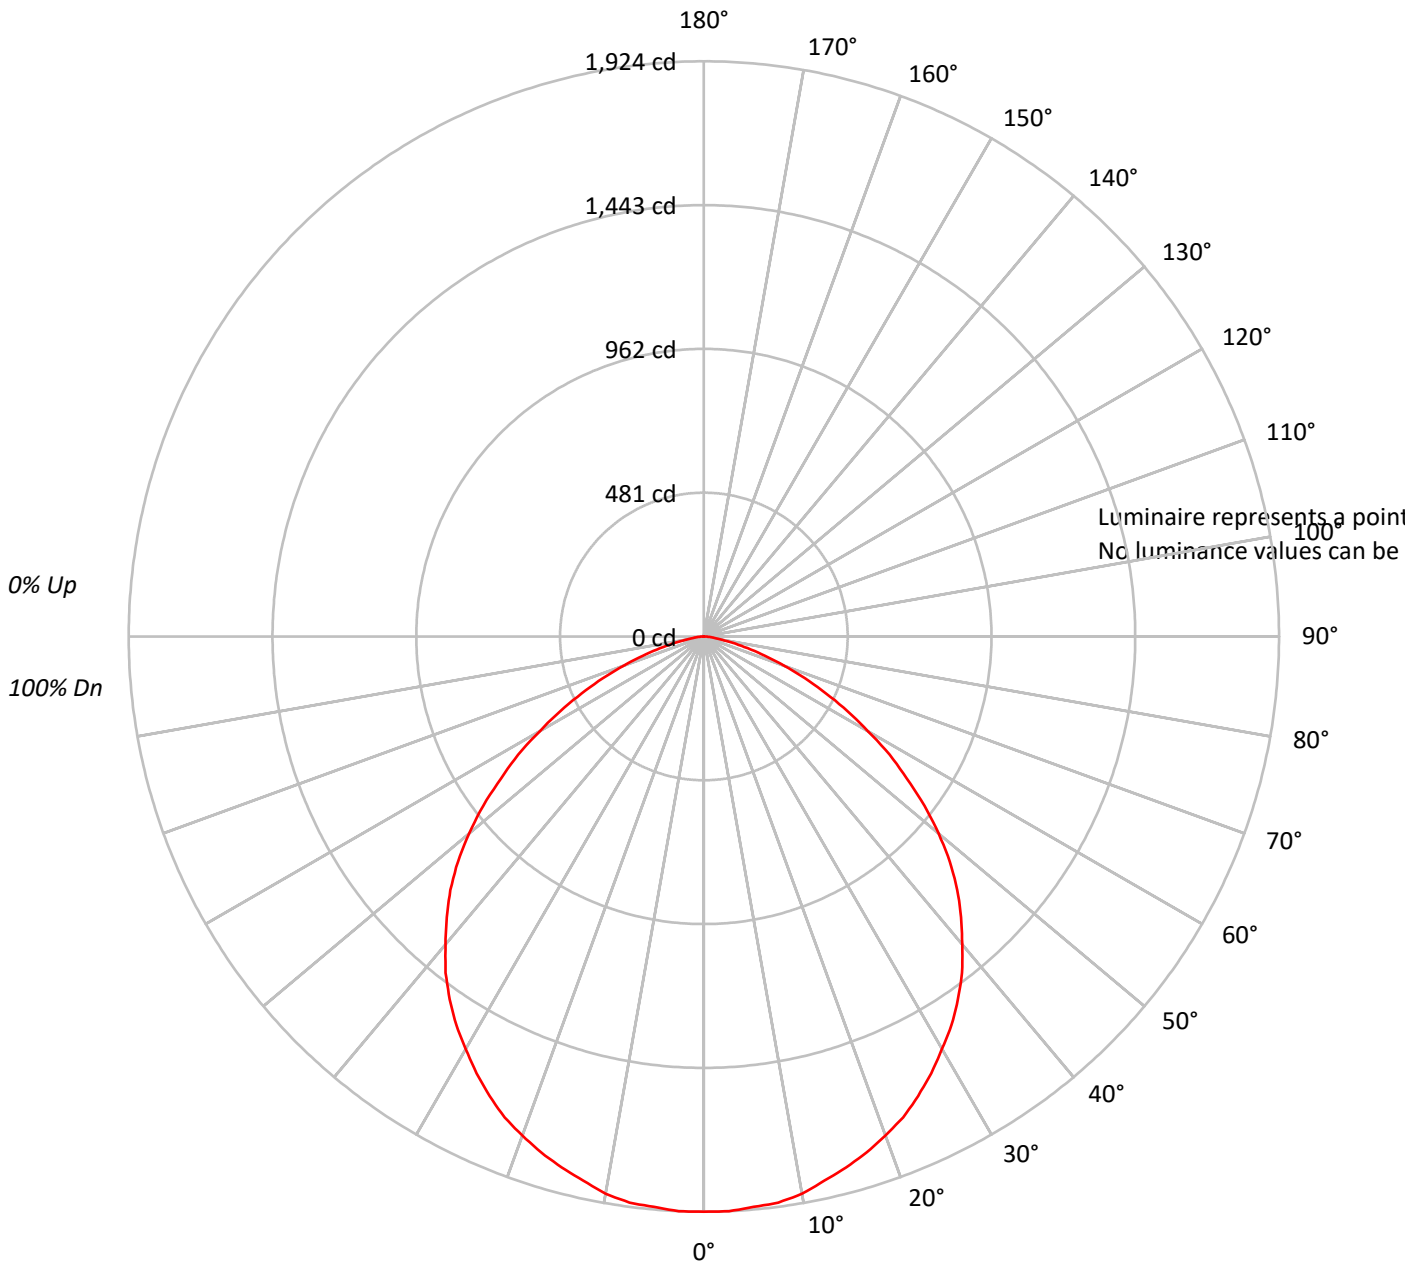



TEST NUMBER: P204814

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBCSMW1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	110	106	102	99	108	104	100	97	100	97	94	96	93	91	92	90	89	87				87
2	101	94	87	82	99	92	86	81	88	84	79	85	81	78	82	79	76	74				74
3	93	83	75	70	90	81	74	69	79	73	68	76	71	67	73	69	65	63				63
4	85	74	66	60	83	73	65	59	70	64	58	68	62	58	66	61	57	55				55
5	79	66	58	52	77	65	57	51	63	56	51	61	55	50	60	54	50	48				48
6	73	60	52	45	71	59	51	45	57	50	45	56	49	44	54	49	44	42				42
7	68	55	46	40	66	54	46	40	52	45	40	51	44	40	50	44	39	37				37
8	63	50	42	36	61	49	41	36	48	41	36	47	40	36	46	40	35	33				33
9	59	46	38	33	57	45	38	32	44	37	32	43	37	32	42	36	32	30				30
10	55	42	35	30	54	42	34	30	41	34	29	40	34	29	39	33	29	27				27

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204814

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBCSMW1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.3	3.9
10°-20°	519.0	11.0
20°-30°	780.8	16.6
30°-40°	925.3	19.6
40°-50°	920.8	19.5
50°-60°	742.3	15.8
60°-70°	449.1	9.5
70°-80°	166.7	3.5
80°-90°	24.8	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1482.1	31.5
0°-40°	2407.4	51.1
0°-60°	4070.5	86.4
0°-90°	4711.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4711.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1924	
5°	1916	182
15°	1838	519
25°	1696	781
35°	1482	925
45°	1199	921
55°	828	742
65°	451	449
75°	151	167
85°	20	25
90°	0	



TEST NUMBER: P204814

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBCSMW1

CANDELA DISTRIBUTION (FULL):

	0°
0°	1924.2
2.5°	1924.2
5°	1915.6
7.5°	1909.9
10°	1892.8
12.5°	1864.2
15°	1838.5
17.5°	1810.0
20°	1775.8
22.5°	1741.5
25°	1695.8
27.5°	1647.2
30°	1593.0
32.5°	1541.6
35°	1481.8
37.5°	1418.9
40°	1344.6
42.5°	1273.2
45°	1199.0
47.5°	1116.2
50°	1024.9
52.5°	930.8
55°	827.9
57.5°	736.6
60°	633.8
62.5°	542.4
65°	451.1
67.5°	365.4
70°	285.5
72.5°	214.1
75°	151.2
77.5°	97.1
80°	57.1
82.5°	34.2
85°	20.0
87.5°	8.6
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)