

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203885

Luminaire Tested: **LE_6B40D010 EC6B30509027 6LBNGPH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203885
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509027 6LBNGPH1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
NARROW DISTRIBUTION WITH GRAPHITE HAZE TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2157.4 lumens
Efficiency: N/A
Efficacy: 51.6 lumens/watt
Spacing Criteria (0/90/45): 0.84 / 0.84 / 0.88
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203885

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBNGPH1

Luminous Intensity Polar Plot

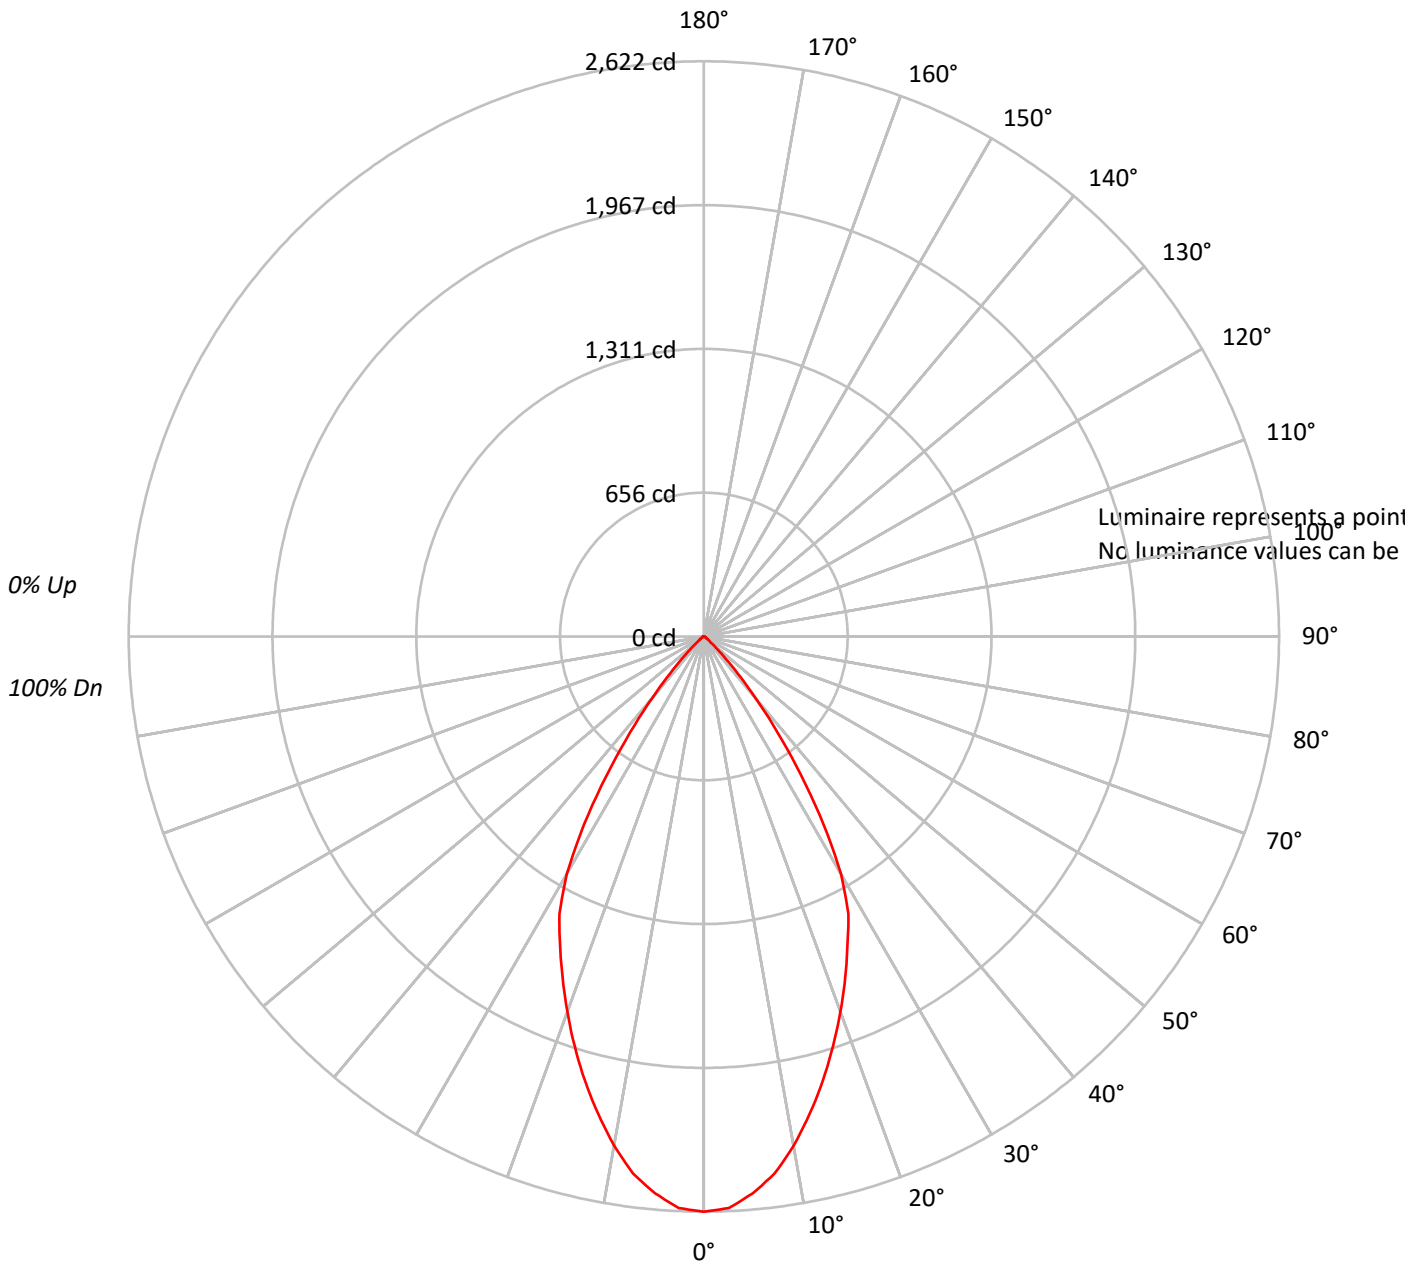



TEST NUMBER: P203885

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBNGPH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	92	91	89	87			
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	88	85	83	81			
4	97	90	84	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76			
5	93	84	78	74	91	83	78	74	82	77	73	80	76	73	78	75	72	70			
6	88	79	73	69	86	78	73	69	77	72	68	75	71	68	74	70	67	66			
7	84	74	68	64	82	74	68	64	72	67	64	71	67	63	70	66	63	62			
8	79	70	64	60	78	69	64	60	68	63	60	67	63	59	66	62	59	58			
9	76	66	60	56	75	66	60	56	65	60	56	64	59	56	63	59	56	54			
10	72	63	57	53	71	62	57	53	61	56	53	61	56	53	60	55	52	51			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203885

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBNGPH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	237.4	11.0
10°-20°	585.5	27.1
20°-30°	709.4	32.9
30°-40°	483.4	22.4
40°-50°	115.1	5.3
50°-60°	18.0	0.8
60°-70°	6.7	0.3
70°-80°	1.9	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1532.2	71.0
0°-40°	2015.6	93.4
0°-60°	2148.8	99.6
0°-90°	2157.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2157.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2622	
5°	2548	237
15°	2096	585
25°	1550	709
35°	772	483
45°	123	115
55°	20	18
65°	5	7
75°	0	2
85°	0	0
90°	0	



TEST NUMBER: P203885

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBNGPH1

CANDELA DISTRIBUTION (FULL):

0°	
0°	2622.4
2.5°	2607.6
5°	2548.5
7.5°	2469.8
10°	2356.6
12.5°	2228.8
15°	2095.9
17.5°	1958.1
20°	1820.4
22.5°	1682.6
25°	1549.8
27.5°	1426.8
30°	1249.6
32.5°	1018.4
35°	772.4
37.5°	551.0
40°	364.1
42.5°	226.4
45°	123.0
47.5°	64.0
50°	34.5
52.5°	24.6
55°	19.6
57.5°	14.8
60°	9.9
62.5°	9.9
65°	4.9
67.5°	4.9
70°	4.9
72.5°	4.9
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)