

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204194

Luminaire Tested: **LE_6B40D010 EC6B30509027 6LBSH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204194
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509027 6LBSH1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4467.1 lumens
Efficiency: N/A
Efficacy: 106.9 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.06 / 1.17
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204194

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBSH1

Luminous Intensity Polar Plot

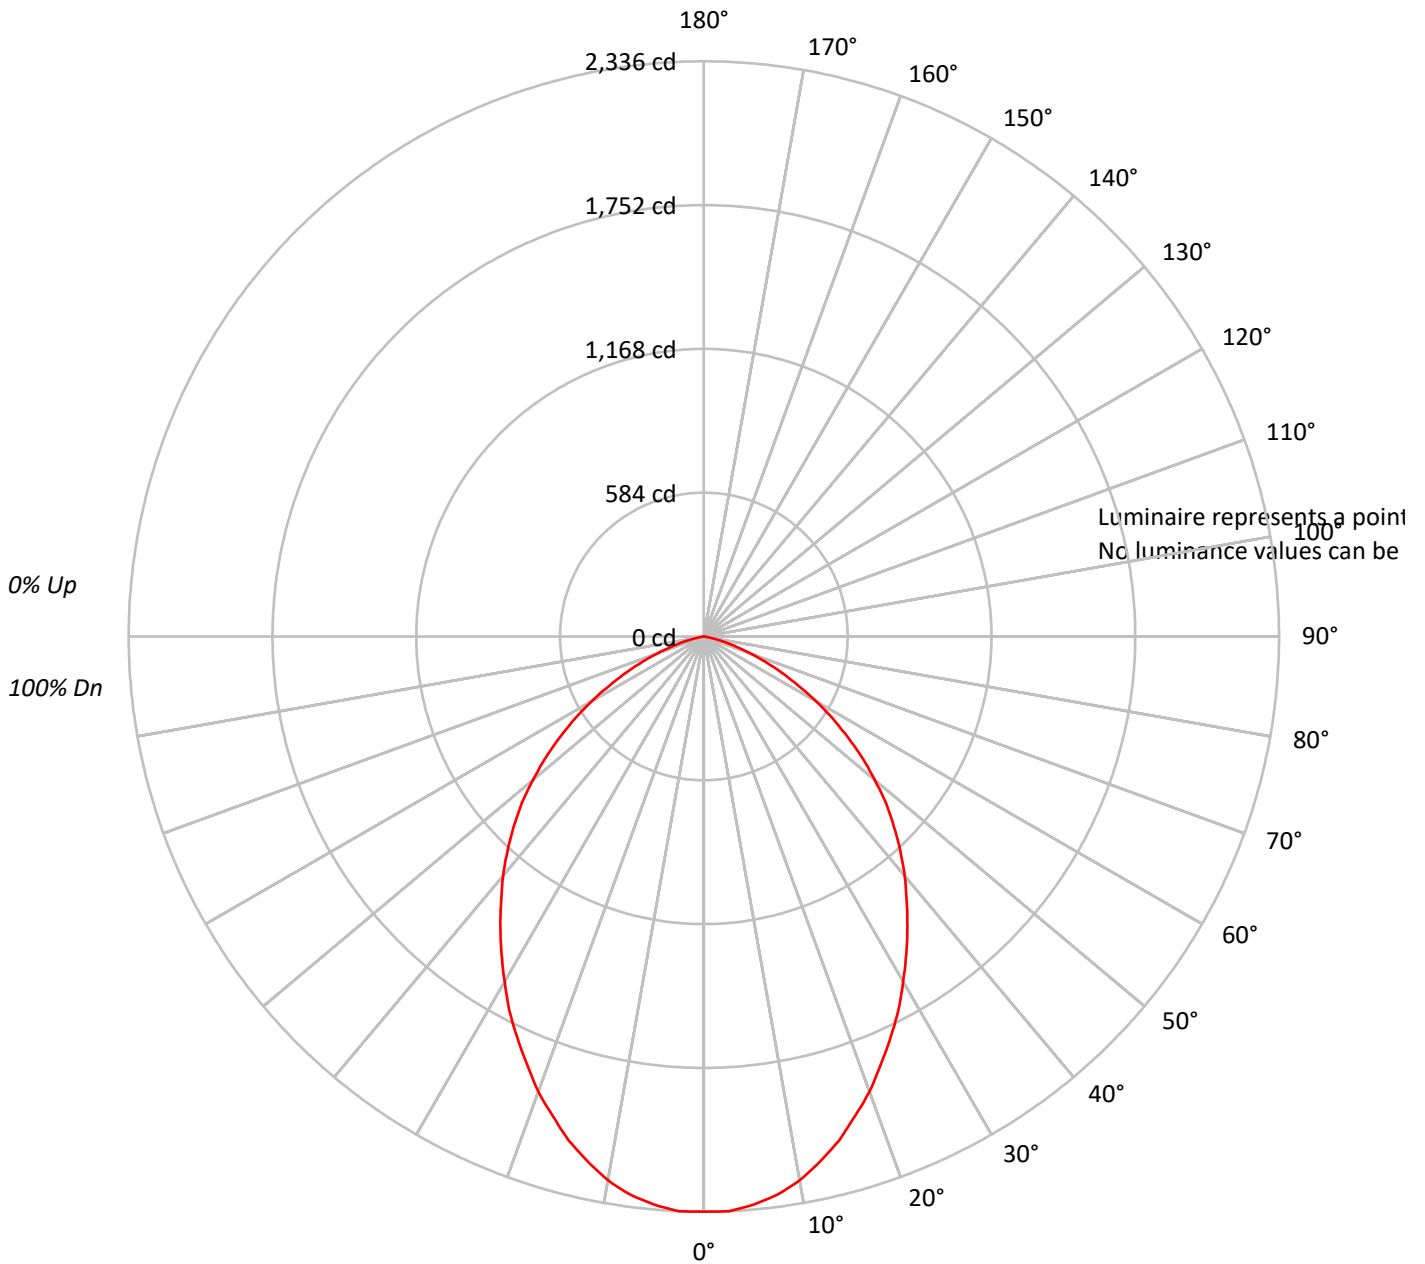



TEST NUMBER: P204194

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBSH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	93	92	90	88			
2	102	96	90	85	100	94	88	84	90	86	82	87	83	80	84	81	79	77			
3	95	85	78	73	92	84	77	72	81	75	71	78	74	70	76	72	69	67			
4	87	77	69	63	85	75	68	63	73	67	62	71	65	61	69	64	60	58			
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51			
6	75	63	55	49	73	62	54	49	60	54	49	59	53	48	57	52	48	46			
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41			
8	65	53	45	40	64	52	45	40	51	44	39	50	44	39	49	43	39	37			
9	61	49	41	36	60	48	41	36	47	40	36	46	40	36	45	40	35	34			
10	58	45	38	33	56	45	38	33	44	37	33	43	37	33	42	37	33	31			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204194

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LSBH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	218.8	4.9
10°-20°	594.8	13.3
20°-30°	826.0	18.5
30°-40°	901.4	20.2
40°-50°	840.9	18.8
50°-60°	638.2	14.3
60°-70°	349.5	7.8
70°-80°	96.2	2.2
80°-90°	1.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1639.6	36.7
0°-40°	2541.0	56.9
0°-60°	4020.1	90.0
0°-90°	4467.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4467.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2336	
5°	2317	219
15°	2120	595
25°	1795	826
35°	1441	901
45°	1092	841
55°	713	638
65°	349	349
75°	84	96
85°	0	1
90°	0	



TEST NUMBER: P204194

CATALOG NUMBER: LE_6B40D010 EC6B30509027 6LBSH1

CANDELA DISTRIBUTION (FULL):

	0°
0°	2336.2
2.5°	2336.2
5°	2316.6
7.5°	2287.1
10°	2242.9
12.5°	2183.8
15°	2119.9
17.5°	2041.1
20°	1967.4
22.5°	1878.9
25°	1795.2
27.5°	1711.6
30°	1618.1
32.5°	1529.6
35°	1441.1
37.5°	1352.6
40°	1269.0
42.5°	1180.5
45°	1091.9
47.5°	1003.4
50°	905.0
52.5°	811.5
55°	713.1
57.5°	619.8
60°	526.2
62.5°	432.9
65°	349.2
67.5°	270.5
70°	201.6
72.5°	137.8
75°	83.6
77.5°	39.4
80°	9.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)