

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204912

Luminaire Tested: **LE_6B40D010 EC6B30508030 6LBCSMB1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204912
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30508030 6LBCSMB1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH CAST MATTE BLACK TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4846.3 lumens
Efficiency: N/A
Efficacy: 115.9 lumens/watt
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204912

CATALOG NUMBER: LE_6B40D010 EC6B30508030 6LBCSMB1

Luminous Intensity Polar Plot

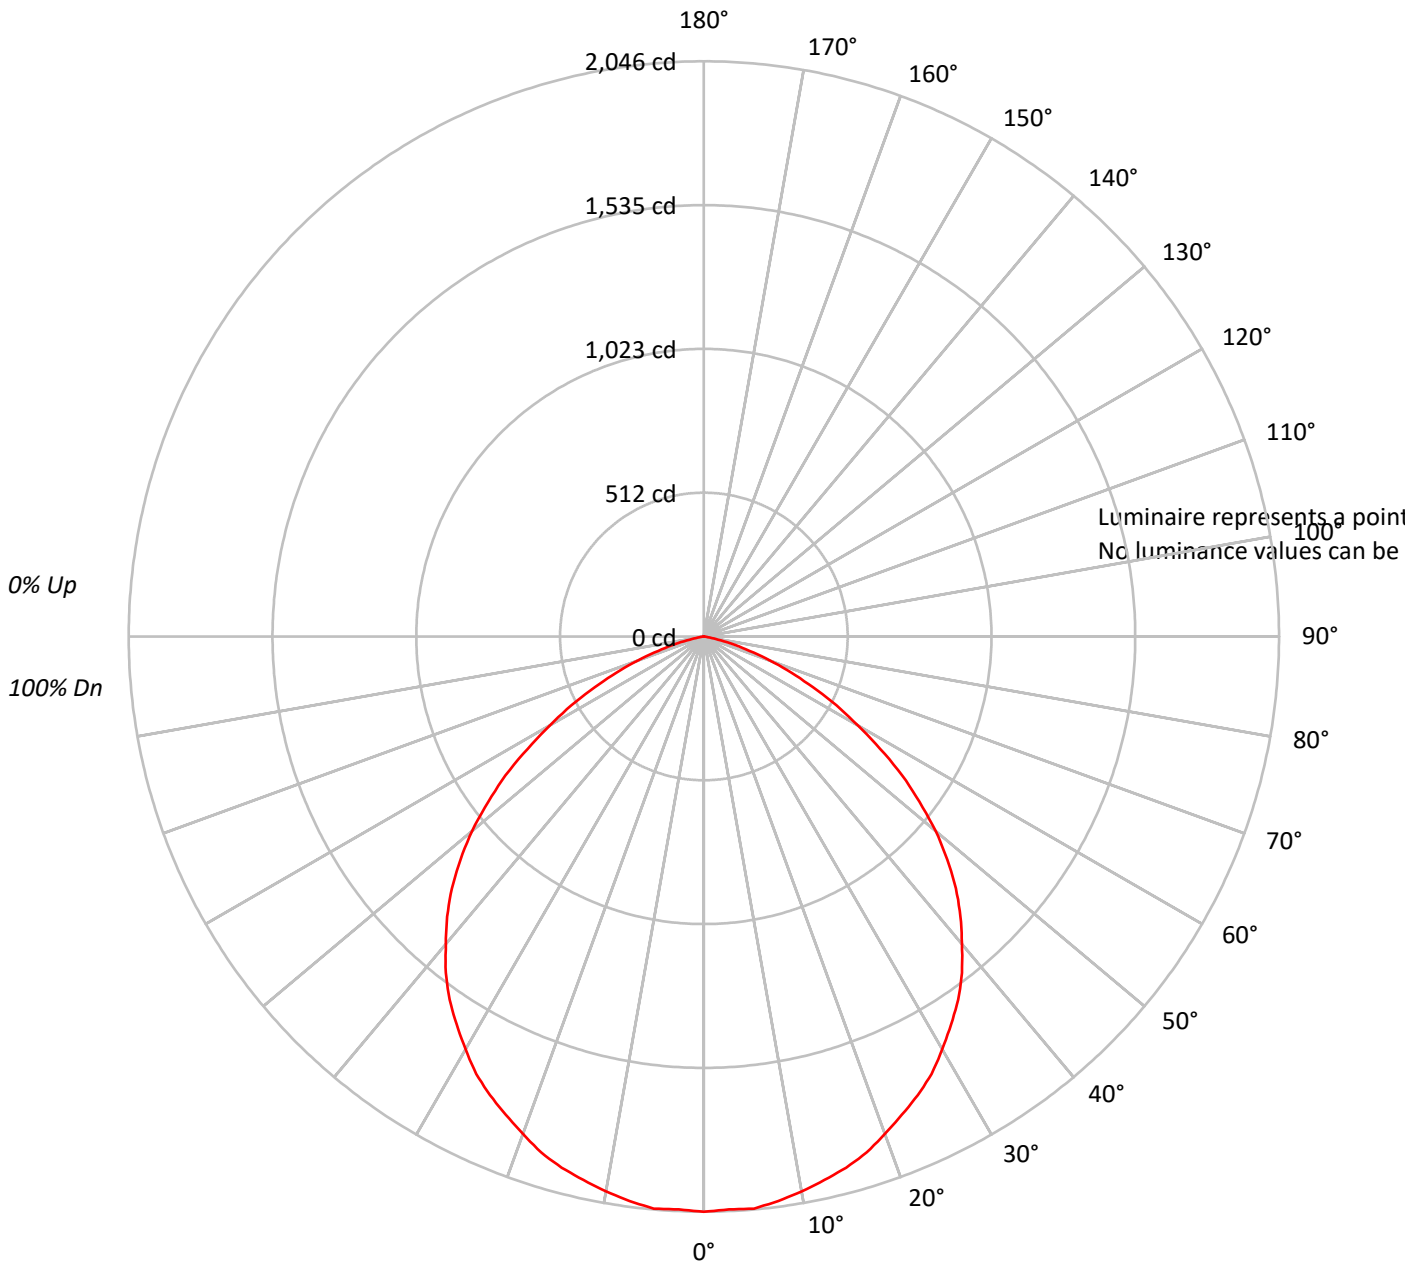



TEST NUMBER: P204912

CATALOG NUMBER: LE_6B40D010 EC6B30508030 6LBCSMB1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	90	88			88
2	102	95	89	84	99	93	87	83	89	85	81	86	82	79	83	80	77	75			75
3	93	84	77	71	91	83	76	70	80	74	69	77	72	68	74	70	67	65			65
4	86	75	67	61	84	74	66	61	71	65	60	69	63	59	67	62	58	56			56
5	79	67	59	53	77	66	59	53	64	57	52	62	56	52	61	55	51	49			49
6	74	61	53	47	72	60	52	46	58	51	46	57	50	46	55	50	45	43			43
7	68	55	47	41	67	55	47	41	53	46	41	52	45	41	50	45	40	39			39
8	64	51	43	37	62	50	42	37	49	42	37	48	41	37	46	41	36	35			35
9	60	47	39	33	58	46	39	33	45	38	33	44	38	33	43	37	33	31			31
10	56	43	35	30	55	43	35	30	42	35	30	41	34	30	40	34	30	28			28

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204912

CATALOG NUMBER: LE_6B40D010 EC6B30508030 6LBCSMB1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	193.6	4.0
10°-20°	551.4	11.4
20°-30°	829.0	17.1
30°-40°	983.6	20.3
40°-50°	973.3	20.1
50°-60°	764.5	15.8
60°-70°	428.7	8.8
70°-80°	120.3	2.5
80°-90°	1.9	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1573.9	32.5
0°-40°	2557.5	52.8
0°-60°	4295.4	88.6
0°-90°	4846.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4846.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2046	
5°	2043	194
15°	1956	551
25°	1800	829
35°	1577	984
45°	1268	973
55°	862	765
65°	427	429
75°	104	120
85°	0	2
90°	0	



TEST NUMBER: P204912

CATALOG NUMBER: LE_6B40D010 EC6B30508030 6LBCSMB1

CANDELA DISTRIBUTION (FULL):

0°	
0°	2046.4
2.5°	2039.5
5°	2042.9
7.5°	2025.5
10°	2004.8
12.5°	1980.4
15°	1956.0
17.5°	1924.8
20°	1883.1
22.5°	1841.4
25°	1799.8
27.5°	1754.5
30°	1695.5
32.5°	1636.4
35°	1577.4
37.5°	1507.9
40°	1428.0
42.5°	1351.5
45°	1268.1
47.5°	1174.4
50°	1077.0
52.5°	965.9
55°	861.6
57.5°	743.5
60°	632.4
62.5°	531.6
65°	427.4
67.5°	337.0
70°	250.1
72.5°	170.2
75°	104.2
77.5°	52.1
80°	13.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)