

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203571

Luminaire Tested: **LE\_6B40D010 EC6B30508030 6LBMMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203571  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508030 6LBMMW1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
MEDIUM DISTRIBUTION WITH MATTE WHITE TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4188.0 lumens  
Efficiency: N/A  
Efficacy: 100.2 lumens/watt  
Spacing Criteria (0/90/45): 1 / 1 / 0.97  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203571

CATALOG NUMBER: LE\_6B40D010 EC6B30508030 6LBMMW1

### Luminous Intensity Polar Plot

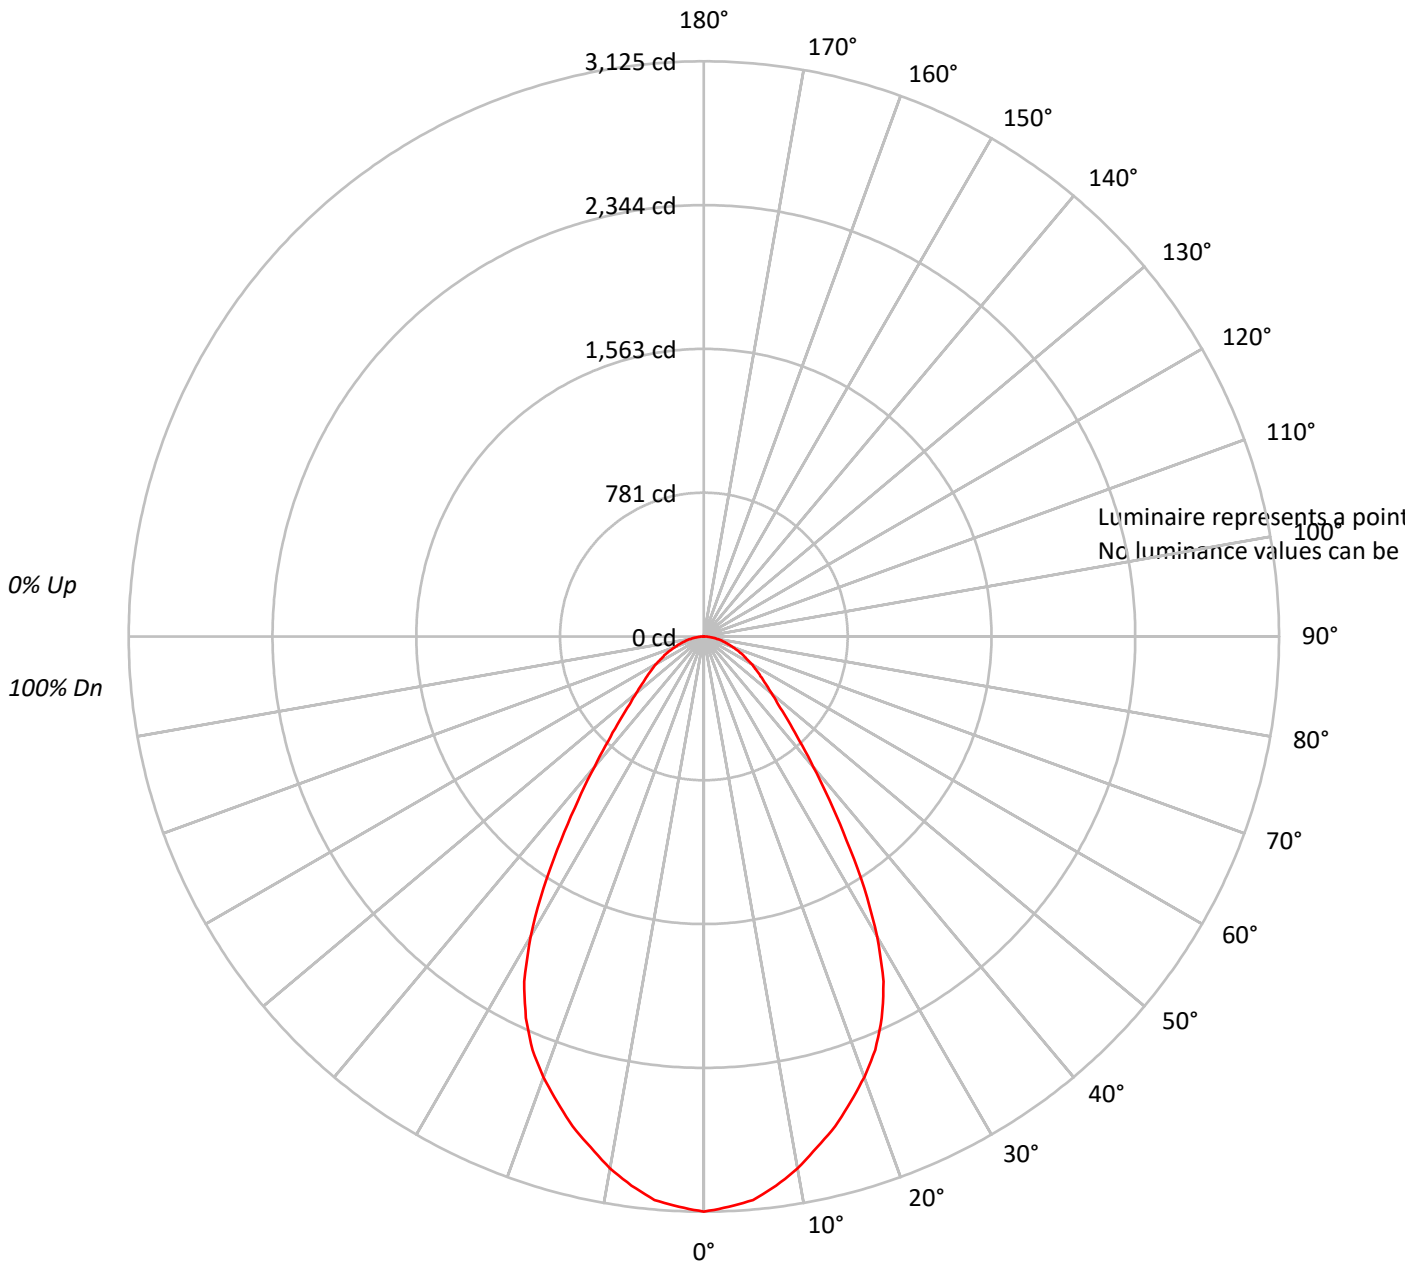



TEST NUMBER: P203571

CATALOG NUMBER: LE\_6B40D010 EC6B30508030 6LBMMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	108	104	101	109	105	103	100	101	99	97	98	96	94	94	92	91	89			
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79			
3	97	88	82	77	95	87	81	76	84	79	75	82	77	74	79	76	73	71			
4	90	81	74	68	88	80	73	68	77	72	67	75	70	66	73	69	65	64			
5	85	74	67	61	83	73	66	61	71	65	61	69	64	60	68	63	59	58			
6	79	68	61	56	78	68	61	56	66	60	55	64	59	55	63	58	54	53			
7	75	63	56	51	73	63	56	51	61	55	50	60	54	50	59	54	50	48			
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44			
9	66	55	48	43	65	54	48	43	53	47	43	52	47	43	51	46	43	41			
10	63	51	45	40	62	51	44	40	50	44	40	49	44	40	48	43	40	38			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203571

CATALOG NUMBER: LE\_6B40D010 EC6B30508030 6LBMMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	288.7	6.9
10°-20°	773.2	18.5
20°-30°	1038.2	24.8
30°-40°	851.6	20.3
40°-50°	511.4	12.2
50°-60°	339.9	8.1
60°-70°	227.8	5.4
70°-80°	122.6	2.9
80°-90°	34.6	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2100.1	50.1
0°-40°	2951.7	70.5
0°-60°	3803.0	90.8
0°-90°	4188.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4188.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3125	
5°	3073	289
15°	2755	773
25°	2287	1038
35°	1352	852
45°	647	511
55°	376	340
65°	231	228
75°	116	123
85°	29	35
90°	0	



TEST NUMBER: P203571

CATALOG NUMBER: LE\_6B40D010 EC6B30508030 6LBMMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3125.0
2.5°	3101.9
5°	3073.0
7.5°	3009.4
10°	2934.4
12.5°	2841.9
15°	2755.2
17.5°	2651.2
20°	2547.4
22.5°	2431.8
25°	2287.4
27.5°	2114.1
30°	1883.0
32.5°	1623.1
35°	1351.6
37.5°	1120.6
40°	924.2
42.5°	768.2
45°	647.0
47.5°	548.8
50°	479.4
52.5°	421.6
55°	375.5
57.5°	335.0
60°	300.4
62.5°	259.9
65°	231.0
67.5°	196.4
70°	167.5
72.5°	138.6
75°	115.5
77.5°	92.4
80°	69.4
82.5°	52.0
85°	28.9
87.5°	11.5
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)