

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203365

Luminaire Tested: **LE\_6B40D010 EC6B30508030 6LBMWH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203365  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508030 6LBMWH1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
MEDIUM DISTRIBUTION WITH WHEAT TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4122.3 lumens  
Efficiency: N/A  
Efficacy: 98.6 lumens/watt  
Spacing Criteria (0/90/45): 0.83 / 0.83 / 0.85  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203365

CATALOG NUMBER: LE\_6B40D010 EC6B30508030 6LBMWH1

### Luminous Intensity Polar Plot

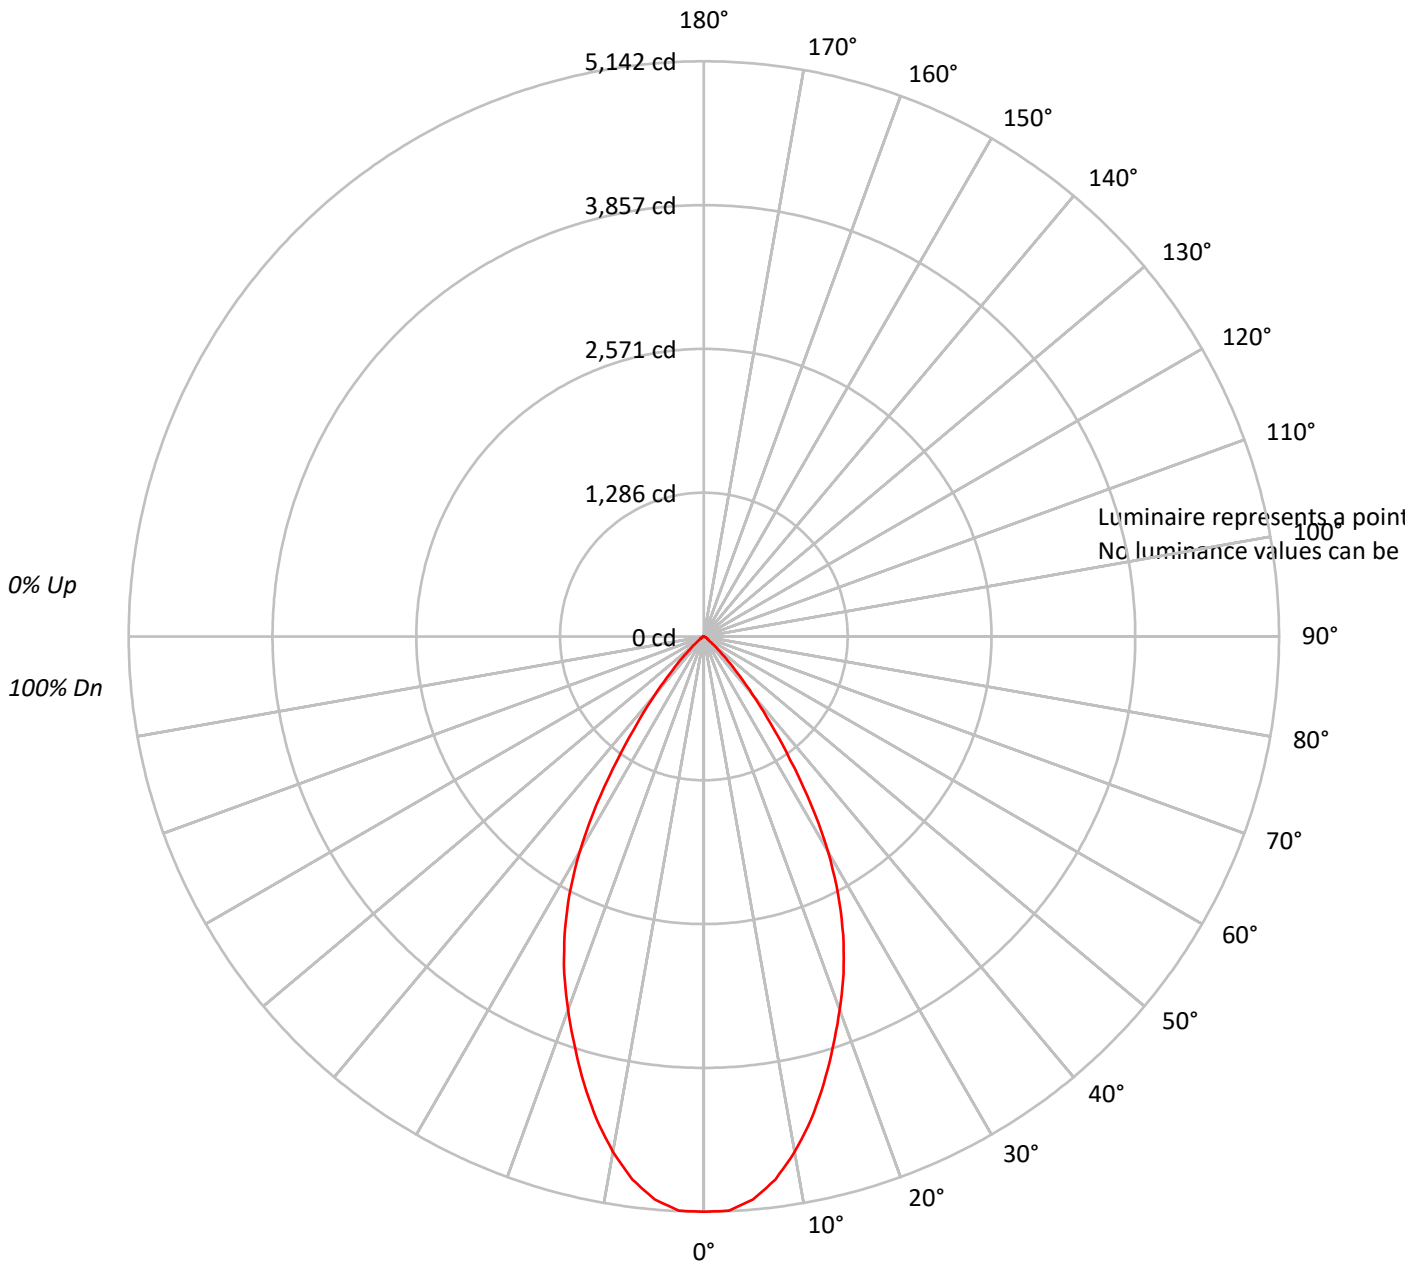



TEST NUMBER: P203365

CATALOG NUMBER: LE\_6B40D010 EC6B30508030 6LBMWH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	92	91	89	87			
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	88	85	83	81			
4	97	90	85	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76			
5	93	84	79	74	91	83	78	74	82	77	73	80	76	73	78	75	72	71			
6	88	79	73	69	87	78	73	69	77	72	68	76	71	68	74	70	67	66			
7	84	75	69	64	82	74	68	64	73	68	64	71	67	64	70	66	63	62			
8	80	70	64	60	78	70	64	60	69	64	60	68	63	60	67	62	59	58			
9	76	66	61	57	75	66	60	57	65	60	56	64	59	56	63	59	56	55			
10	72	63	57	53	71	62	57	53	62	57	53	61	56	53	60	56	53	52			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203365

CATALOG NUMBER: LE\_6B40D010 EC6B30508030 6LBMWH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	470.1	11.4
10°-20°	1154.2	28.0
20°-30°	1335.4	32.4
30°-40°	853.6	20.7
40°-50°	242.0	5.9
50°-60°	43.2	1.0
60°-70°	17.7	0.4
70°-80°	6.1	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2959.7	71.8
0°-40°	3813.3	92.5
0°-60°	4098.5	99.4
0°-90°	4122.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4122.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	5142	
5°	5051	470
15°	4139	1154
25°	2947	1335
35°	1347	854
45°	281	242
55°	40	43
65°	17	18
75°	6	6
85°	0	0
90°	0	



TEST NUMBER: P203365

CATALOG NUMBER: LE\_6B40D010 EC6B30508030 6LBMWH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	5142.5
2.5°	5136.9
5°	5050.9
7.5°	4896.0
10°	4678.1
12.5°	4425.9
15°	4139.2
17.5°	3841.1
20°	3548.8
22.5°	3262.1
25°	2946.8
27.5°	2602.8
30°	2218.8
32.5°	1788.8
35°	1347.2
37.5°	974.6
40°	676.5
42.5°	447.1
45°	280.9
47.5°	166.2
50°	97.5
52.5°	57.4
55°	40.1
57.5°	34.4
60°	28.6
62.5°	22.9
65°	17.2
67.5°	11.5
70°	11.5
72.5°	5.8
75°	5.8
77.5°	5.8
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)