

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203268

Luminaire Tested: **LE_6B40D010 EC6B30509030 6LBMH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203268
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509030 6LBMH1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
MEDIUM DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3259.9 lumens
Efficiency: N/A
Efficacy: 78.0 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203268

CATALOG NUMBER: LE_6B40D010 EC6B30509030 6LBMH1

Luminous Intensity Polar Plot

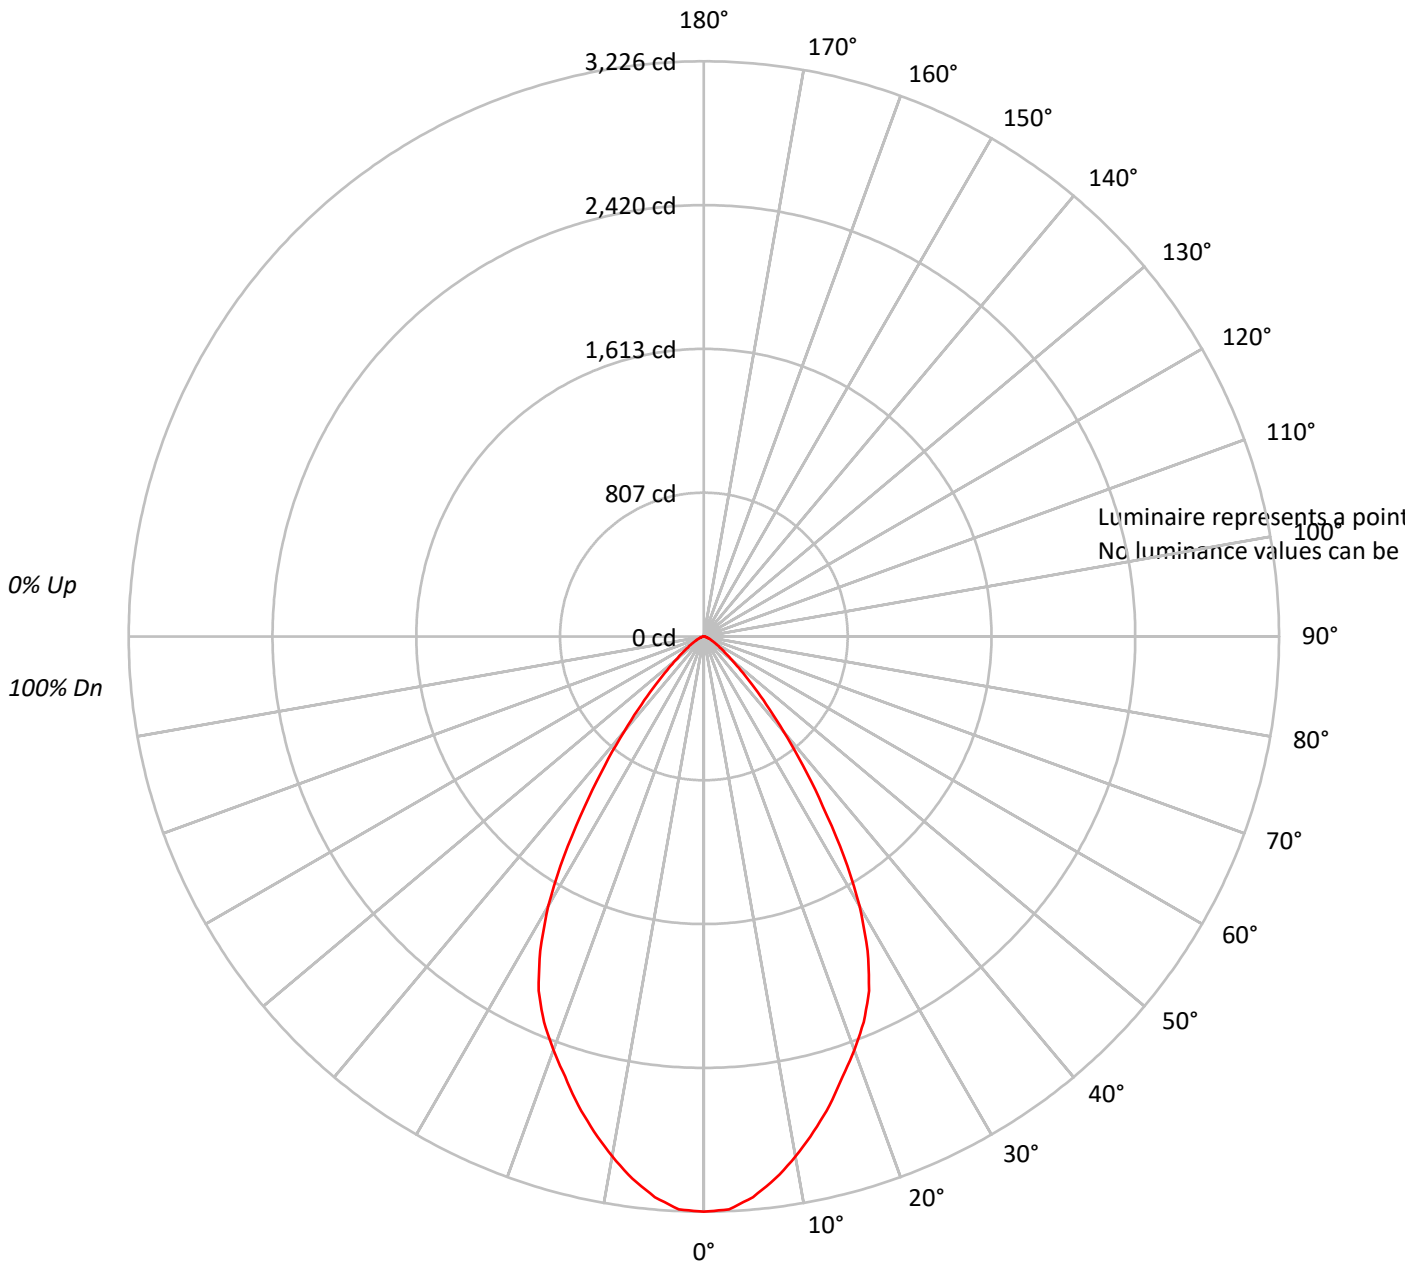



TEST NUMBER: P203268

CATALOG NUMBER: LE_6B40D010 EC6B30509030 6LBMH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | |
| 1 | 113 | 110 | 107 | 105 | 111 | 108 | 105 | 103 | 104 | 102 | 100 | 100 | 99 | 97 | 97 | 95 | 94 | 92 | | |
| 2 | 107 | 102 | 97 | 93 | 105 | 100 | 96 | 92 | 97 | 93 | 90 | 94 | 91 | 88 | 91 | 89 | 87 | 85 | | |
| 3 | 101 | 94 | 88 | 84 | 99 | 92 | 88 | 84 | 90 | 86 | 82 | 87 | 84 | 81 | 85 | 82 | 80 | 78 | | |
| 4 | 95 | 87 | 81 | 76 | 93 | 86 | 80 | 76 | 84 | 79 | 75 | 82 | 78 | 74 | 80 | 76 | 73 | 72 | | |
| 5 | 90 | 81 | 75 | 70 | 88 | 80 | 74 | 70 | 78 | 73 | 69 | 76 | 72 | 68 | 75 | 71 | 68 | 66 | | |
| 6 | 85 | 75 | 69 | 64 | 83 | 75 | 69 | 64 | 73 | 68 | 64 | 72 | 67 | 63 | 70 | 66 | 63 | 61 | | |
| 7 | 80 | 70 | 64 | 59 | 79 | 70 | 64 | 59 | 68 | 63 | 59 | 67 | 62 | 59 | 66 | 62 | 58 | 57 | | |
| 8 | 76 | 66 | 60 | 55 | 75 | 65 | 59 | 55 | 64 | 59 | 55 | 63 | 58 | 55 | 62 | 58 | 54 | 53 | | |
| 9 | 72 | 62 | 56 | 51 | 71 | 61 | 55 | 51 | 60 | 55 | 51 | 60 | 55 | 51 | 59 | 54 | 51 | 49 | | |
| 10 | 69 | 58 | 52 | 48 | 68 | 58 | 52 | 48 | 57 | 52 | 48 | 56 | 51 | 48 | 55 | 51 | 48 | 46 | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203268

CATALOG NUMBER: LE_6B40D010 EC6B30509030 6LBMH1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 295.0 | 9.0 |
| 10°-20° | 763.1 | 23.4 |
| 20°-30° | 988.8 | 30.3 |
| 30°-40° | 734.1 | 22.5 |
| 40°-50° | 309.9 | 9.5 |
| 50°-60° | 110.1 | 3.4 |
| 60°-70° | 42.5 | 1.3 |
| 70°-80° | 14.7 | 0.4 |
| 80°-90° | 1.9 | 0.1 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 2046.8 | 62.8 |
| 0°-40° | 2780.9 | 85.3 |
| 0°-60° | 3200.9 | 98.2 |
| 0°-90° | 3259.9 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 3259.9 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 3226 | |
| 5° | 3156 | 295 |
| 15° | 2723 | 763 |
| 25° | 2193 | 989 |
| 35° | 1164 | 734 |
| 45° | 382 | 310 |
| 55° | 116 | 110 |
| 65° | 42 | 42 |
| 75° | 14 | 15 |
| 85° | 0 | 2 |
| 90° | 0 | |



TEST NUMBER: P203268

CATALOG NUMBER: LE_6B40D010 EC6B30509030 6LBMH1

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 3226.0 |
| 2.5° | 3216.8 |
| 5° | 3156.2 |
| 7.5° | 3067.8 |
| 10° | 2960.8 |
| 12.5° | 2844.4 |
| 15° | 2723.2 |
| 17.5° | 2588.2 |
| 20° | 2467.2 |
| 22.5° | 2341.5 |
| 25° | 2192.6 |
| 27.5° | 1987.8 |
| 30° | 1745.8 |
| 32.5° | 1461.8 |
| 35° | 1163.8 |
| 37.5° | 912.4 |
| 40° | 693.6 |
| 42.5° | 516.8 |
| 45° | 381.8 |
| 47.5° | 279.2 |
| 50° | 204.9 |
| 52.5° | 153.6 |
| 55° | 116.4 |
| 57.5° | 88.5 |
| 60° | 69.9 |
| 62.5° | 51.2 |
| 65° | 41.9 |
| 67.5° | 32.6 |
| 70° | 23.2 |
| 72.5° | 18.6 |
| 75° | 14.0 |
| 77.5° | 9.2 |
| 80° | 4.6 |
| 82.5° | 4.6 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)