

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203273

Luminaire Tested: **LE_6B40D010 EC6B30509730 6LBMH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203273
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509730 6LBMH1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
MEDIUM DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2849.4 lumens
Efficiency: N/A
Efficacy: 68.2 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203273

CATALOG NUMBER: LE_6B40D010 EC6B30509730 6LBMH1

Luminous Intensity Polar Plot

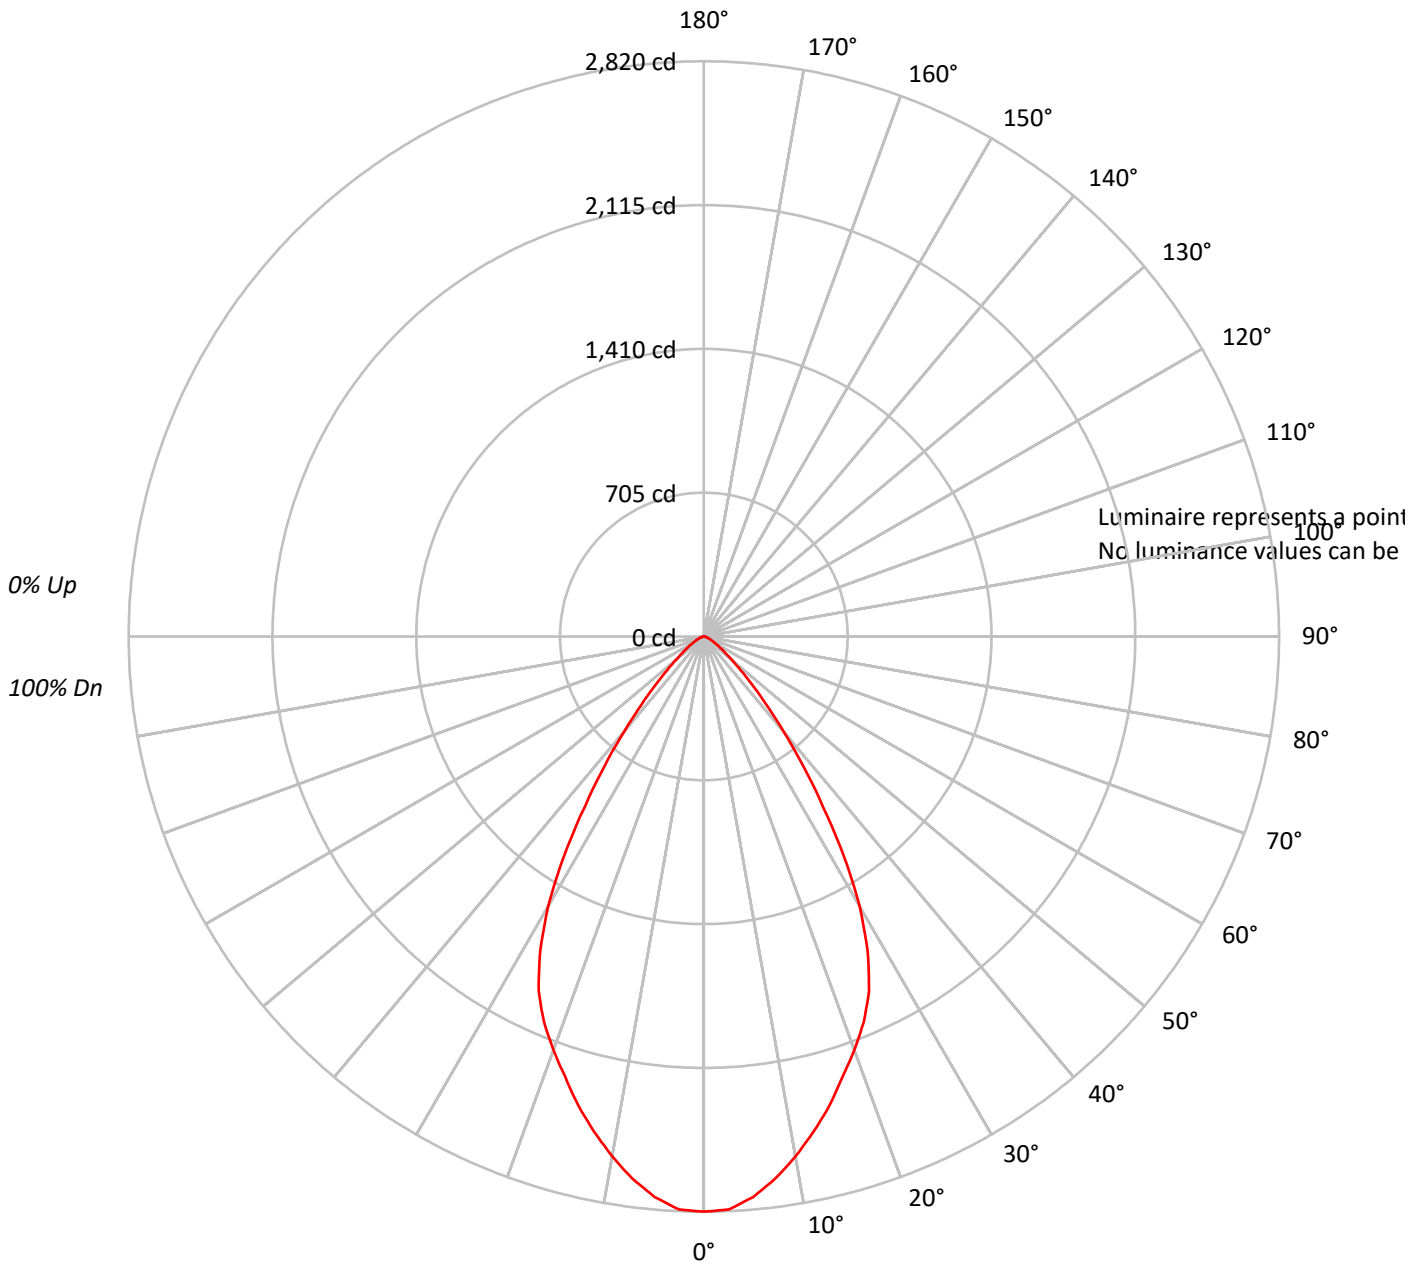



TEST NUMBER: P203273

CATALOG NUMBER: LE_6B40D010 EC6B30509730 6LBMH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92			92
2	107	102	97	93	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	84	90	86	82	87	84	81	85	82	80	78			78
4	95	87	81	76	93	86	80	76	84	79	75	82	78	74	80	76	73	72			72
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68	66			66
6	85	75	69	64	83	75	69	64	73	68	64	72	67	63	70	66	63	61			61
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			57
8	76	66	60	55	75	65	59	55	64	59	55	63	58	55	62	58	54	53			53
9	72	62	56	51	71	61	55	51	60	55	51	60	55	51	59	54	51	49			49
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	48	46			46

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203273

CATALOG NUMBER: LE_6B40D010 EC6B30509730 6LBMH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	257.8	9.0
10°-20°	667.0	23.4
20°-30°	864.3	30.3
30°-40°	641.6	22.5
40°-50°	270.8	9.5
50°-60°	96.2	3.4
60°-70°	37.1	1.3
70°-80°	12.8	0.5
80°-90°	1.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1789.1	62.8
0°-40°	2430.7	85.3
0°-60°	2797.8	98.2
0°-90°	2849.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2849.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2820	
5°	2759	258
15°	2380	667
25°	1916	864
35°	1017	642
45°	334	271
55°	102	96
65°	37	37
75°	12	13
85°	0	2
90°	0	



TEST NUMBER: P203273

CATALOG NUMBER: LE_6B40D010 EC6B30509730 6LBMH1

CANDELA DISTRIBUTION (FULL):

	0°
0°	2819.9
2.5°	2811.8
5°	2758.9
7.5°	2681.5
10°	2588.0
12.5°	2486.2
15°	2380.4
17.5°	2262.4
20°	2156.6
22.5°	2046.8
25°	1916.5
27.5°	1737.5
30°	1525.9
32.5°	1277.8
35°	1017.2
37.5°	797.5
40°	606.2
42.5°	451.6
45°	333.6
47.5°	244.1
50°	179.0
52.5°	134.2
55°	101.8
57.5°	77.4
60°	61.0
62.5°	44.8
65°	36.6
67.5°	28.5
70°	20.4
72.5°	16.2
75°	12.2
77.5°	8.1
80°	4.1
82.5°	4.1
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)