

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204613

Luminaire Tested: **LE\_6B40D010 EC6B30509730 6LBSMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204613  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30509730 6LBSMW1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH MATTE WHITE TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4233.9 lumens  
Efficiency: N/A  
Efficacy: 101.3 lumens/watt  
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.34  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204613

CATALOG NUMBER: LE\_6B40D010 EC6B30509730 6LBSMW1

### Luminous Intensity Polar Plot

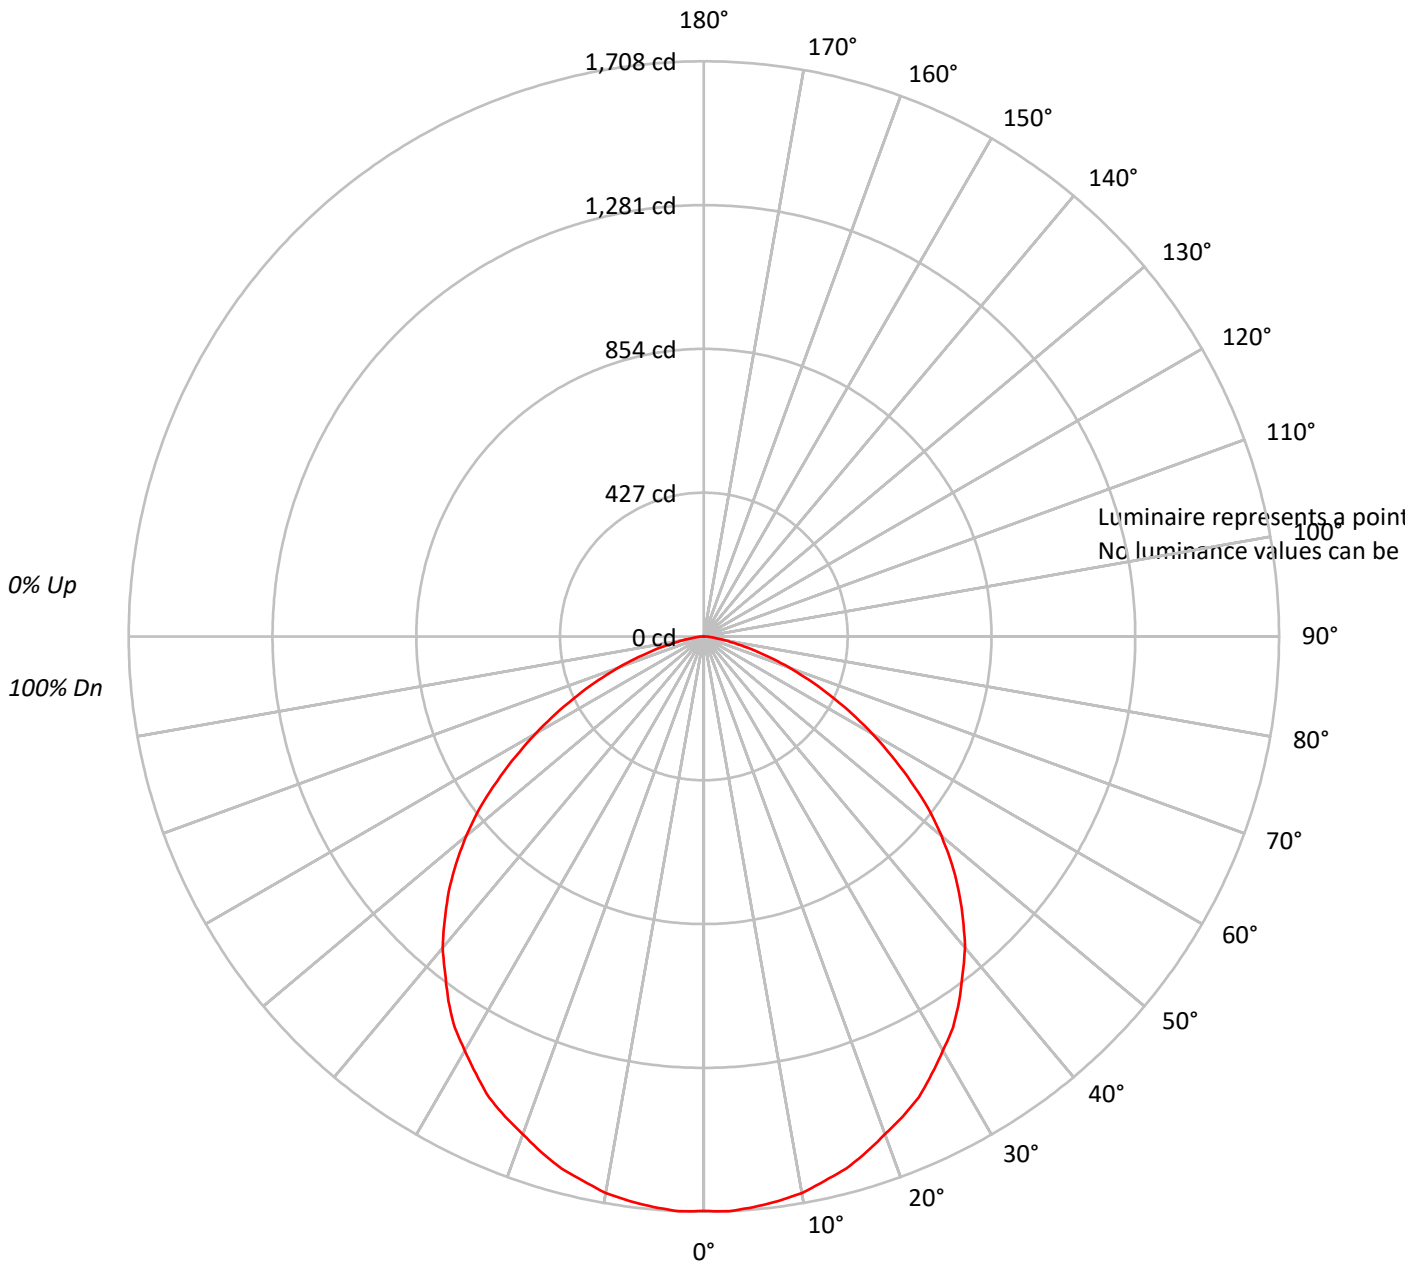



TEST NUMBER: P204613

CATALOG NUMBER: LE\_6B40D010 EC6B30509730 6LBSMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	110	106	102	99	107	104	100	97	99	97	94	96	93	91	92	90	88	86				86
2	101	93	87	82	98	92	86	81	88	83	79	85	81	77	82	79	76	74				74
3	93	83	75	69	90	81	74	69	78	72	67	76	70	66	73	69	65	63				63
4	85	74	65	59	83	72	65	59	70	63	58	68	62	57	66	61	56	54				54
5	78	66	58	51	76	65	57	51	63	56	51	61	55	50	59	54	49	47				47
6	73	60	51	45	71	59	51	45	57	50	44	55	49	44	54	48	44	42				42
7	67	54	46	40	66	54	46	40	52	45	40	51	44	39	49	43	39	37				37
8	63	50	41	36	61	49	41	36	48	41	35	46	40	35	45	39	35	33				33
9	59	46	38	32	57	45	37	32	44	37	32	43	36	32	42	36	32	30				30
10	55	42	34	29	54	42	34	29	41	34	29	40	33	29	39	33	29	27				27

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204613

CATALOG NUMBER: LE\_6B40D010 EC6B30509730 6LBSMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	161.6	3.8
10°-20°	460.7	10.9
20°-30°	693.9	16.4
30°-40°	825.6	19.5
40°-50°	824.1	19.5
50°-60°	670.2	15.8
60°-70°	412.3	9.7
70°-80°	159.8	3.8
80°-90°	25.6	0.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1316.2	31.1
0°-40°	2141.9	50.6
0°-60°	3636.2	85.9
0°-90°	4233.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4233.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1706	
5°	1701	162
15°	1636	461
25°	1510	694
35°	1322	826
45°	1071	824
55°	750	670
65°	414	412
75°	146	160
85°	20	26
90°	0	



TEST NUMBER: P204613

CATALOG NUMBER: LE\_6B40D010 EC6B30509730 6LBSMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1705.9
2.5°	1708.4
5°	1700.9
7.5°	1690.9
10°	1678.2
12.5°	1655.8
15°	1635.6
17.5°	1605.5
20°	1572.9
22.5°	1542.8
25°	1510.2
27.5°	1465.0
30°	1419.9
32.5°	1377.2
35°	1322.0
37.5°	1261.9
40°	1206.6
42.5°	1138.9
45°	1071.1
47.5°	998.4
50°	920.6
52.5°	840.4
55°	750.1
57.5°	662.2
60°	577.0
62.5°	494.2
65°	413.9
67.5°	338.6
70°	268.4
72.5°	203.2
75°	145.5
77.5°	95.4
80°	57.8
82.5°	35.1
85°	20.1
87.5°	10.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)