

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P202552

Luminaire Tested: **LE\_6B40D010 EC6B30509730 6LBSWMH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P202552  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30509730 6LBSWMH1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH WARM HAZE TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4096.7 lumens  
Efficiency: N/A  
Efficacy: 98.0 lumens/watt  
Spacing Criteria (0/90/45): 0.97 / 0.97 / 1.1  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P202552

CATALOG NUMBER: LE\_6B40D010 EC6B30509730 6LBSWMH1

### Luminous Intensity Polar Plot

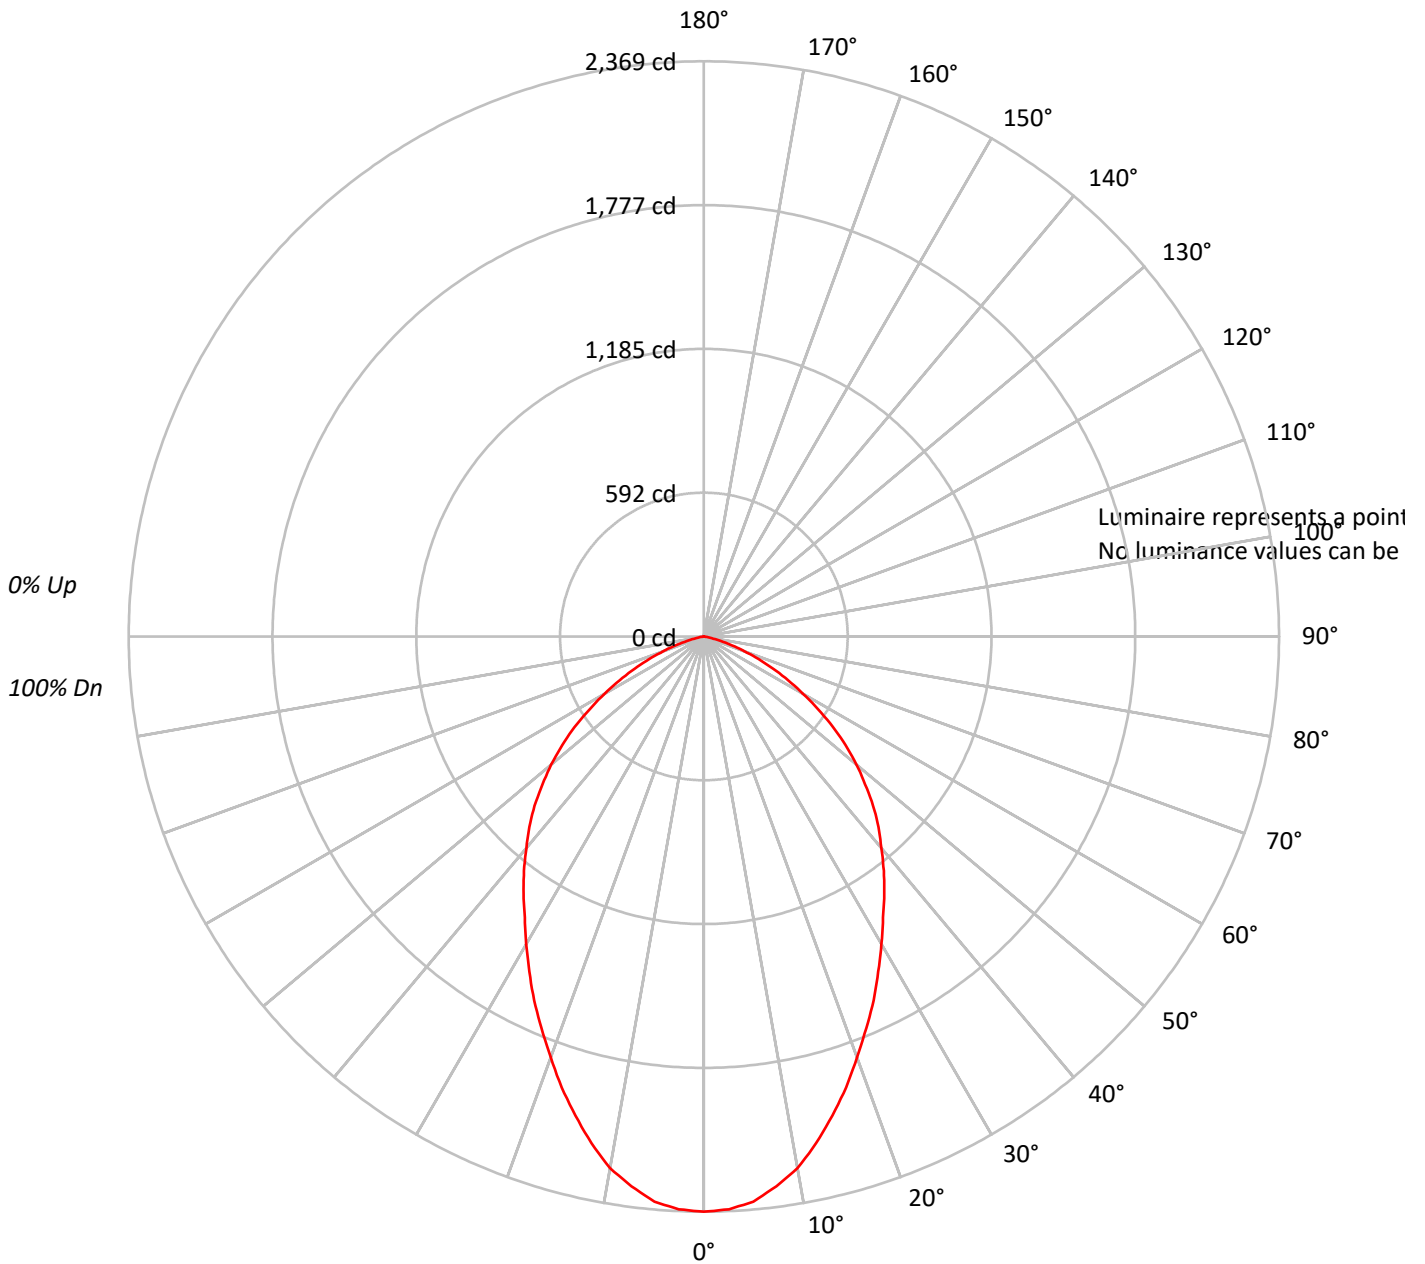



TEST NUMBER: P202552

CATALOG NUMBER: LE\_6B40D010 EC6B30509730 6LBSWMH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	88			
2	103	96	90	85	100	94	89	84	91	86	82	87	84	81	84	81	79	77			
3	95	86	79	73	92	84	78	73	81	76	71	79	74	70	76	72	69	67			
4	88	77	70	64	86	76	69	63	74	67	62	71	66	62	69	65	61	59			
5	81	70	62	56	79	69	61	56	67	60	55	65	59	55	63	58	54	52			
6	76	64	56	50	74	63	55	50	61	54	49	59	53	49	58	53	48	47			
7	70	58	50	45	69	57	50	45	56	49	44	55	48	44	53	48	44	42			
8	66	54	46	40	64	53	45	40	52	45	40	50	44	40	49	44	40	38			
9	62	49	42	37	61	49	42	37	48	41	37	47	41	36	46	40	36	35			
10	58	46	39	34	57	45	38	34	45	38	34	44	38	33	43	37	33	32			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P202552

CATALOG NUMBER: LE\_6B40D010 EC6B30509730 6LBSWMH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	219.2	5.4
10°-20°	573.0	14.0
20°-30°	759.7	18.5
30°-40°	810.4	19.8
40°-50°	757.5	18.5
50°-60°	577.6	14.1
60°-70°	314.2	7.7
70°-80°	84.3	2.1
80°-90°	1.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1551.9	37.9
0°-40°	2362.2	57.7
0°-60°	3697.3	90.2
0°-90°	4096.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4096.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2369	
5°	2336	219
15°	2043	573
25°	1654	760
35°	1295	810
45°	986	757
55°	650	578
65°	314	314
75°	73	84
85°	0	1
90°	0	



TEST NUMBER: P202552

CATALOG NUMBER: LE\_6B40D010 EC6B30509730 6LBSWMH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2369.0
2.5°	2361.5
5°	2336.4
7.5°	2283.8
10°	2223.5
12.5°	2138.1
15°	2042.8
17.5°	1947.4
20°	1844.5
22.5°	1746.6
25°	1653.8
27.5°	1555.9
30°	1463.1
32.5°	1372.8
35°	1294.9
37.5°	1217.1
40°	1136.9
42.5°	1064.0
45°	986.2
47.5°	900.9
50°	820.6
52.5°	735.2
55°	650.0
57.5°	557.1
60°	471.8
62.5°	391.5
65°	313.8
67.5°	243.4
70°	178.1
72.5°	123.0
75°	72.8
77.5°	32.6
80°	7.5
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)