

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204396

Luminaire Tested: **LE\_6B40D010 EC6B30508035 6LBSGPH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204396  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508035 6LBSGPH1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH GRAPHITE HAZE TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5113.2 lumens  
Efficiency: N/A  
Efficacy: 122.3 lumens/watt  
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.26  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204396

CATALOG NUMBER: LE\_6B40D010 EC6B30508035 6LBSGPH1

### Luminous Intensity Polar Plot

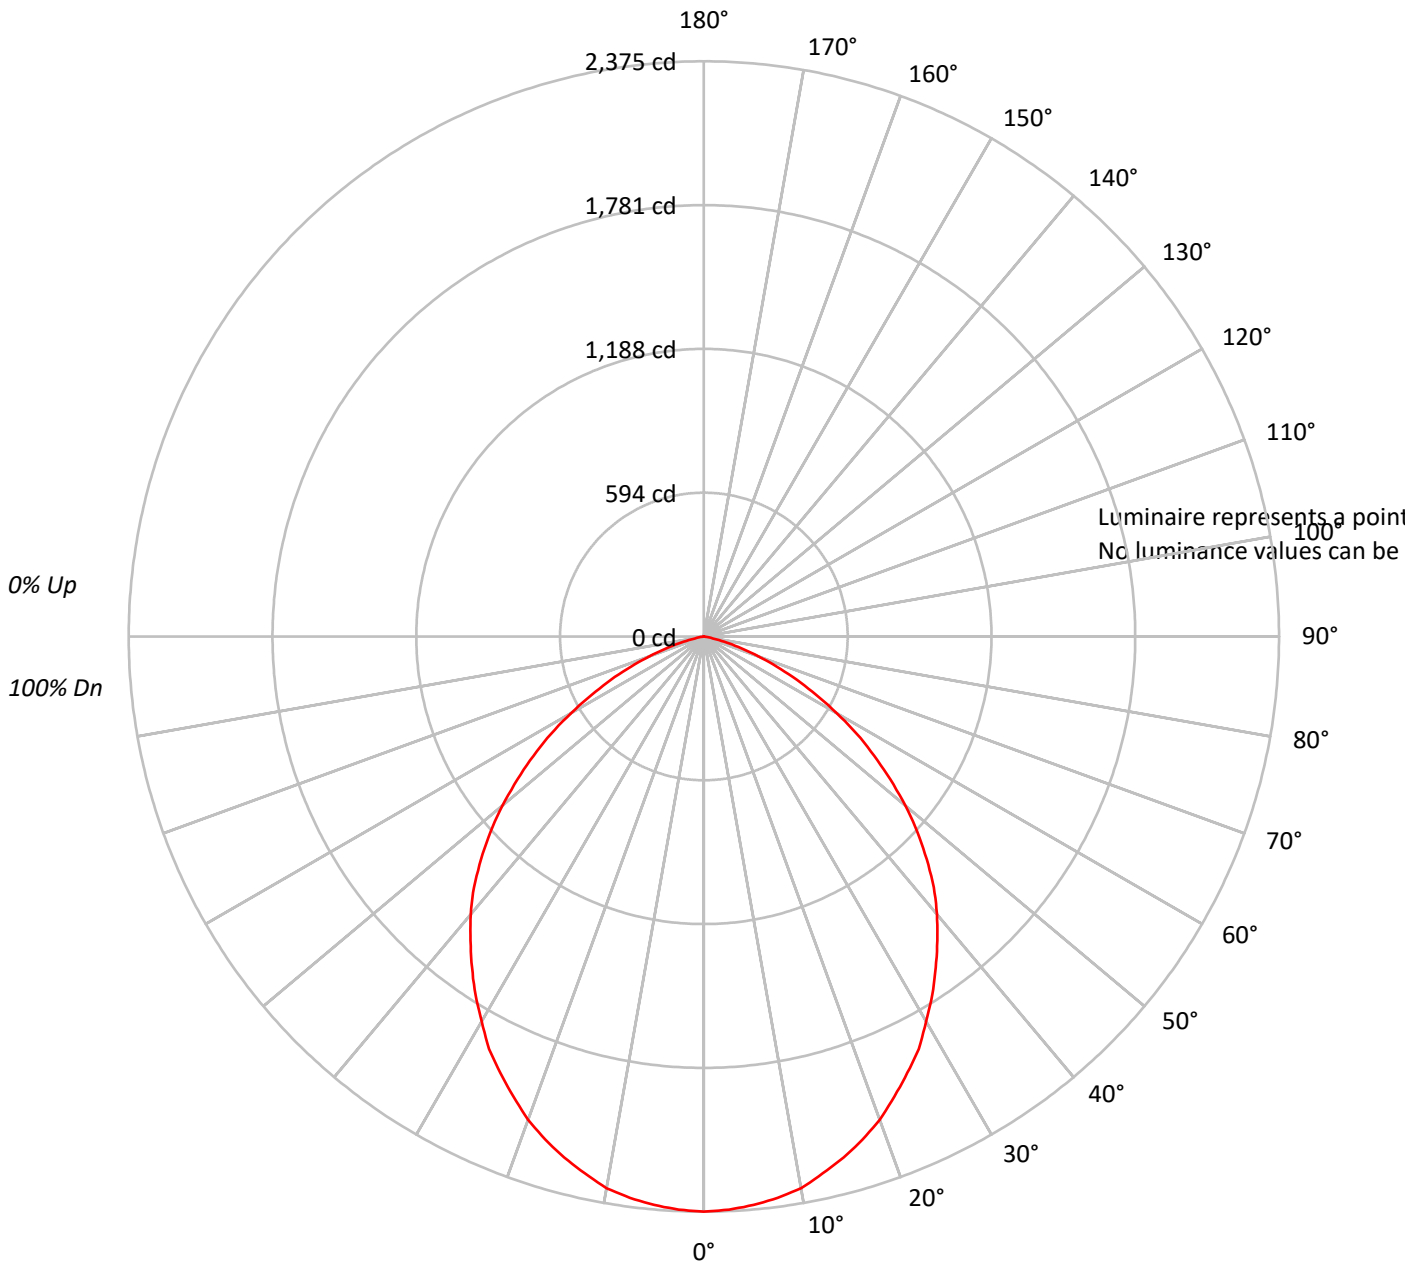



TEST NUMBER: P204396

CATALOG NUMBER: LE\_6B40D010 EC6B30508035 6LBSGPH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	103	100	108	105	102	99	101	98	96	97	95	93	93	91	90	88			
2	102	95	89	84	100	93	88	83	90	85	82	87	83	80	84	81	78	76			
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66			
4	87	76	68	62	85	75	67	62	72	66	61	70	65	60	68	63	59	57			
5	80	68	60	54	78	67	60	54	65	59	53	63	58	53	62	56	52	50			
6	74	62	54	48	73	61	53	48	59	52	47	58	52	47	56	51	47	45			
7	69	57	48	43	68	56	48	43	54	47	42	53	47	42	52	46	42	40			
8	65	52	44	38	63	51	44	38	50	43	38	49	42	38	48	42	38	36			
9	60	48	40	35	59	47	40	35	46	39	35	45	39	34	44	38	34	32			
10	57	44	37	32	56	44	36	32	43	36	31	42	36	31	41	35	31	30			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204396

CATALOG NUMBER: LE\_6B40D010 EC6B30508035 6LBSGPH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	223.6	4.4
10°-20°	627.6	12.3
20°-30°	915.4	17.9
30°-40°	1043.9	20.4
40°-50°	1001.4	19.6
50°-60°	766.9	15.0
60°-70°	420.9	8.2
70°-80°	111.9	2.2
80°-90°	1.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1766.7	34.6
0°-40°	2810.6	55.0
0°-60°	4578.8	89.5
0°-90°	5113.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5113.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2375	
5°	2356	224
15°	2228	628
25°	1988	915
35°	1669	1044
45°	1301	1001
55°	859	767
65°	423	421
75°	98	112
85°	0	2
90°	0	



TEST NUMBER: P204396

CATALOG NUMBER: LE\_6B40D010 EC6B30508035 6LBSGPH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2374.9
2.5°	2368.8
5°	2356.5
7.5°	2338.0
10°	2313.5
12.5°	2270.5
15°	2227.6
17.5°	2178.5
20°	2123.2
22.5°	2055.8
25°	1988.2
27.5°	1920.8
30°	1834.9
32.5°	1755.1
35°	1669.1
37.5°	1583.2
40°	1497.4
42.5°	1405.2
45°	1301.0
47.5°	1196.6
50°	1086.1
52.5°	969.6
55°	859.1
57.5°	748.6
60°	632.1
62.5°	521.6
65°	423.4
67.5°	325.2
70°	239.4
72.5°	159.5
75°	98.1
77.5°	43.0
80°	12.2
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)