

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204293

Luminaire Tested: **LE_6B40D010 EC6B30508035 6LBSWH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204293
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30508035 6LBSWH1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH WHEAT TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5603.8 lumens
Efficiency: N/A
Efficacy: 134.1 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 1.08
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204293

CATALOG NUMBER: LE_6B40D010 EC6B30508035 6LBSWH1

Luminous Intensity Polar Plot

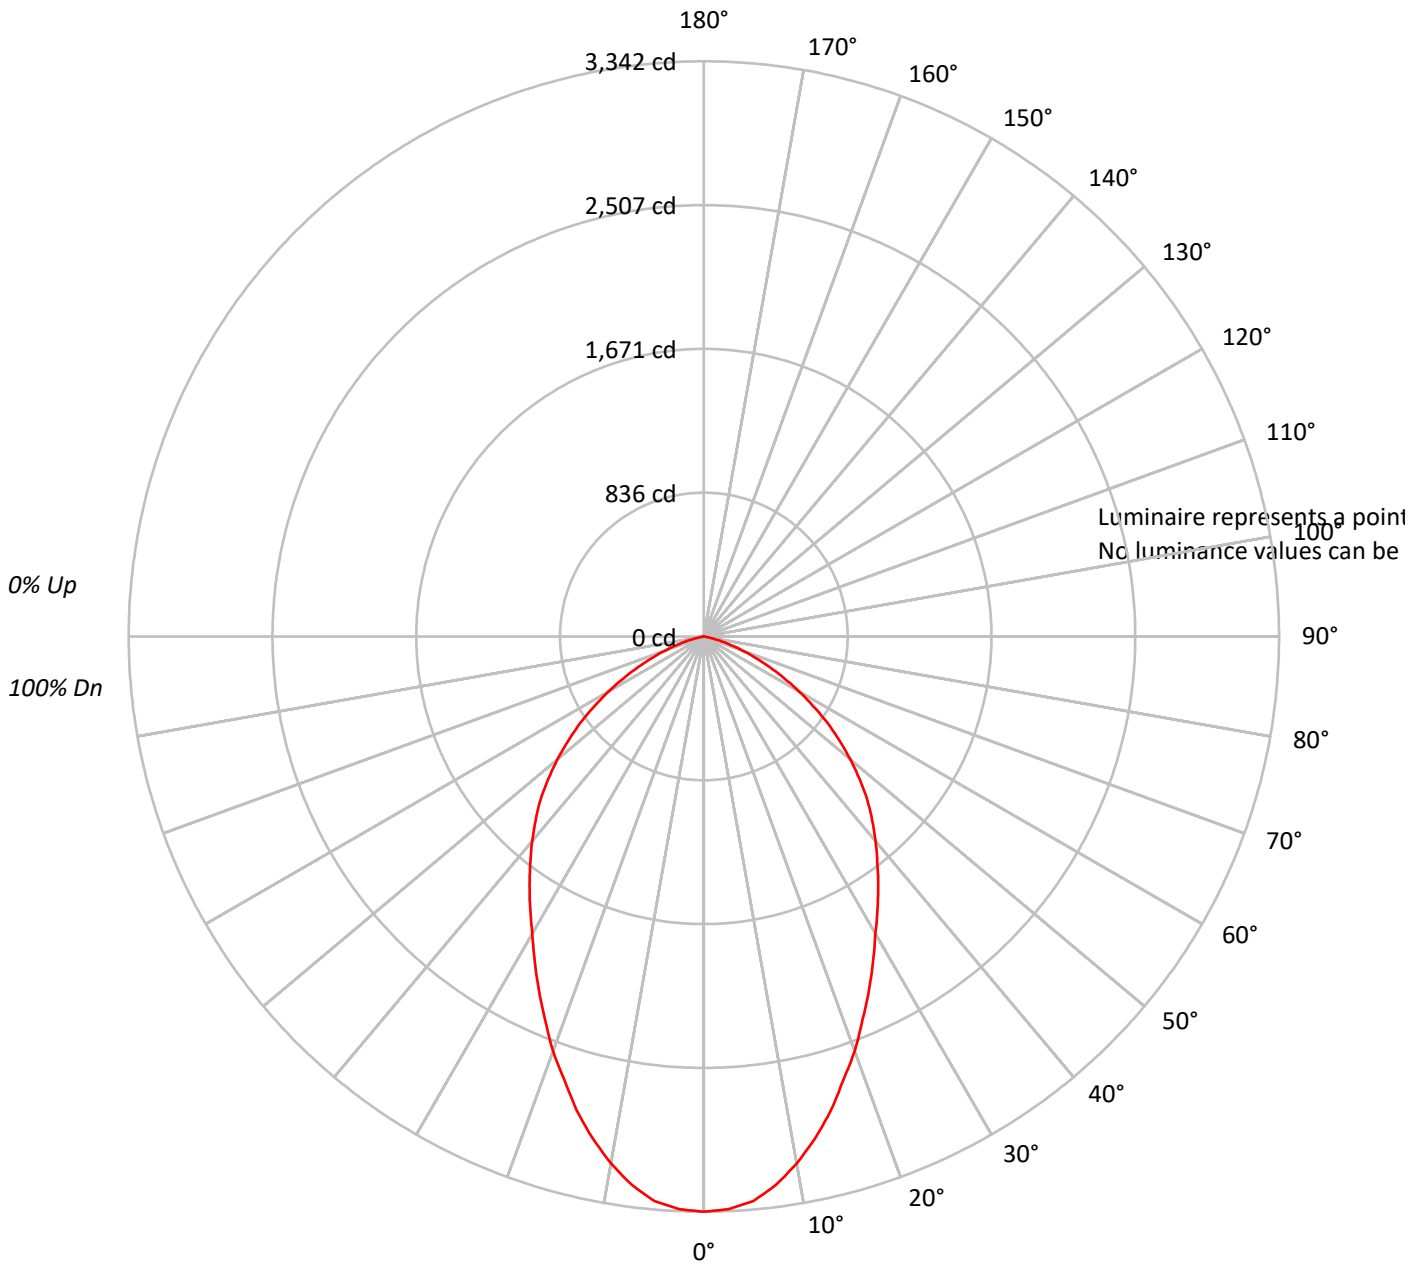



TEST NUMBER: P204293

CATALOG NUMBER: LE_6B40D010 EC6B30508035 6LBSWH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	89			
2	103	96	90	85	100	94	89	84	91	86	83	87	84	81	85	82	79	77			
3	95	86	79	73	93	84	78	73	82	76	72	79	74	70	76	73	69	67			
4	88	77	70	64	86	76	69	63	74	68	63	72	66	62	69	65	61	59			
5	81	70	62	56	79	69	62	56	67	60	55	65	59	55	63	58	54	52			
6	76	64	56	50	74	63	55	50	61	54	49	60	54	49	58	53	49	47			
7	71	58	51	45	69	58	50	45	56	49	45	55	49	44	54	48	44	42			
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38			
9	62	50	42	37	61	49	42	37	48	41	37	47	41	37	46	41	37	35			
10	58	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204293

CATALOG NUMBER: LE_6B40D010 EC6B30508035 6LBSWH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	308.2	5.5
10°-20°	797.9	14.2
20°-30°	1043.6	18.6
30°-40°	1105.0	19.7
40°-50°	1030.7	18.4
50°-60°	780.6	13.9
60°-70°	422.8	7.5
70°-80°	113.4	2.0
80°-90°	1.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2149.7	38.4
0°-40°	3254.7	58.1
0°-60°	5066.0	90.4
0°-90°	5603.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5603.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3342	
5°	3293	308
15°	2852	798
25°	2269	1044
35°	1766	1105
45°	1343	1031
55°	877	781
65°	423	423
75°	98	113
85°	0	2
90°	0	



TEST NUMBER: P204293

CATALOG NUMBER: LE_6B40D010 EC6B30508035 6LBSWH1

CANDELA DISTRIBUTION (FULL):

	0°
0°	3342.1
2.5°	3329.9
5°	3293.0
7.5°	3213.2
10°	3109.0
12.5°	2986.4
15°	2851.5
17.5°	2698.2
20°	2563.2
22.5°	2410.0
25°	2268.9
27.5°	2127.9
30°	1993.0
32.5°	1876.5
35°	1766.1
37.5°	1655.8
40°	1551.5
42.5°	1447.2
45°	1343.0
47.5°	1226.5
50°	1110.0
52.5°	993.4
55°	876.9
57.5°	754.2
60°	637.8
62.5°	527.4
65°	423.1
67.5°	325.0
70°	239.1
72.5°	165.6
75°	98.1
77.5°	42.9
80°	12.2
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)