

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P202954

Luminaire Tested: **LE\_6B40D010 EC6B30508035 6LBWGPH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P202954  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508035 6LBWGPH1  
Description: PORTFOLIO 6 INCH 60 DEGREE CUTOFF RECESSED DOWNLIGHT  
WIDE DISTRIBUTIONWITH GRAPHITE HAZE TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3562.1 lumens  
Efficiency: N/A  
Efficacy: 85.2 lumens/watt  
Spacing Criteria (0/90/45): 1.11 / 1.11 / 1.11  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P202954

CATALOG NUMBER: LE\_6B40D010 EC6B30508035 6LBWGPH1

### Luminous Intensity Polar Plot

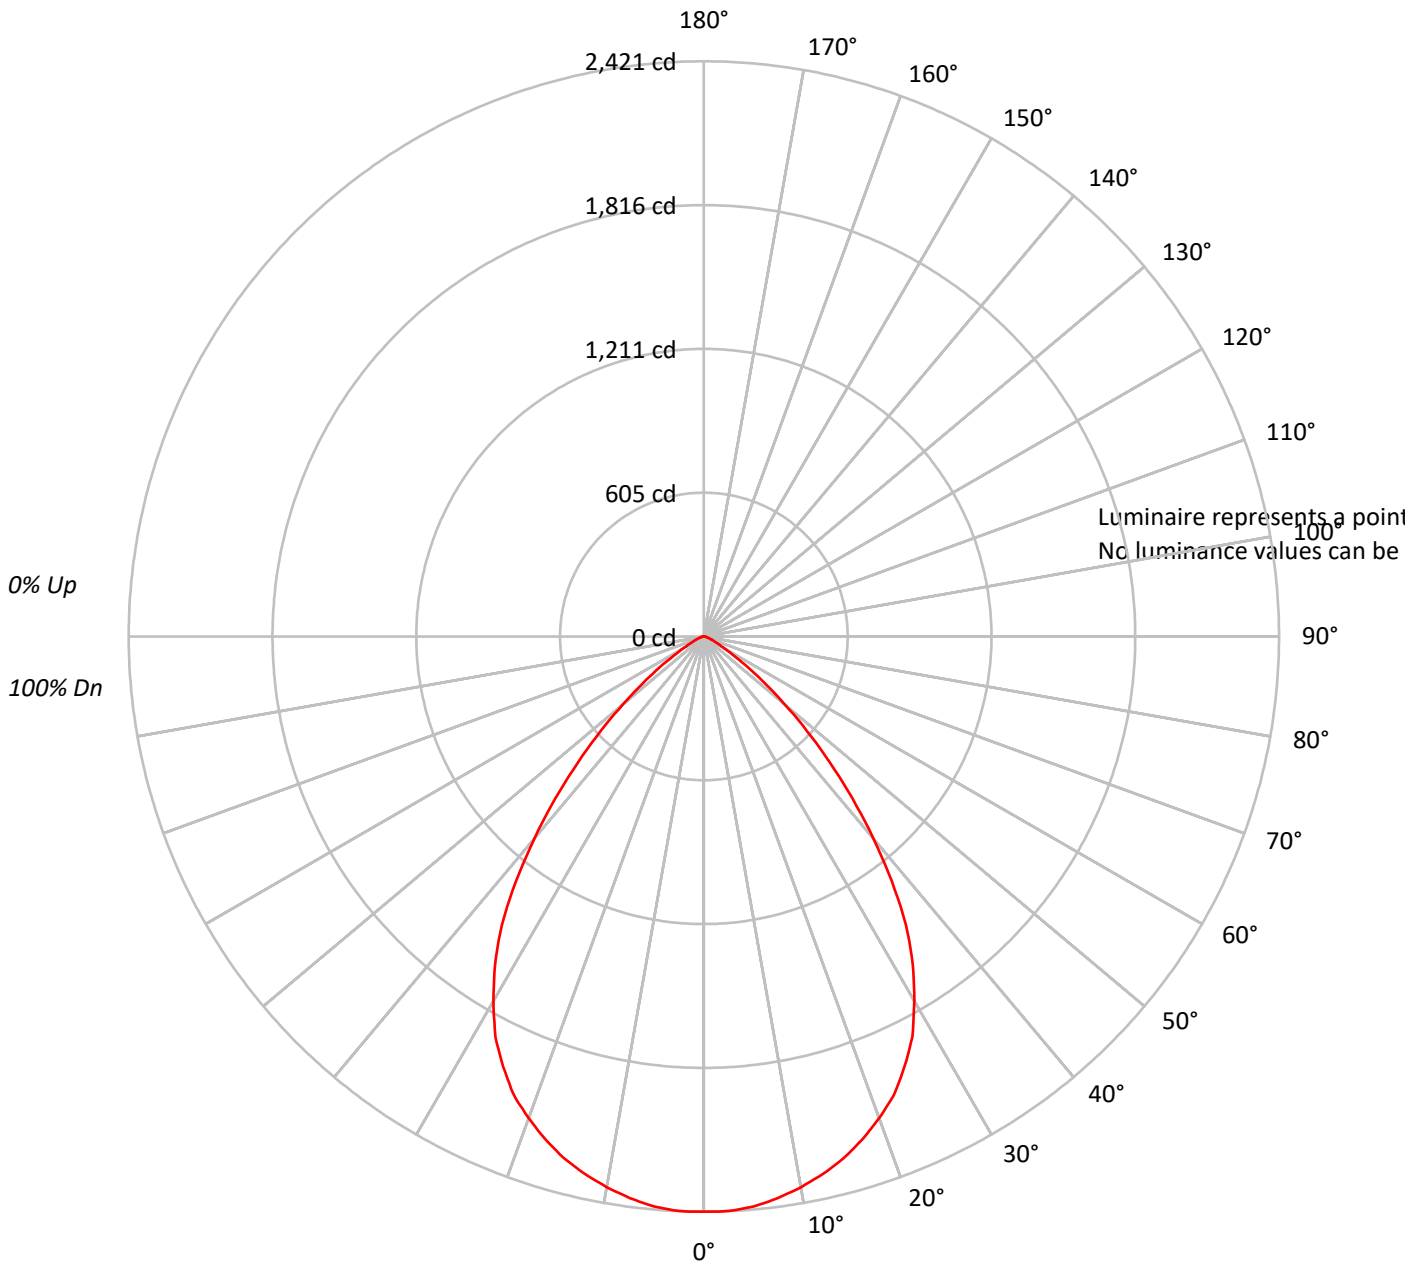



TEST NUMBER: P202954

CATALOG NUMBER: LE\_6B40D010 EC6B30508035 6LBWGPH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	104	110	107	104	102	103	101	99	99	98	96	96	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	86	84	82			
3	99	91	85	81	97	90	84	80	87	82	79	85	81	77	82	79	76	74			
4	93	84	77	72	91	82	76	72	80	75	71	78	74	70	76	72	69	67			
5	87	77	70	65	85	76	69	65	74	68	64	72	67	63	71	66	63	61			
6	81	71	64	59	80	70	63	59	68	62	58	67	62	58	65	61	57	56			
7	76	65	58	53	75	65	58	53	63	57	53	62	57	53	61	56	52	51			
8	72	61	54	49	70	60	53	49	59	53	49	58	52	48	57	52	48	47			
9	68	57	50	45	66	56	49	45	55	49	45	54	48	45	53	48	44	43			
10	64	53	46	42	63	52	46	42	51	45	41	51	45	41	50	45	41	40			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P202954

CATALOG NUMBER: LE\_6B40D010 EC6B30508035 6LBWGPH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	228.1	6.4
10°-20°	639.6	18.0
20°-30°	915.1	25.7
30°-40°	912.1	25.6
40°-50°	580.9	16.3
50°-60°	214.2	6.0
60°-70°	53.6	1.5
70°-80°	16.1	0.5
80°-90°	2.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1782.7	50.0
0°-40°	2694.8	75.7
0°-60°	3490.0	98.0
0°-90°	3562.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3562.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2421	
5°	2409	228
15°	2274	640
25°	1998	915
35°	1483	912
45°	748	581
55°	227	214
65°	49	54
75°	12	16
85°	0	2
90°	0	



TEST NUMBER: P202954

CATALOG NUMBER: LE\_6B40D010 EC6B30508035 6LBWGPH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2421.0
2.5°	2421.0
5°	2408.8
7.5°	2384.2
10°	2353.6
12.5°	2316.9
15°	2274.0
17.5°	2218.8
20°	2157.5
22.5°	2090.1
25°	1998.1
27.5°	1900.1
30°	1771.4
32.5°	1636.5
35°	1483.2
37.5°	1299.4
40°	1109.4
42.5°	925.5
45°	747.8
47.5°	588.4
50°	441.2
52.5°	324.9
55°	226.8
57.5°	147.1
60°	98.1
62.5°	67.4
65°	49.0
67.5°	36.8
70°	30.6
72.5°	18.4
75°	12.2
77.5°	12.2
80°	6.1
82.5°	6.1
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)