

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203990

Luminaire Tested: **LE\_6B40D010 EC6B30509035 6LBNB1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203990  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30509035 6LBNB1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
NARROW DISTRIBUTION WITH SPECULAR BLACK TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1974.7 lumens  
Efficiency: N/A  
Efficacy: 47.2 lumens/watt  
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.83  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203990

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBNB1

### Luminous Intensity Polar Plot

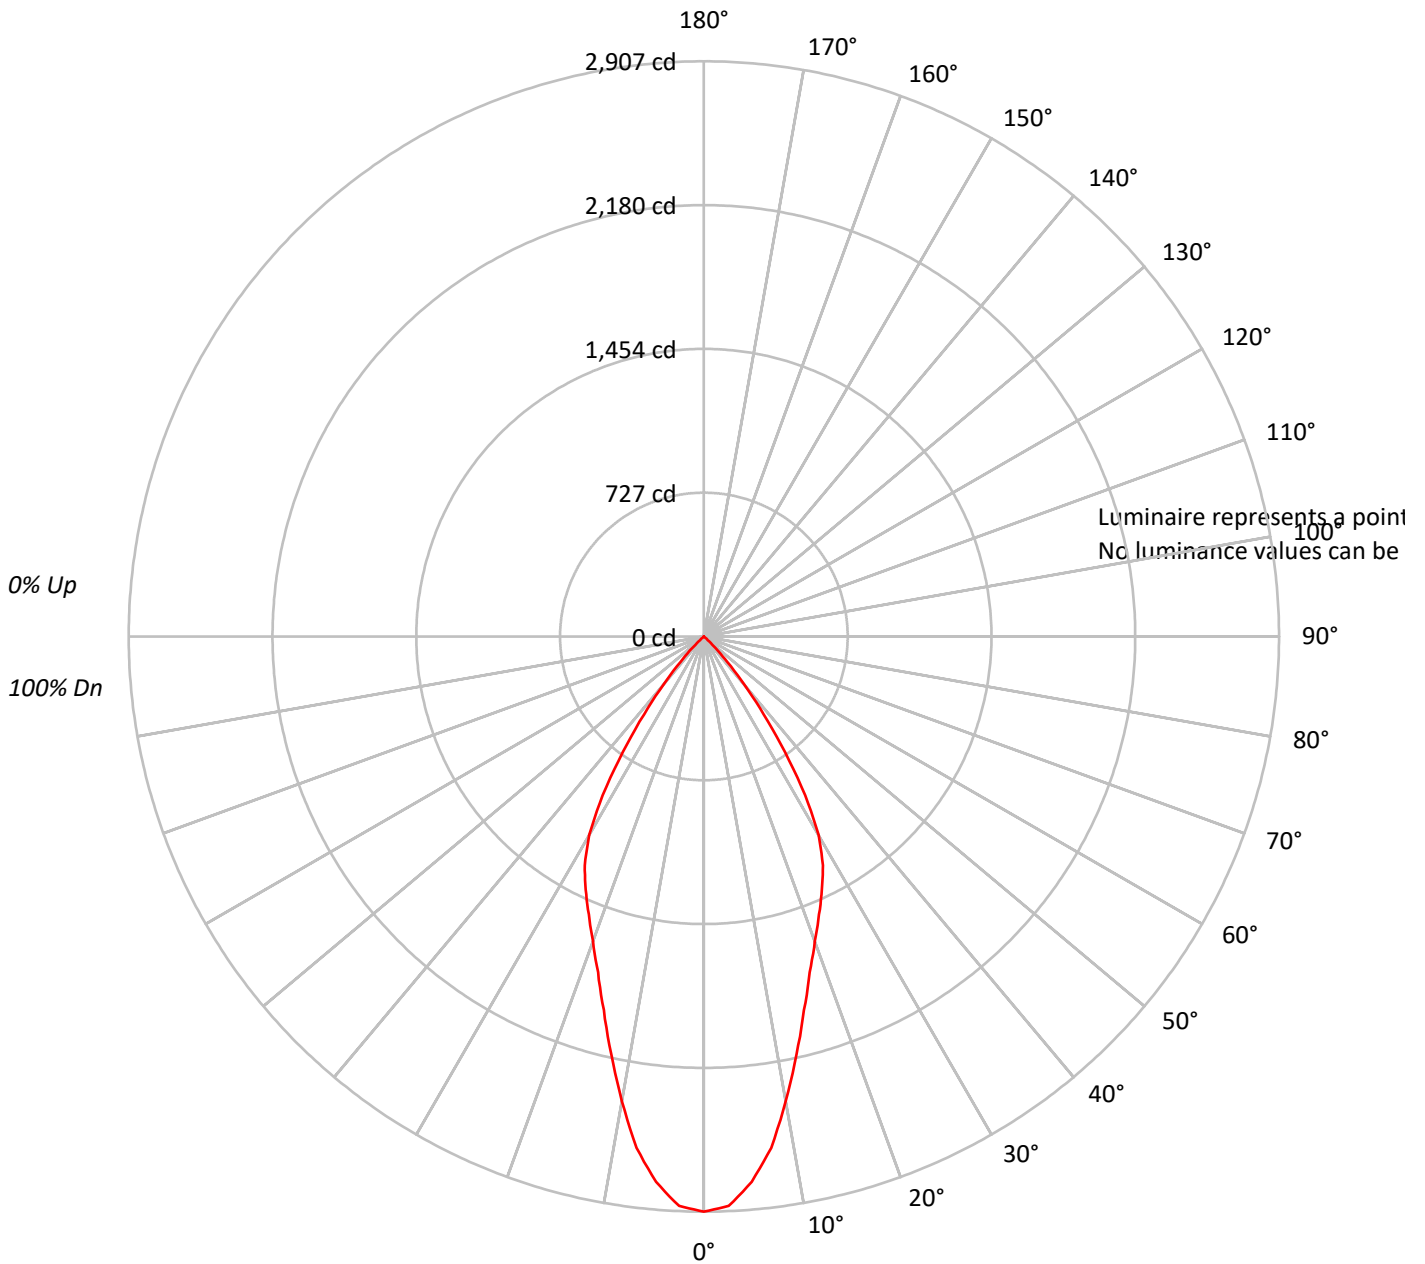



TEST NUMBER: P203990

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBNB1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |    |    |   |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |    | 0  |   |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0 |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |   |
| 1   | 114 | 111 | 109 | 107 | 111 | 109 | 107 | 105 | 105 | 103 | 102 | 101 | 100 | 99  | 98  | 97  | 96  | 94  |    |    |   |
| 2   | 108 | 104 | 100 | 97  | 106 | 102 | 99  | 96  | 99  | 96  | 93  | 96  | 94  | 91  | 93  | 91  | 90  | 88  |    |    |   |
| 3   | 103 | 97  | 92  | 88  | 101 | 96  | 91  | 88  | 93  | 89  | 86  | 91  | 88  | 85  | 88  | 86  | 84  | 82  |    |    |   |
| 4   | 98  | 91  | 86  | 82  | 96  | 90  | 85  | 81  | 88  | 84  | 80  | 86  | 82  | 79  | 84  | 81  | 78  | 77  |    |    |   |
| 5   | 93  | 85  | 80  | 76  | 92  | 85  | 79  | 75  | 83  | 78  | 75  | 81  | 77  | 74  | 80  | 76  | 73  | 72  |    |    |   |
| 6   | 89  | 80  | 75  | 71  | 88  | 80  | 74  | 70  | 78  | 73  | 70  | 77  | 73  | 69  | 75  | 72  | 69  | 67  |    |    |   |
| 7   | 85  | 76  | 70  | 66  | 83  | 75  | 70  | 66  | 74  | 69  | 65  | 73  | 68  | 65  | 72  | 68  | 65  | 63  |    |    |   |
| 8   | 81  | 72  | 66  | 62  | 80  | 71  | 66  | 62  | 70  | 65  | 61  | 69  | 64  | 61  | 68  | 64  | 61  | 60  |    |    |   |
| 9   | 77  | 68  | 62  | 58  | 76  | 67  | 62  | 58  | 66  | 61  | 58  | 65  | 61  | 58  | 65  | 61  | 58  | 56  |    |    |   |
| 10  | 74  | 64  | 59  | 55  | 73  | 64  | 58  | 55  | 63  | 58  | 55  | 62  | 58  | 55  | 62  | 57  | 54  | 53  |    |    |   |

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203990

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBNB1

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 252.2  | 12.8      |
| 10°-20°   | 549.6  | 27.8      |
| 20°-30°   | 645.9  | 32.7      |
| 30°-40°   | 444.7  | 22.5      |
| 40°-50°   | 82.4   | 4.2       |
| 50°-60°   | 0.0    | 0.0       |
| 60°-70°   | 0.0    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 1447.6 | 73.3      |
| 0°-40°    | 1892.3 | 95.8      |
| 0°-60°    | 1974.7 | 100.0     |
| 0°-90°    | 1974.7 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1974.7 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 2907 |      |
| 5°  | 2767 | 252  |
| 15° | 1955 | 550  |
| 25° | 1412 | 646  |
| 35° | 714  | 445  |
| 45° | 83   | 82   |
| 55° | 0    | 0    |
| 65° | 0    | 0    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P203990

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBNB1

**CANDELA DISTRIBUTION (FULL):**

|       | 0°     |
|-------|--------|
| 0°    | 2906.9 |
| 2.5°  | 2881.0 |
| 5°    | 2767.2 |
| 7.5°  | 2606.9 |
| 10°   | 2384.5 |
| 12.5° | 2162.1 |
| 15°   | 1955.1 |
| 17.5° | 1779.2 |
| 20°   | 1639.6 |
| 22.5° | 1520.8 |
| 25°   | 1412.1 |
| 27.5° | 1303.5 |
| 30°   | 1158.6 |
| 32.5° | 951.8  |
| 35°   | 713.8  |
| 37.5° | 496.5  |
| 40°   | 315.5  |
| 42.5° | 175.9  |
| 45°   | 82.8   |
| 47.5° | 25.9   |
| 50°   | 0.0    |
| 52.5° | 0.0    |
| 55°   | 0.0    |
| 57.5° | 0.0    |
| 60°   | 0.0    |
| 62.5° | 0.0    |
| 65°   | 0.0    |
| 67.5° | 0.0    |
| 70°   | 0.0    |
| 72.5° | 0.0    |
| 75°   | 0.0    |
| 77.5° | 0.0    |
| 80°   | 0.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)