

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203681

Luminaire Tested: **LE_6B40D010 EC6B30509035 6LBNH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203681
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509035 6LBNH1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
NARROW DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2845.4 lumens
Efficiency: N/A
Efficacy: 68.1 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203681

CATALOG NUMBER: LE_6B40D010 EC6B30509035 6LBNH1

Luminous Intensity Polar Plot

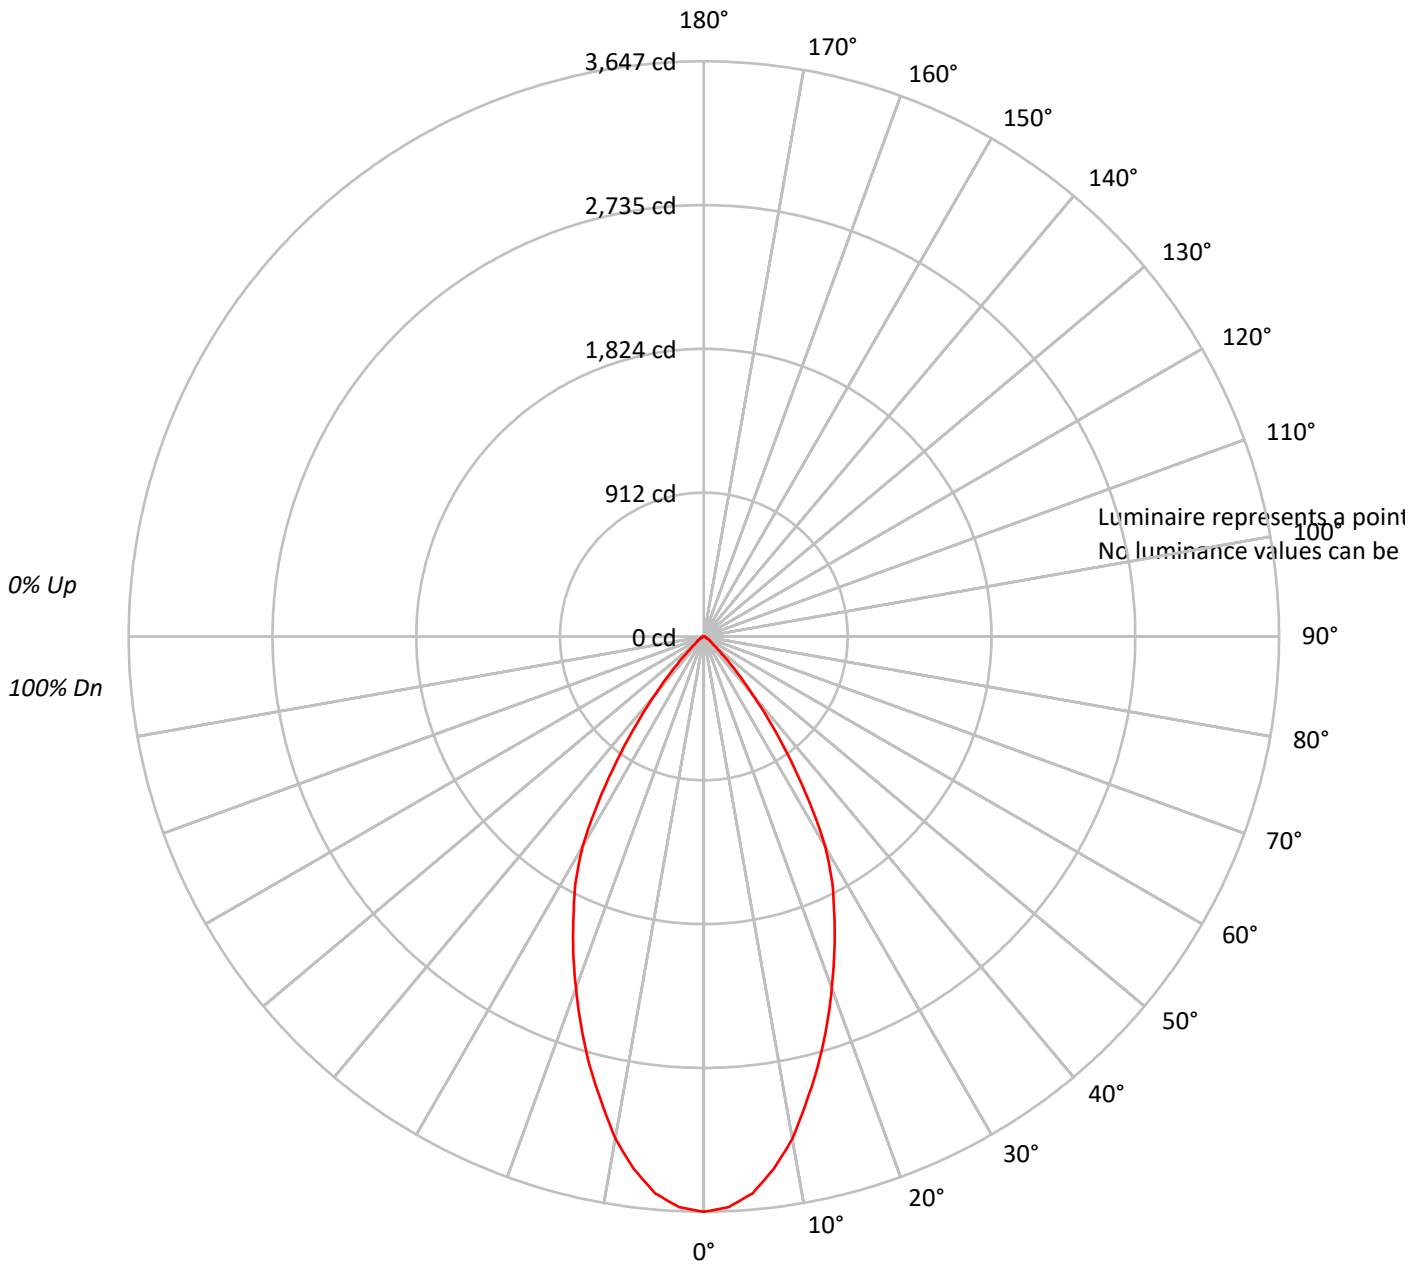



TEST NUMBER: P203681

CATALOG NUMBER: LE_6B40D010 EC6B30509035 6LBNH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75																			
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70																			
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65																			
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61																			
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58																			
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	55	54																			
10	72	62	57	53	71	62	57	53	61	56	53	60	56	52	60	55	52	51																			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203681

CATALOG NUMBER: LE_6B40D010 EC6B30509035 6LBNH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	328.0	11.5
10°-20°	782.2	27.5
20°-30°	896.1	31.5
30°-40°	602.1	21.2
40°-50°	172.0	6.0
50°-60°	42.1	1.5
60°-70°	16.0	0.6
70°-80°	6.2	0.2
80°-90°	0.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2006.3	70.5
0°-40°	2608.4	91.7
0°-60°	2822.5	99.2
0°-90°	2845.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2845.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3647	
5°	3544	328
15°	2807	782
25°	1956	896
35°	960	602
45°	197	172
55°	47	42
65°	16	16
75°	5	6
85°	0	1
90°	0	



TEST NUMBER: P203681

CATALOG NUMBER: LE_6B40D010 EC6B30509035 6LBNH1

CANDELA DISTRIBUTION (FULL):

0°	
0°	3647.4
2.5°	3621.5
5°	3543.6
7.5°	3403.6
10°	3232.4
12.5°	3014.5
15°	2806.9
17.5°	2589.0
20°	2371.1
22.5°	2163.5
25°	1956.0
27.5°	1764.0
30°	1541.0
32.5°	1245.2
35°	959.9
37.5°	700.4
40°	482.5
42.5°	316.5
45°	197.1
47.5°	119.4
50°	72.6
52.5°	57.1
55°	46.8
57.5°	36.4
60°	26.0
62.5°	20.8
65°	15.6
67.5°	10.4
70°	10.4
72.5°	5.2
75°	5.2
77.5°	5.2
80°	5.2
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)