

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204299

Luminaire Tested: **LE\_6B40D010 EC6B30509035 6LBSWH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204299  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30509035 6LBSWH1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH WHEAT TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4737.0 lumens  
Efficiency: N/A  
Efficacy: 113.3 lumens/watt  
Spacing Criteria (0/90/45): 0.94 / 0.94 / 1.08  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204299

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBSWH1

### Luminous Intensity Polar Plot

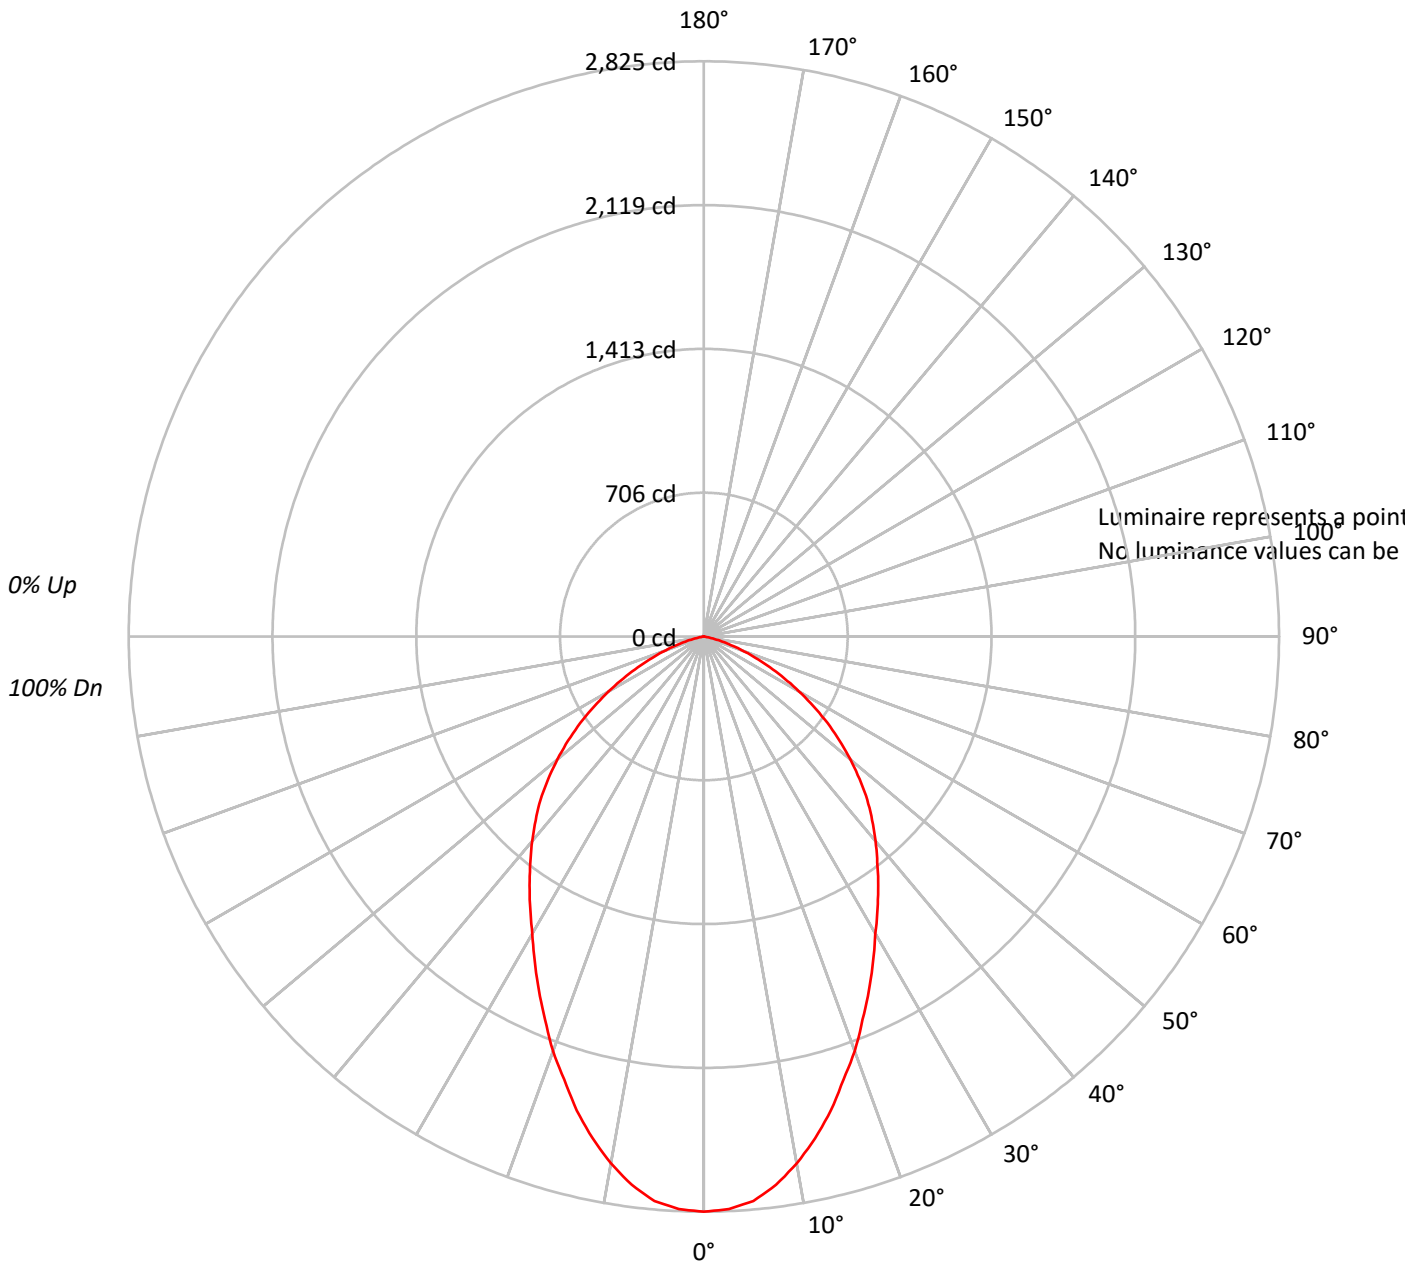



TEST NUMBER: P204299

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBSWH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	89			
2	103	96	90	85	100	94	89	84	91	86	83	87	84	81	85	82	79	77			
3	95	86	79	73	93	84	78	73	82	76	72	79	74	70	76	73	69	67			
4	88	77	70	64	86	76	69	63	74	68	63	72	66	62	69	65	61	59			
5	81	70	62	56	79	69	62	56	67	60	55	65	59	55	63	58	54	52			
6	76	64	56	50	74	63	55	50	61	54	49	60	54	49	58	53	49	47			
7	71	58	51	45	69	58	50	45	56	49	45	55	49	44	54	48	44	42			
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38			
9	62	50	42	37	61	49	42	37	48	41	37	47	41	37	46	41	37	35			
10	58	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204299

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBSWH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	260.6	5.5
10°-20°	674.5	14.2
20°-30°	882.2	18.6
30°-40°	934.1	19.7
40°-50°	871.2	18.4
50°-60°	659.8	13.9
60°-70°	357.4	7.5
70°-80°	95.9	2.0
80°-90°	1.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1817.2	38.4
0°-40°	2751.3	58.1
0°-60°	4282.4	90.4
0°-90°	4737.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4737.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2825	
5°	2784	261
15°	2410	674
25°	1918	882
35°	1493	934
45°	1135	871
55°	741	660
65°	358	357
75°	83	96
85°	0	1
90°	0	



TEST NUMBER: P204299

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBSWH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2825.1
2.5°	2814.8
5°	2783.6
7.5°	2716.2
10°	2628.1
12.5°	2524.5
15°	2410.5
17.5°	2280.9
20°	2166.8
22.5°	2037.2
25°	1918.0
27.5°	1798.8
30°	1684.8
32.5°	1586.2
35°	1492.9
37.5°	1399.6
40°	1311.5
42.5°	1223.4
45°	1135.2
47.5°	1036.8
50°	938.2
52.5°	839.8
55°	741.2
57.5°	637.6
60°	539.1
62.5°	445.8
65°	357.6
67.5°	274.8
70°	202.1
72.5°	140.0
75°	83.0
77.5°	36.2
80°	10.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)