

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203063

Luminaire Tested: **LE\_6B40D010 EC6B30509035 6LBWB1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P203063  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30509035 6LBWB1  
Description: PORTFOLIO 6 INCH 60 DEGREE CUTOFF RECESSED DOWNLIGHT  
WIDE DISTRIBUTION WITH SPECULAR BLACK TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2544.7 lumens  
Efficiency: N/A  
Efficacy: 60.9 lumens/watt  
Spacing Criteria (0/90/45): 1.08 / 1.08 / 1.08  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P203063

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBWB1

### Luminous Intensity Polar Plot

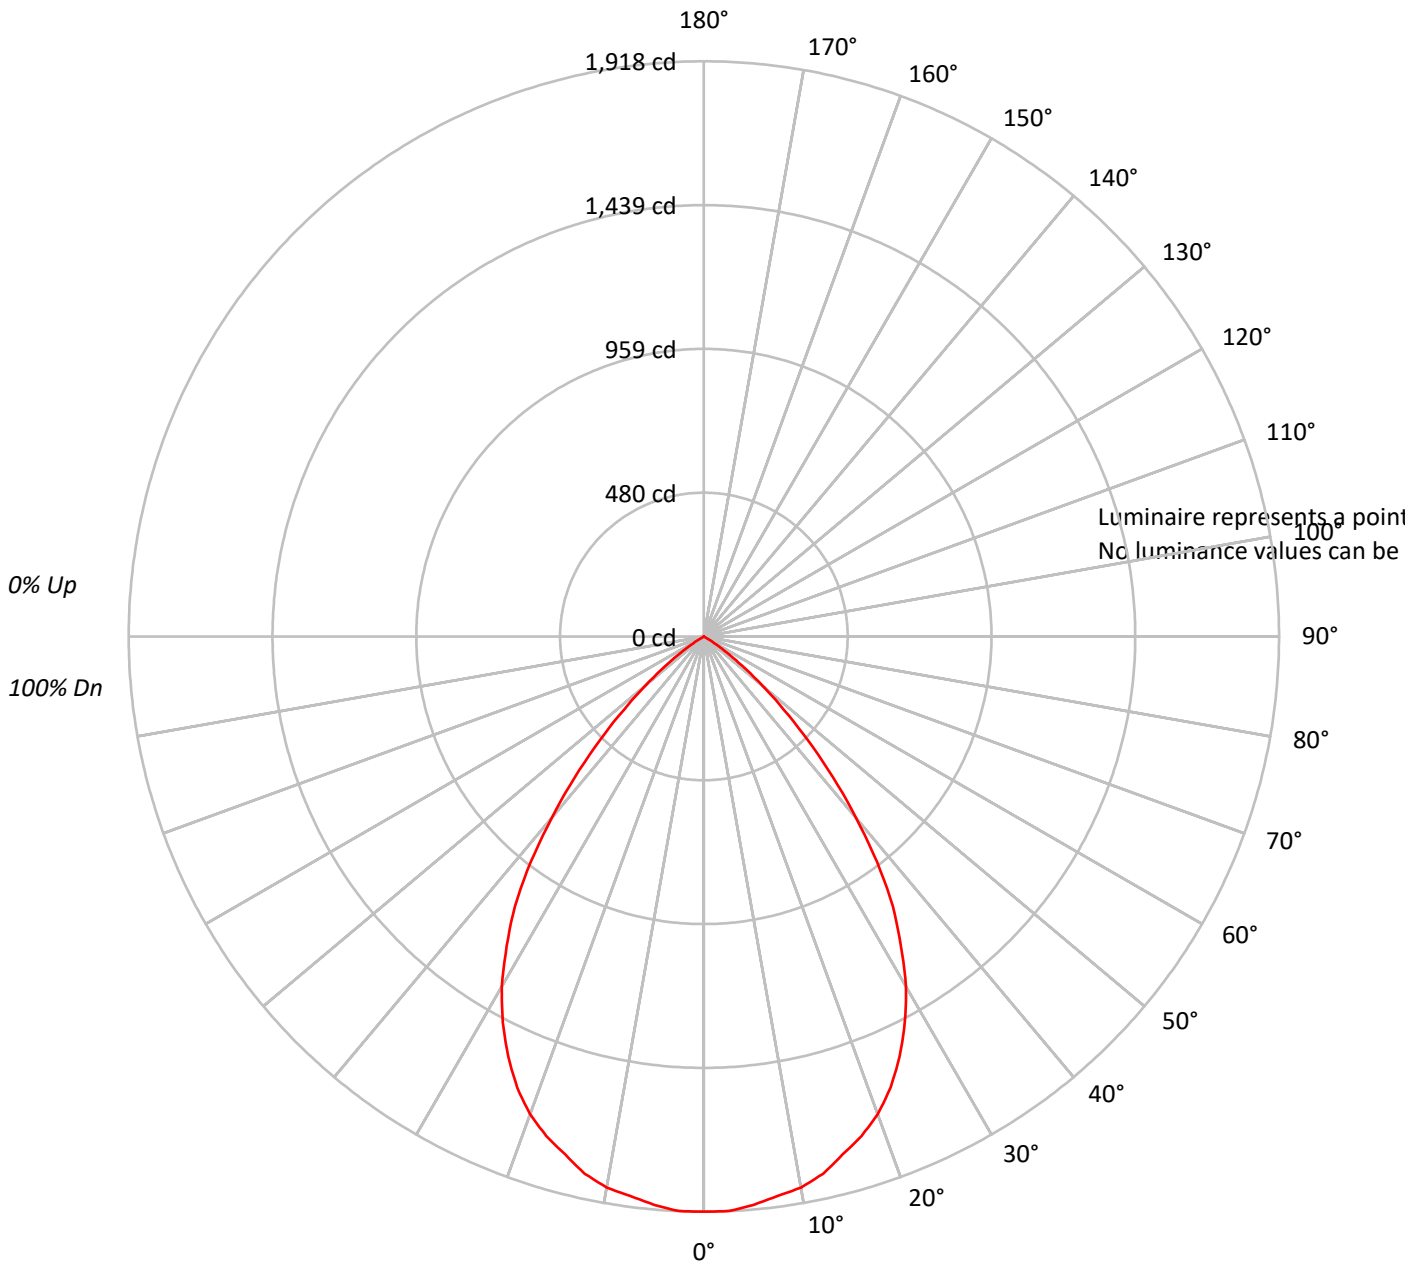



TEST NUMBER: P203063

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBWB1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92	92	92	92
2	106	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84	84	84	84
3	100	93	87	83	98	92	86	82	89	85	81	86	83	80	84	81	78	77	77	77	77
4	94	86	79	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70	70	70	70
5	89	79	73	68	87	78	72	67	76	71	67	75	70	66	73	69	66	64	64	64	64
6	83	73	67	62	82	72	66	61	71	65	61	69	64	61	68	64	60	59	59	59	59
7	78	68	61	56	77	67	61	56	66	60	56	65	60	56	63	59	55	54	54	54	54
8	74	63	57	52	73	63	56	52	61	56	52	60	55	51	59	55	51	50	50	50	50
9	70	59	52	48	69	58	52	48	57	52	48	57	51	47	56	51	47	46	46	46	46
10	66	55	49	44	65	55	49	44	54	48	44	53	48	44	52	47	44	42	42	42	42

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P203063

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBWB1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	180.3	7.1
10°-20°	504.2	19.8
20°-30°	706.3	27.8
30°-40°	674.6	26.5
40°-50°	384.2	15.1
50°-60°	93.8	3.7
60°-70°	1.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1390.9	54.7
0°-40°	2065.5	81.2
0°-60°	2543.5	100.0
0°-90°	2544.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2544.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1918	
5°	1902	180
15°	1788	504
25°	1545	706
35°	1099	675
45°	492	384
55°	93	94
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P203063

CATALOG NUMBER: LE\_6B40D010 EC6B30509035 6LBWB1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1917.9
2.5°	1917.9
5°	1902.4
7.5°	1881.6
10°	1866.0
12.5°	1835.0
15°	1788.2
17.5°	1746.9
20°	1695.0
22.5°	1627.6
25°	1544.6
27.5°	1451.4
30°	1347.8
32.5°	1223.2
35°	1098.9
37.5°	948.6
40°	787.9
42.5°	637.6
45°	492.4
47.5°	362.9
50°	254.0
52.5°	160.6
55°	93.2
57.5°	41.5
60°	10.4
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)