

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204914

Luminaire Tested: **LE_6B40D010 EC6B30508040 6LBCSMB1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204914
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30508040 6LBCSMB1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH CAST MATTE BLACK TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5020.0 lumens
Efficiency: N/A
Efficacy: 120.1 lumens/watt
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204914

CATALOG NUMBER: LE_6B40D010 EC6B30508040 6LBCSMB1

Luminous Intensity Polar Plot

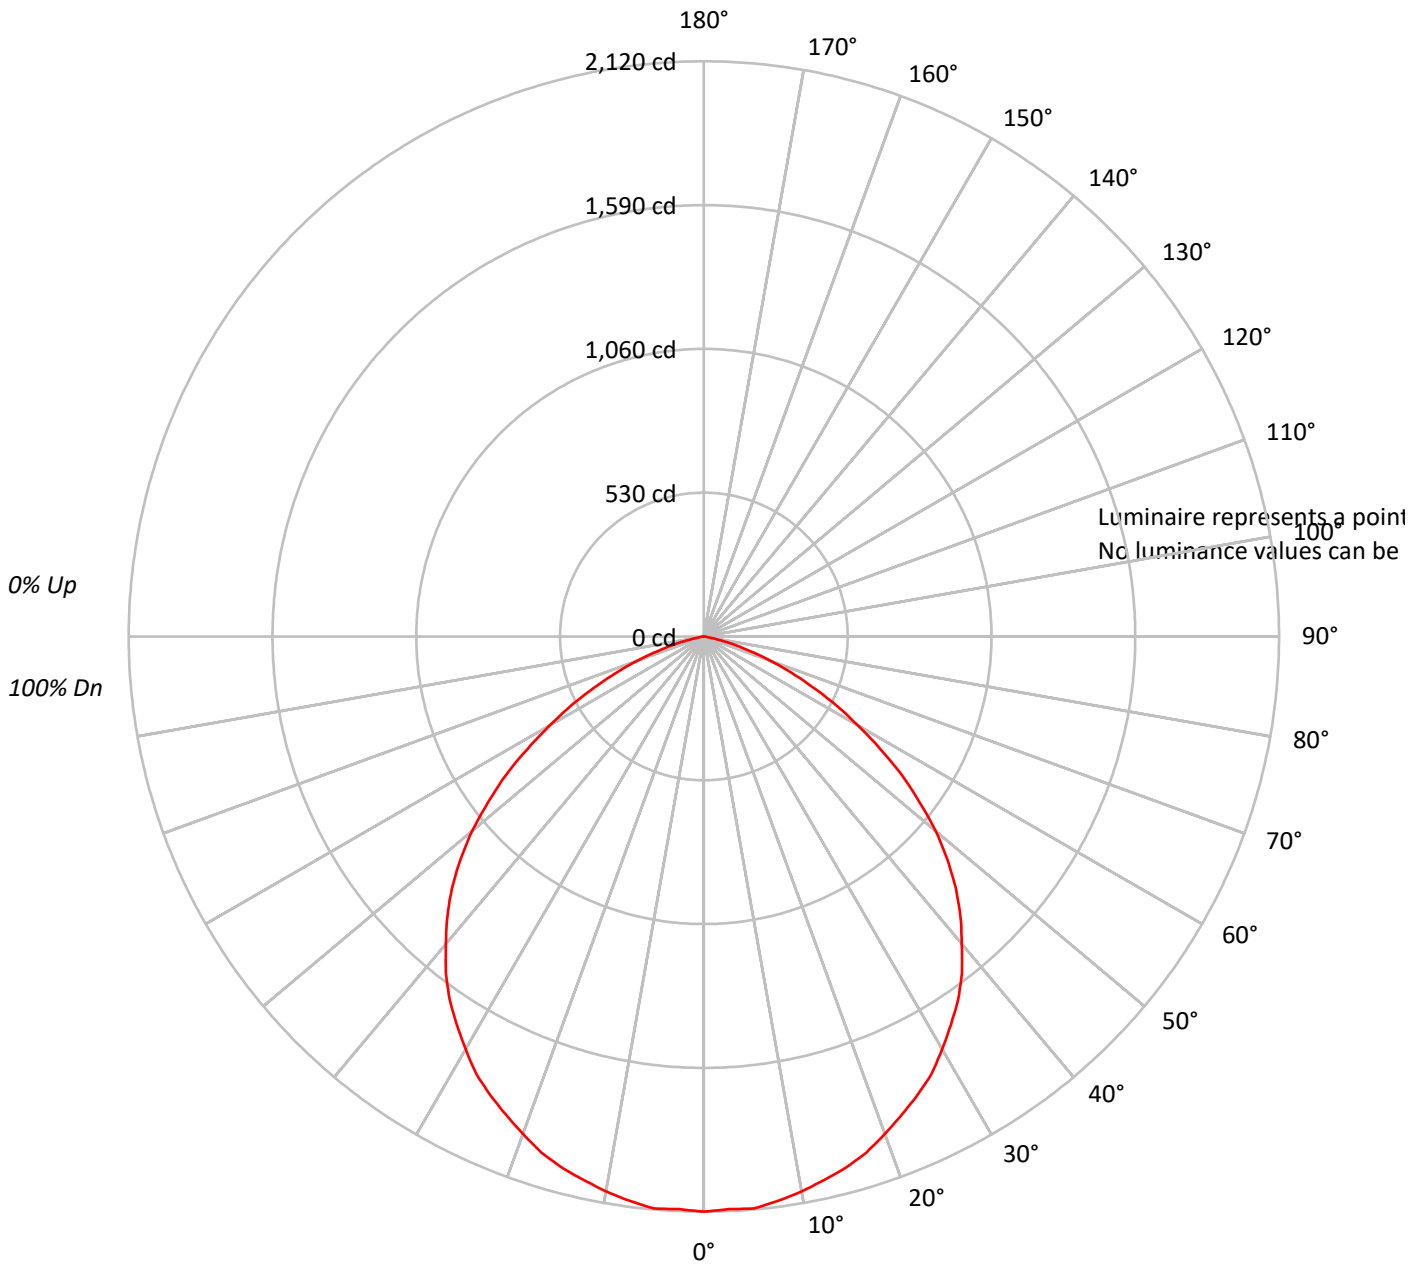



TEST NUMBER: P204914

CATALOG NUMBER: LE_6B40D010 EC6B30508040 6LBCSMB1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	90	88																			
2	102	95	89	84	99	93	87	83	89	85	81	86	82	79	83	80	77	75																			
3	93	84	77	71	91	83	76	70	80	74	69	77	72	68	74	70	67	65																			
4	86	75	67	61	84	74	66	61	71	65	60	69	63	59	67	62	58	56																			
5	79	67	59	53	77	66	59	53	64	57	52	62	56	52	61	55	51	49																			
6	74	61	53	47	72	60	52	46	58	51	46	57	50	46	55	50	45	43																			
7	68	55	47	41	67	55	47	41	53	46	41	52	45	41	50	45	40	39																			
8	64	51	43	37	62	50	42	37	49	42	37	48	41	37	46	41	36	35																			
9	60	47	39	33	58	46	39	33	45	38	33	44	38	33	43	37	33	31																			
10	56	43	35	30	55	43	35	30	42	35	30	41	34	30	40	34	30	28																			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204914

CATALOG NUMBER: LE_6B40D010 EC6B30508040 6LBCSMB1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.5	4.0
10°-20°	571.2	11.4
20°-30°	858.7	17.1
30°-40°	1018.8	20.3
40°-50°	1008.2	20.1
50°-60°	791.9	15.8
60°-70°	444.0	8.8
70°-80°	124.7	2.5
80°-90°	2.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1630.3	32.5
0°-40°	2649.2	52.8
0°-60°	4449.3	88.6
0°-90°	5020.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5020.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2120	
5°	2116	200
15°	2026	571
25°	1864	859
35°	1634	1019
45°	1314	1008
55°	892	792
65°	443	444
75°	108	125
85°	0	2
90°	0	



TEST NUMBER: P204914

CATALOG NUMBER: LE_6B40D010 EC6B30508040 6LBCSMB1

CANDELA DISTRIBUTION (FULL):

	0°
0°	2119.8
2.5°	2112.5
5°	2116.1
7.5°	2098.1
10°	2076.5
12.5°	2051.4
15°	2026.1
17.5°	1993.8
20°	1950.6
22.5°	1907.4
25°	1864.2
27.5°	1817.4
30°	1756.2
32.5°	1695.1
35°	1633.9
37.5°	1561.9
40°	1479.1
42.5°	1400.0
45°	1313.6
47.5°	1216.4
50°	1115.6
52.5°	1000.5
55°	892.5
57.5°	770.1
60°	655.0
62.5°	550.6
65°	442.6
67.5°	349.1
70°	259.1
72.5°	176.4
75°	108.0
77.5°	54.0
80°	14.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)