

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P205319

Luminaire Tested: **LE\_6B40D010 EC6B30508040 6LBNLI1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P205319  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508040 6LBNLI1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
NARROW DISTRIBUTION WITH SPECULAR CLEAR TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4300.9 lumens  
Efficiency: N/A  
Efficacy: 102.9 lumens/watt  
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P205319

CATALOG NUMBER: LE\_6B40D010 EC6B30508040 6LBNLI1

### Luminous Intensity Polar Plot

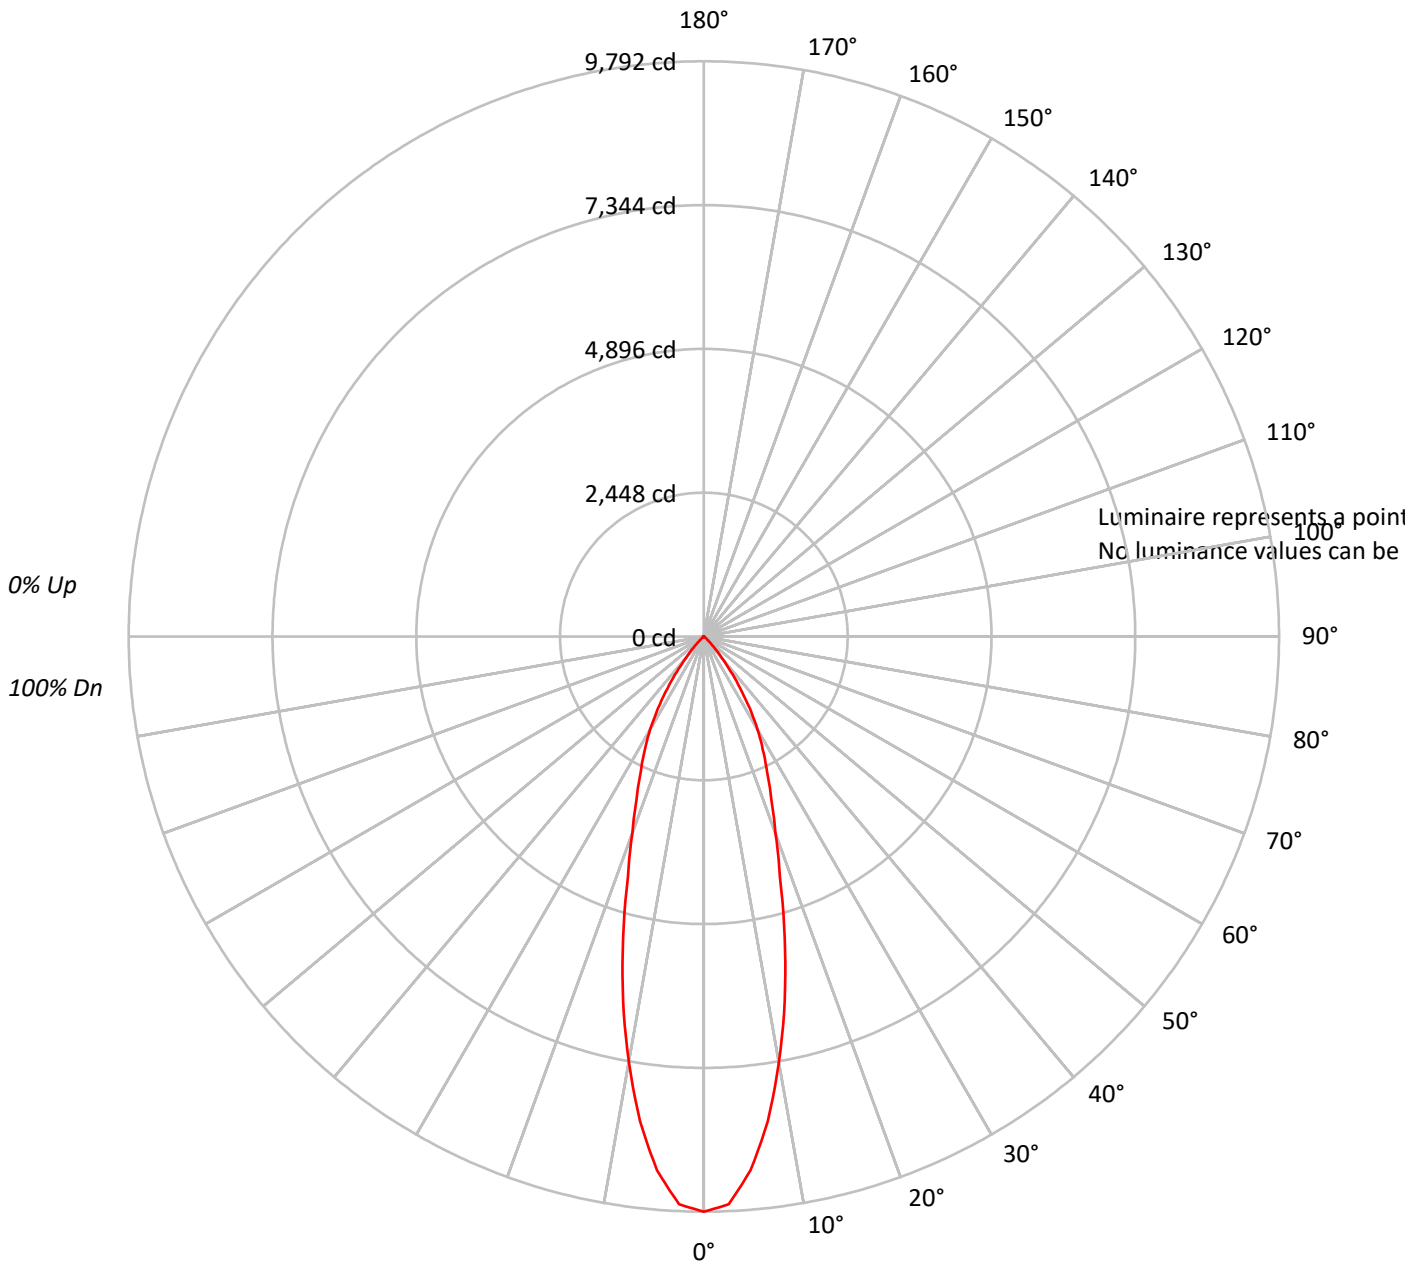



TEST NUMBER: P205319

CATALOG NUMBER: LE\_6B40D010 EC6B30508040 6LBNLI1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	109	107	112	109	107	106	105	104	102	102	101	99	98	97	96	95			
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	89			
3	105	99	94	91	103	97	93	90	95	91	89	93	90	87	90	88	86	85			
4	100	93	88	85	98	92	88	84	90	86	83	88	85	82	86	84	81	80			
5	96	88	83	79	94	87	83	79	86	82	78	84	81	78	83	80	77	76			
6	92	84	79	75	90	83	78	75	82	77	74	80	76	74	79	76	73	72			
7	88	80	74	71	87	79	74	71	78	73	70	77	73	70	76	72	69	68			
8	84	76	71	67	83	75	70	67	74	70	67	73	69	66	73	69	66	65			
9	81	73	67	64	80	72	67	64	71	67	63	70	66	63	70	66	63	62			
10	78	69	64	61	77	69	64	61	68	64	61	67	63	60	67	63	60	59			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P205319

CATALOG NUMBER: LE\_6B40D010 EC6B30508040 6LBNLI1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	814.2	18.9
10°-20°	1461.4	34.0
20°-30°	1181.5	27.5
30°-40°	680.6	15.8
40°-50°	143.9	3.3
50°-60°	12.4	0.3
60°-70°	6.2	0.1
70°-80°	0.8	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3457.1	80.4
0°-40°	4137.7	96.2
0°-60°	4294.0	99.8
0°-90°	4300.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4300.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9792	
5°	9123	814
15°	5309	1461
25°	2549	1182
35°	1079	681
45°	155	144
55°	12	12
65°	6	6
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P205319

CATALOG NUMBER: LE\_6B40D010 EC6B30508040 6LBNLI1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	9792.4
2.5°	9674.6
5°	9122.6
7.5°	8328.9
10°	7355.1
12.5°	6356.8
15°	5308.6
17.5°	4297.8
20°	3559.8
22.5°	2995.4
25°	2548.9
27.5°	2170.6
30°	1829.5
32.5°	1451.1
35°	1079.1
37.5°	750.4
40°	489.9
42.5°	297.6
45°	155.0
47.5°	62.0
50°	18.6
52.5°	18.6
55°	12.4
57.5°	12.4
60°	6.2
62.5°	6.2
65°	6.2
67.5°	6.2
70°	6.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)