

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P205422

Luminaire Tested: **LE\_6B40D010 EC6B30508040 6LBSLI1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P205422  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508040 6LBSLI1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH SPECULAR CLEAR TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5831.8 lumens  
Efficiency: N/A  
Efficacy: 139.5 lumens/watt  
Spacing Criteria (0/90/45): 0.91 / 0.91 / 1.04  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P205422

CATALOG NUMBER: LE\_6B40D010 EC6B30508040 6LBSLI1

### Luminous Intensity Polar Plot

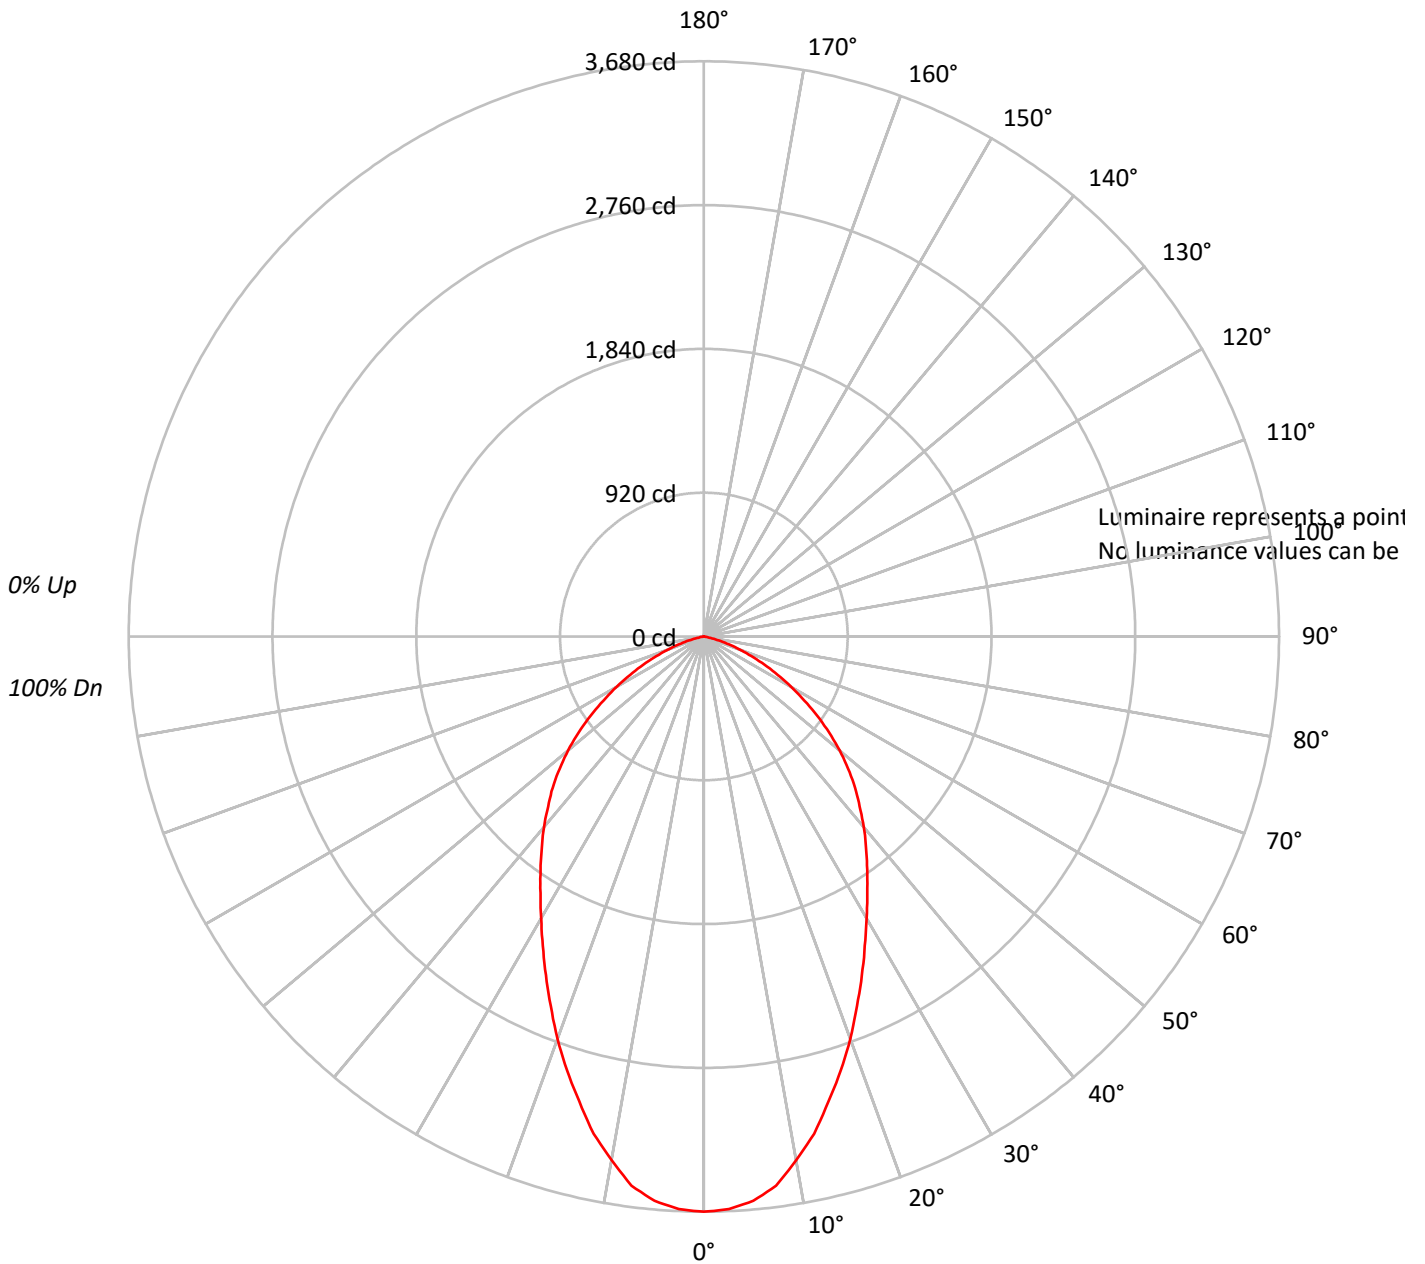



TEST NUMBER: P205422

CATALOG NUMBER: LE\_6B40D010 EC6B30508040 6LBSLI1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	109	105	102	99	101	99	96	97	95	93	94	92	91	89			
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77			
3	95	86	79	74	93	85	78	73	82	76	72	79	75	71	77	73	70	68			
4	88	78	70	64	86	77	69	64	74	68	63	72	67	62	70	65	62	60			
5	82	71	63	57	80	70	62	57	67	61	56	66	60	55	64	59	55	53			
6	76	64	56	51	74	63	56	51	62	55	50	60	54	50	59	53	49	47			
7	71	59	51	46	70	58	51	45	57	50	45	55	49	45	54	49	45	43			
8	67	54	47	41	65	54	46	41	52	46	41	51	45	41	50	45	41	39			
9	63	50	43	38	61	50	43	38	49	42	38	48	42	37	47	41	37	36			
10	59	47	40	35	58	46	39	35	45	39	35	45	39	34	44	38	34	33			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P205422

CATALOG NUMBER: LE\_6B40D010 EC6B30508040 6LBSLI1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	339.1	5.8
10°-20°	863.3	14.8
20°-30°	1100.9	18.9
30°-40°	1141.7	19.6
40°-50°	1052.0	18.0
50°-60°	791.3	13.6
60°-70°	427.2	7.3
70°-80°	114.6	2.0
80°-90°	1.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2303.3	39.5
0°-40°	3445.0	59.1
0°-60°	5288.3	90.7
0°-90°	5831.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5831.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3680	
5°	3624	339
15°	3079	863
25°	2392	1101
35°	1822	1142
45°	1369	1052
55°	886	791
65°	428	427
75°	99	115
85°	0	2
90°	0	



TEST NUMBER: P205422

CATALOG NUMBER: LE\_6B40D010 EC6B30508040 6LBSLI1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3680.1
2.5°	3667.8
5°	3624.4
7.5°	3543.8
10°	3401.2
12.5°	3258.8
15°	3079.1
17.5°	2911.9
20°	2738.4
22.5°	2558.8
25°	2391.5
27.5°	2230.4
30°	2081.6
32.5°	1945.4
35°	1821.5
37.5°	1703.8
40°	1592.2
42.5°	1474.5
45°	1369.2
47.5°	1251.5
50°	1133.8
52.5°	1009.9
55°	886.0
57.5°	762.0
60°	644.4
62.5°	532.8
65°	427.5
67.5°	328.4
70°	241.6
72.5°	167.2
75°	99.1
77.5°	43.4
80°	12.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)