

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203270

Luminaire Tested: **LE_6B40D010 EC6B30509040 6LBMH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203270
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509040 6LBMH1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
MEDIUM DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3312.2 lumens
Efficiency: N/A
Efficacy: 79.2 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct

Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203270
CATALOG NUMBER: LE_6B40D010 EC6B30509040 6LBMH1

Luminous Intensity Polar Plot

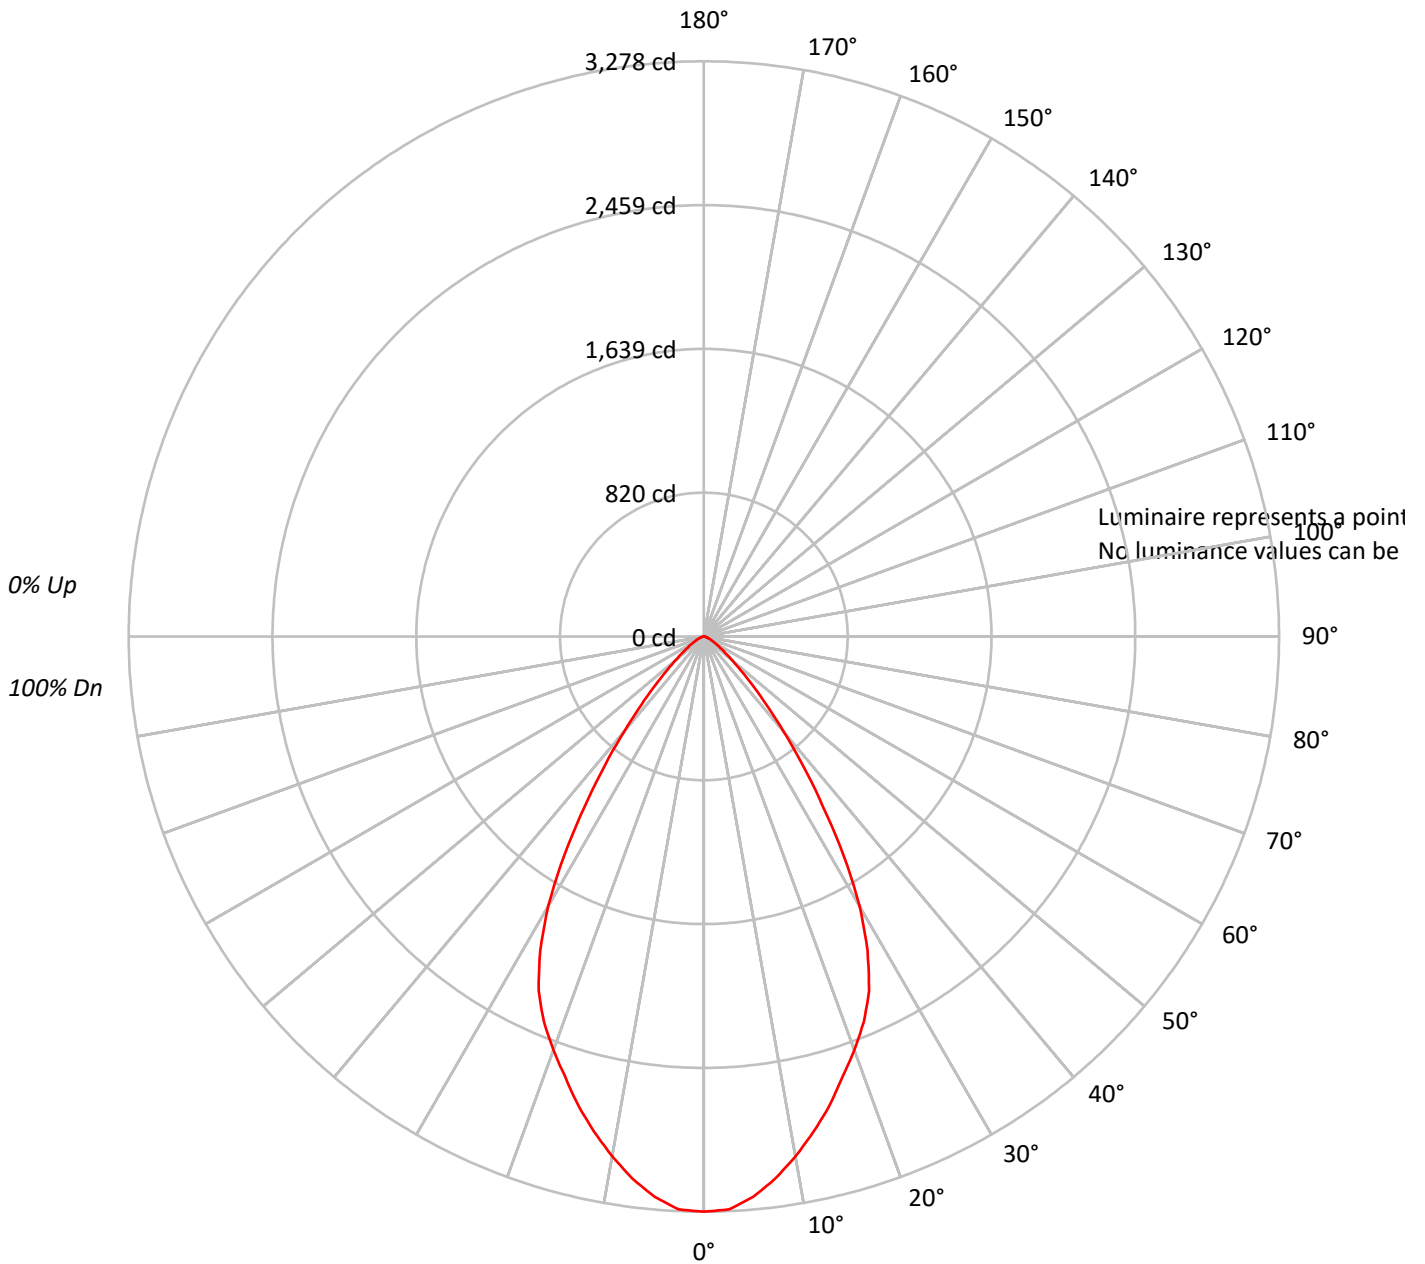



TEST NUMBER: P203270

CATALOG NUMBER: LE_6B40D010 EC6B30509040 6LBMH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92		
2	107	102	97	93	105	100	96	92	97	93	90	94	91	88	91	89	87	85		
3	101	94	88	84	99	92	87	84	90	86	82	87	84	81	85	82	80	78		
4	95	87	81	76	93	86	80	76	84	79	75	82	78	74	80	76	73	72		
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68	66		
6	85	75	69	64	83	75	69	64	73	68	64	72	67	63	70	66	63	61		
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57		
8	76	66	60	55	75	65	59	55	64	59	55	63	58	55	62	58	54	53		
9	72	62	56	51	71	61	55	51	60	55	51	60	55	51	59	54	51	49		
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	48	46		

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203270

CATALOG NUMBER: LE_6B40D010 EC6B30509040 6LBMH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	299.7	9.0
10°-20°	775.3	23.4
20°-30°	1004.6	30.3
30°-40°	745.8	22.5
40°-50°	314.9	9.5
50°-60°	111.8	3.4
60°-70°	43.2	1.3
70°-80°	14.9	0.5
80°-90°	2.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2079.7	62.8
0°-40°	2825.5	85.3
0°-60°	3252.2	98.2
0°-90°	3312.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3312.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3278	
5°	3207	300
15°	2767	775
25°	2228	1005
35°	1182	746
45°	388	315
55°	118	112
65°	43	43
75°	14	15
85°	0	2
90°	0	



TEST NUMBER: P203270

CATALOG NUMBER: LE_6B40D010 EC6B30509040 6LBMH1

CANDELA DISTRIBUTION (FULL):

	0°
0°	3277.8
2.5°	3268.4
5°	3206.9
7.5°	3117.0
10°	3008.1
12.5°	2889.9
15°	2767.0
17.5°	2629.8
20°	2506.9
22.5°	2379.1
25°	2227.8
27.5°	2019.6
30°	1773.8
32.5°	1485.1
35°	1182.5
37.5°	927.0
40°	704.8
42.5°	525.0
45°	387.9
47.5°	283.8
50°	208.1
52.5°	156.1
55°	118.2
57.5°	89.9
60°	71.0
62.5°	52.0
65°	42.6
67.5°	33.1
70°	23.6
72.5°	18.9
75°	14.2
77.5°	9.5
80°	4.8
82.5°	4.8
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)