

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204714

Luminaire Tested: **LE_6B40D010 EC6B30509040 6LBPSMW1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204714
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509040 6LBPSMW1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH PLASTIC MATTE WHITE TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4921.5 lumens
Efficiency: N/A
Efficacy: 117.7 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.34
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204714

CATALOG NUMBER: LE_6B40D010 EC6B30509040 6LBPSMW1

Luminous Intensity Polar Plot

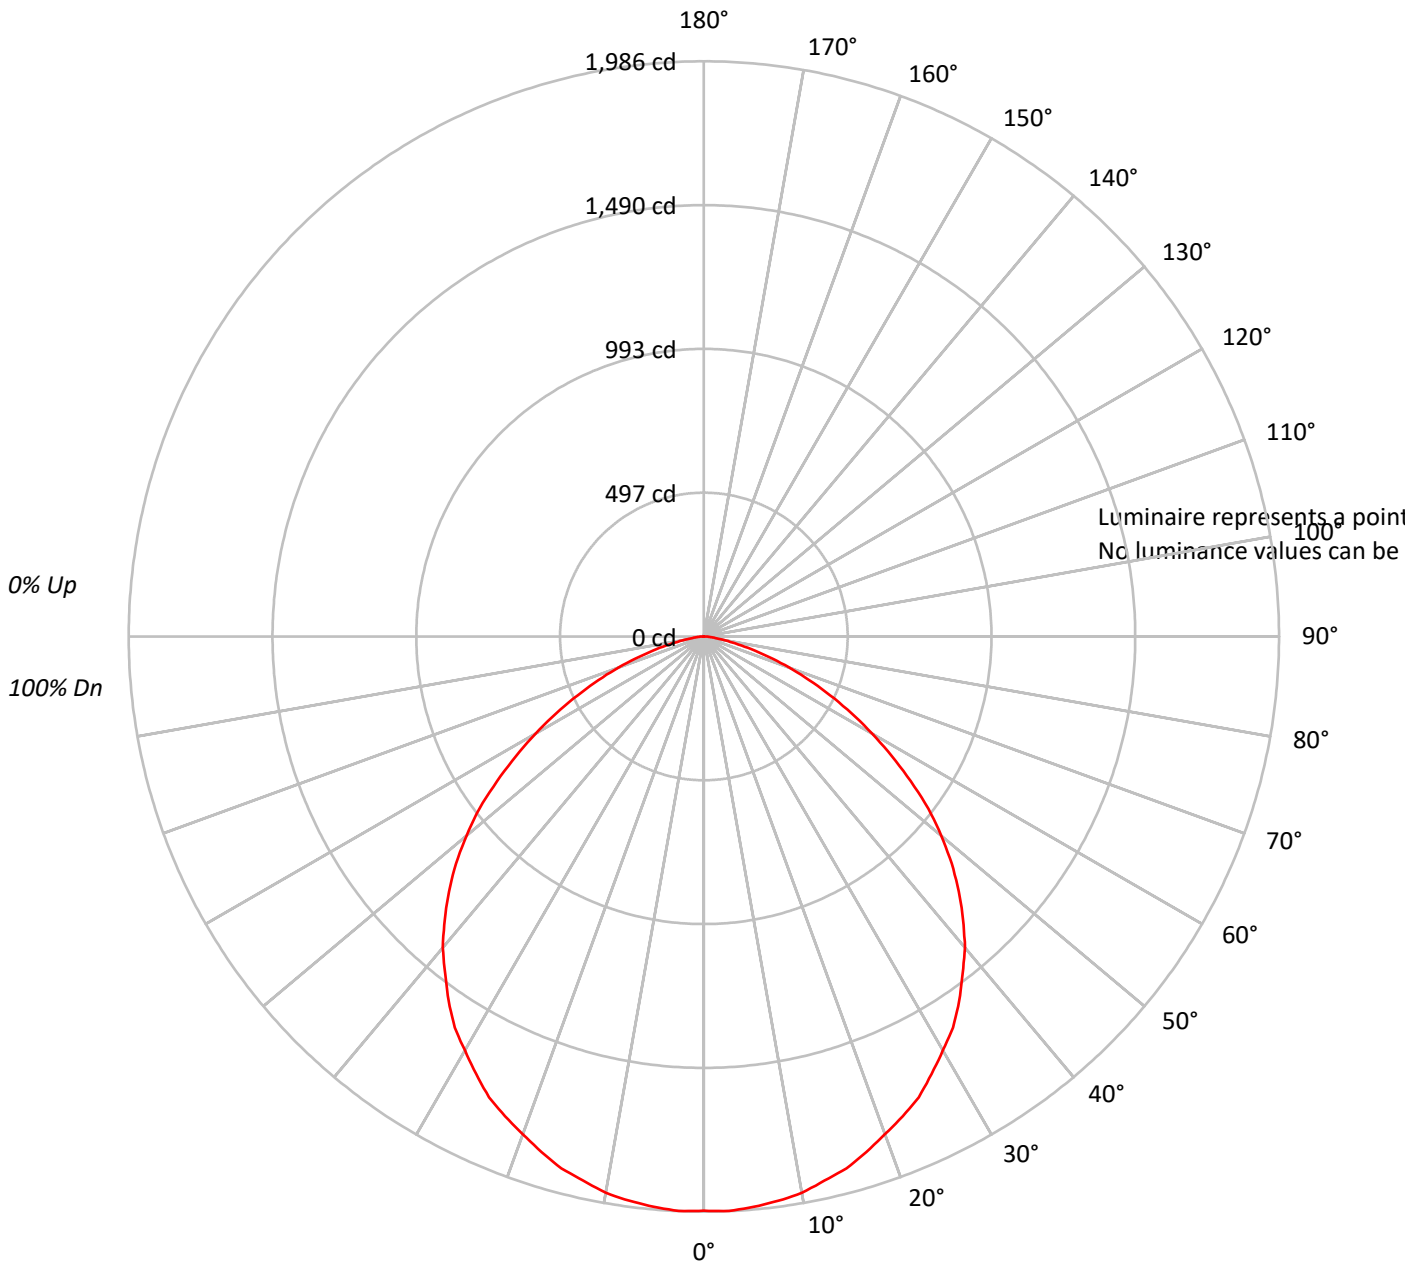



TEST NUMBER: P204714

CATALOG NUMBER: LE_6B40D010 EC6B30509040 6LBPSMW1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	110	106	102	99	107	104	100	97	99	97	94	96	93	91	92	90	88	86				86
2	101	93	87	82	98	92	86	81	88	83	79	85	81	77	82	79	76	74				74
3	93	83	75	69	90	81	74	69	78	72	67	76	70	66	73	69	65	63				63
4	85	74	65	59	83	72	65	59	70	63	58	68	62	57	66	61	56	54				54
5	78	66	58	51	76	65	57	51	63	56	51	61	55	50	59	54	49	47				47
6	73	60	51	45	71	59	51	45	57	50	44	55	49	44	54	48	44	42				42
7	67	54	46	40	66	54	46	40	52	45	40	51	44	39	49	43	39	37				37
8	63	50	41	36	61	49	41	36	48	41	35	46	40	35	45	39	35	33				33
9	59	46	38	32	57	45	37	32	44	37	32	43	36	32	42	36	32	30				30
10	55	42	34	29	54	42	34	29	41	34	29	40	33	29	39	33	29	27				27

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204714

CATALOG NUMBER: LE_6B40D010 EC6B30509040 6LBPSMW1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	187.9	3.8
10°-20°	535.5	10.9
20°-30°	806.5	16.4
30°-40°	959.7	19.5
40°-50°	958.0	19.5
50°-60°	779.1	15.8
60°-70°	479.3	9.7
70°-80°	185.7	3.8
80°-90°	29.8	0.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1530.0	31.1
0°-40°	2489.7	50.6
0°-60°	4226.7	85.9
0°-90°	4921.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4921.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1983	
5°	1977	188
15°	1901	536
25°	1755	807
35°	1537	960
45°	1245	958
55°	872	779
65°	481	479
75°	169	186
85°	23	30
90°	0	



TEST NUMBER: P204714

CATALOG NUMBER: LE_6B40D010 EC6B30509040 6LBPSMW1

CANDELA DISTRIBUTION (FULL):

	0°
0°	1982.9
2.5°	1985.8
5°	1977.0
7.5°	1965.4
10°	1950.8
12.5°	1924.5
15°	1901.2
17.5°	1866.2
20°	1828.2
22.5°	1793.4
25°	1755.4
27.5°	1702.9
30°	1650.4
32.5°	1600.9
35°	1536.8
37.5°	1466.8
40°	1402.6
42.5°	1323.9
45°	1245.1
47.5°	1160.5
50°	1070.1
52.5°	976.9
55°	871.9
57.5°	769.9
60°	670.6
62.5°	574.5
65°	481.1
67.5°	393.6
70°	312.0
72.5°	236.2
75°	169.1
77.5°	110.8
80°	67.1
82.5°	40.9
85°	23.4
87.5°	11.6
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)