

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204192

Luminaire Tested: **LE\_6B40D010 EC6B30508050 6LBSH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204192  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B40D010 EC6B30508050 6LBSH1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH SEMI-SPECULAR CLEAR TRIM  
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57  
W DL3-44.71 W DLE-39.33 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 5630.2 lumens  
Efficiency: N/A  
Efficacy: 134.7 lumens/watt  
Spacing Criteria (0/90/45): 1.06 / 1.06 / 1.17  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct

Input Watts (W): 41.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204192  
CATALOG NUMBER: LE\_6B40D010 EC6B30508050 6LBSH1

### Luminous Intensity Polar Plot

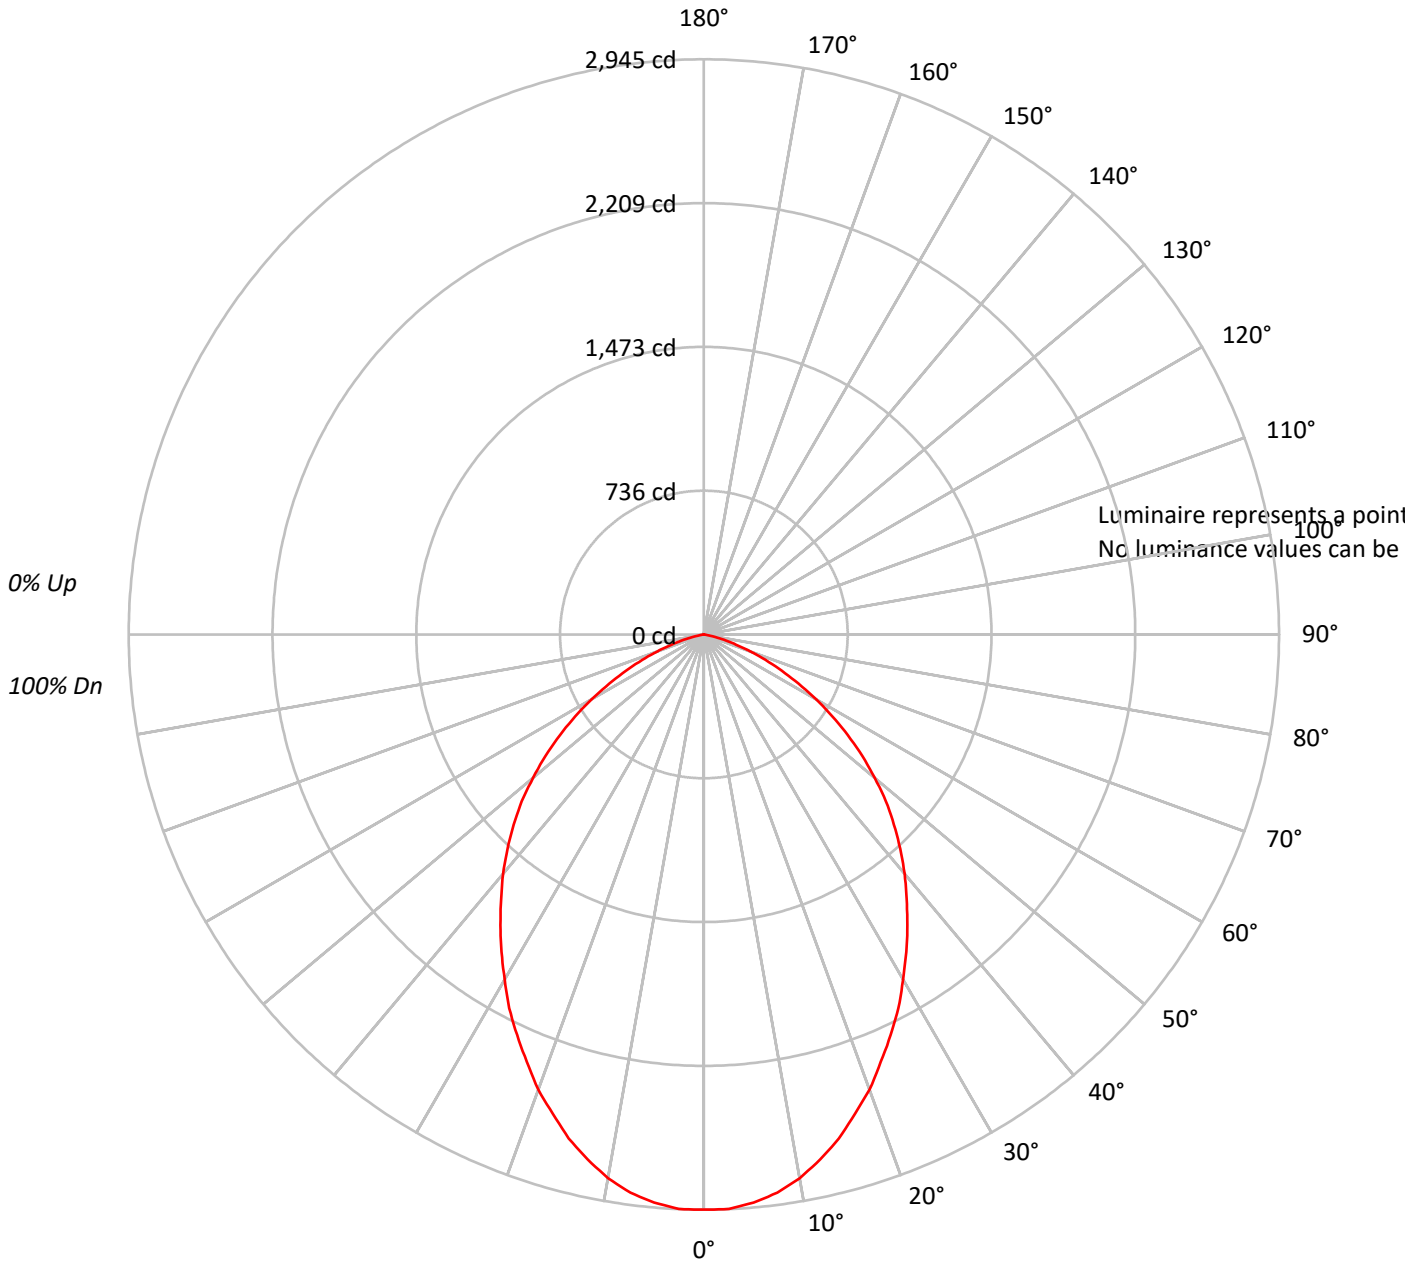



TEST NUMBER: P204192

CATALOG NUMBER: LE\_6B40D010 EC6B30508050 6LBSH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	93	92	90	88			
2	102	96	90	85	100	94	88	84	90	86	82	87	83	80	84	81	79	77			
3	95	85	78	73	92	84	77	72	81	75	71	78	74	70	76	72	69	67			
4	87	77	69	63	85	75	68	63	73	67	62	71	65	61	69	64	60	58			
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51			
6	75	63	55	49	73	62	54	49	60	54	49	59	53	48	57	52	48	46			
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41			
8	65	53	45	40	64	52	45	40	51	44	39	50	44	39	49	43	39	37			
9	61	49	41	36	60	48	41	36	47	40	36	46	40	36	45	40	35	34			
10	58	45	38	33	56	45	38	33	44	37	33	43	37	33	42	37	33	31			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204192

CATALOG NUMBER: LE\_6B40D010 EC6B30508050 6LBSH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	275.8	4.9
10°-20°	749.7	13.3
20°-30°	1041.1	18.5
30°-40°	1136.1	20.2
40°-50°	1059.8	18.8
50°-60°	804.4	14.3
60°-70°	440.4	7.8
70°-80°	121.2	2.2
80°-90°	1.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2066.6	36.7
0°-40°	3202.7	56.9
0°-60°	5066.9	90.0
0°-90°	5630.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5630.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2945	
5°	2920	276
15°	2672	750
25°	2263	1041
35°	1816	1136
45°	1376	1060
55°	899	804
65°	440	440
75°	105	121
85°	0	2
90°	0	



TEST NUMBER: P204192

CATALOG NUMBER: LE\_6B40D010 EC6B30508050 6LBSH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2944.6
2.5°	2944.6
5°	2919.8
7.5°	2882.6
10°	2826.8
12.5°	2752.4
15°	2671.9
17.5°	2572.6
20°	2479.6
22.5°	2368.1
25°	2262.8
27.5°	2157.2
30°	2039.5
32.5°	1927.9
35°	1816.4
37.5°	1704.8
40°	1599.4
42.5°	1487.8
45°	1376.2
47.5°	1264.6
50°	1140.6
52.5°	1022.9
55°	898.9
57.5°	781.1
60°	663.2
62.5°	545.5
65°	440.1
67.5°	341.0
70°	254.1
72.5°	173.6
75°	105.4
77.5°	49.6
80°	12.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)