

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203162

Luminaire Tested: **LE_6B40D010 EC6B30508050 6LBWMW1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203162
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30508050 6LBWMW1
Description: PORTFOLIO 6 INCH 60 DEGREE CUTOFF RECESSED DOWNLIGHT
WIDE DISTRIBUTION WITH MATTE WHITE TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5110.0 lumens
Efficiency: N/A
Efficacy: 122.2 lumens/watt
Spacing Criteria (0/90/45): 1.13 / 1.13 / 1.15
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203162

CATALOG NUMBER: LE_6B40D010 EC6B30508050 6LBWMW1

Luminous Intensity Polar Plot

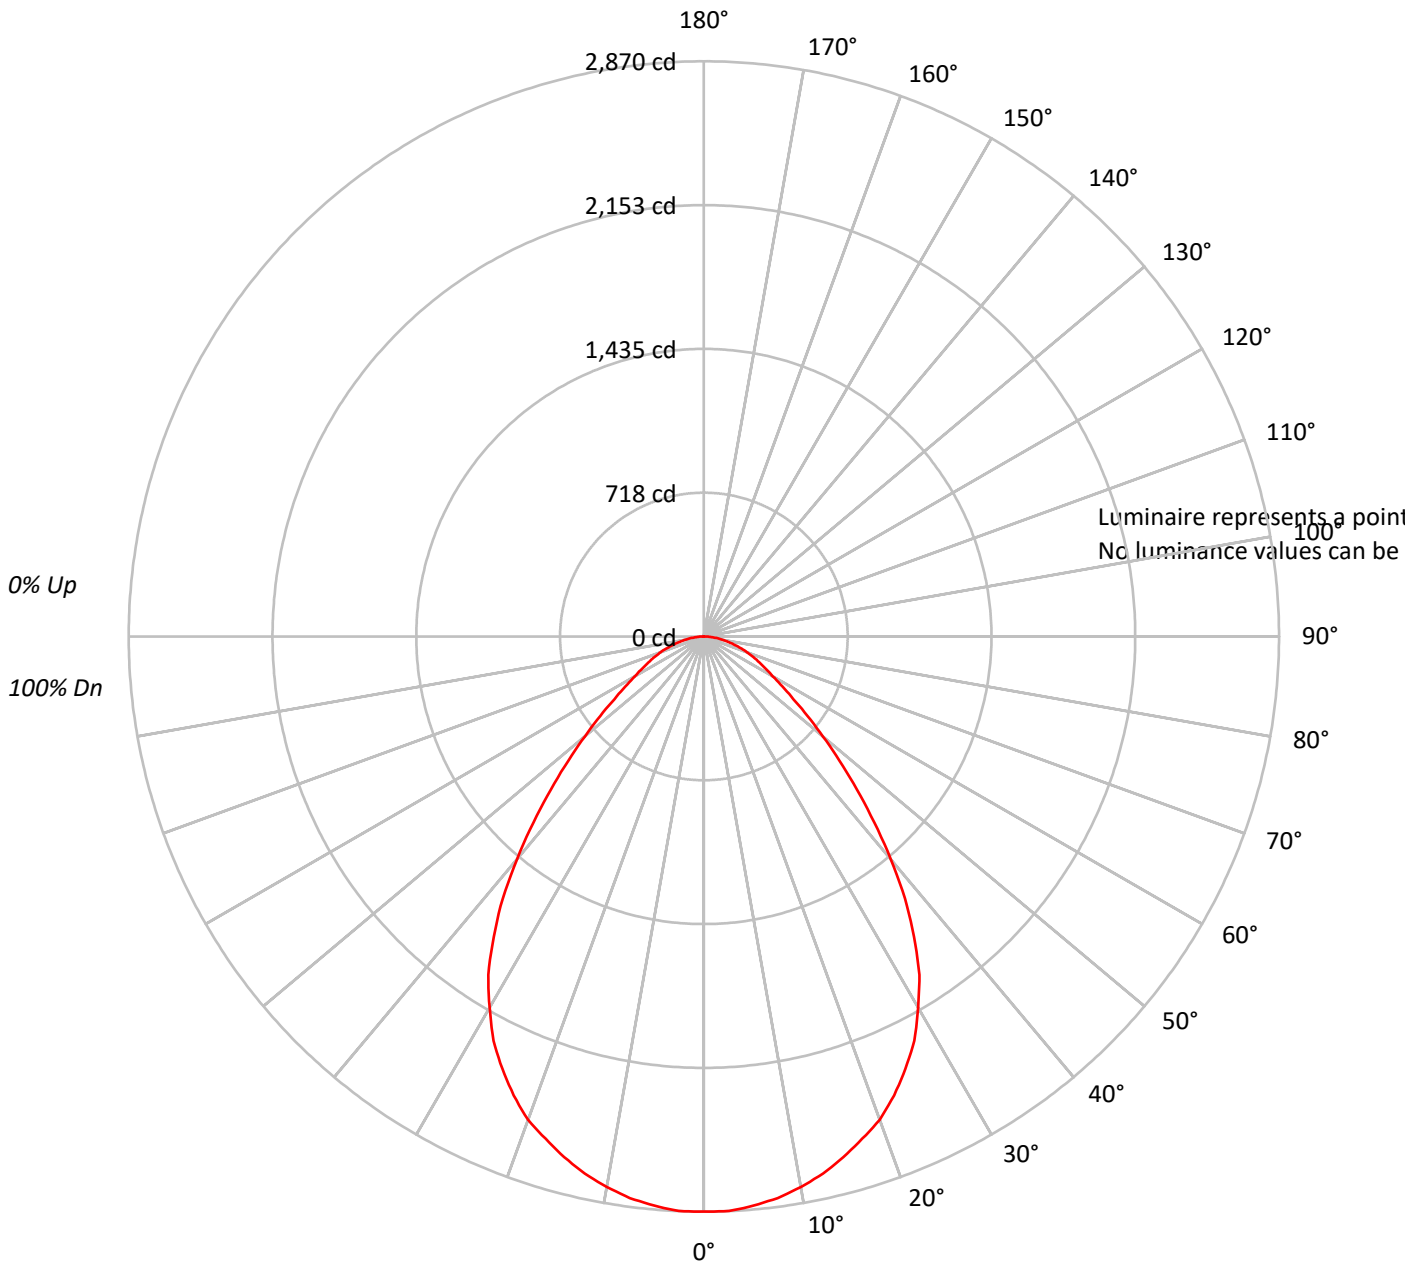



TEST NUMBER: P203162

CATALOG NUMBER: LE_6B40D010 EC6B30508050 6LBWMW1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|-----|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|----|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 |
| RC | 80 | | | | | | | | | 70 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | 100 | | | | | | | | | | | | | | | | |
| 1 | 111 | 107 | 104 | 100 | 108 | 105 | 102 | 99 | 101 | 98 | 96 | 97 | 95 | 93 | 93 | 92 | 90 | 88 | | | | | | | | | | | | 88 | | | | | | | | | | | | | | | | |
| 2 | 103 | 96 | 90 | 86 | 100 | 94 | 89 | 85 | 91 | 86 | 83 | 88 | 84 | 81 | 85 | 82 | 79 | 77 | | | | | | | | | | | | 77 | | | | | | | | | | | | | | | | |
| 3 | 95 | 86 | 80 | 74 | 93 | 85 | 79 | 74 | 82 | 77 | 72 | 80 | 75 | 71 | 77 | 73 | 70 | 68 | | | | | | | | | | | | 68 | | | | | | | | | | | | | | | | |
| 4 | 89 | 78 | 71 | 65 | 86 | 77 | 70 | 65 | 75 | 69 | 64 | 72 | 67 | 63 | 70 | 66 | 62 | 60 | | | | | | | | | | | | 60 | | | | | | | | | | | | | | | | |
| 5 | 82 | 71 | 64 | 58 | 80 | 70 | 63 | 58 | 68 | 62 | 57 | 66 | 61 | 56 | 65 | 60 | 56 | 54 | | | | | | | | | | | | 54 | | | | | | | | | | | | | | | | |
| 6 | 77 | 65 | 57 | 52 | 75 | 64 | 57 | 52 | 63 | 56 | 51 | 61 | 55 | 51 | 60 | 54 | 50 | 49 | | | | | | | | | | | | 49 | | | | | | | | | | | | | | | | |
| 7 | 72 | 60 | 52 | 47 | 70 | 59 | 52 | 47 | 58 | 51 | 46 | 56 | 50 | 46 | 55 | 50 | 46 | 44 | | | | | | | | | | | | 44 | | | | | | | | | | | | | | | | |
| 8 | 67 | 55 | 48 | 42 | 66 | 55 | 47 | 42 | 53 | 47 | 42 | 52 | 46 | 42 | 51 | 46 | 42 | 40 | | | | | | | | | | | | 40 | | | | | | | | | | | | | | | | |
| 9 | 63 | 51 | 44 | 39 | 62 | 51 | 44 | 39 | 50 | 43 | 39 | 49 | 43 | 38 | 48 | 42 | 38 | 37 | | | | | | | | | | | | 37 | | | | | | | | | | | | | | | | |
| 10 | 60 | 48 | 40 | 36 | 58 | 47 | 40 | 36 | 46 | 40 | 36 | 45 | 40 | 35 | 45 | 39 | 35 | 34 | | | | | | | | | | | | 34 | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203162

CATALOG NUMBER: LE_6B40D010 EC6B30508050 6LBWMW1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 270.2 | 5.3 |
| 10°-20° | 757.9 | 14.8 |
| 20°-30° | 1092.0 | 21.4 |
| 30°-40° | 1133.7 | 22.2 |
| 40°-50° | 838.2 | 16.4 |
| 50°-60° | 500.7 | 9.8 |
| 60°-70° | 304.3 | 6.0 |
| 70°-80° | 166.7 | 3.3 |
| 80°-90° | 46.3 | 0.9 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 2120.1 | 41.5 |
| 0°-40° | 3253.8 | 63.7 |
| 0°-60° | 4592.7 | 89.9 |
| 0°-90° | 5110.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 5110.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2870 | |
| 5° | 2851 | 270 |
| 15° | 2690 | 758 |
| 25° | 2380 | 1092 |
| 35° | 1828 | 1134 |
| 45° | 1078 | 838 |
| 55° | 545 | 501 |
| 65° | 304 | 304 |
| 75° | 155 | 167 |
| 85° | 37 | 46 |
| 90° | 0 | |



TEST NUMBER: P203162

CATALOG NUMBER: LE_6B40D010 EC6B30508050 6LBWMW1

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 2869.5 |
| 2.5° | 2869.5 |
| 5° | 2851.0 |
| 7.5° | 2826.1 |
| 10° | 2789.0 |
| 12.5° | 2745.6 |
| 15° | 2689.9 |
| 17.5° | 2627.9 |
| 20° | 2565.9 |
| 22.5° | 2479.1 |
| 25° | 2379.9 |
| 27.5° | 2274.6 |
| 30° | 2138.2 |
| 32.5° | 2001.9 |
| 35° | 1828.4 |
| 37.5° | 1648.6 |
| 40° | 1450.2 |
| 42.5° | 1258.1 |
| 45° | 1078.4 |
| 47.5° | 917.2 |
| 50° | 774.8 |
| 52.5° | 650.8 |
| 55° | 545.4 |
| 57.5° | 464.9 |
| 60° | 396.6 |
| 62.5° | 347.1 |
| 65° | 303.8 |
| 67.5° | 266.5 |
| 70° | 229.4 |
| 72.5° | 192.1 |
| 75° | 155.0 |
| 77.5° | 124.0 |
| 80° | 93.0 |
| 82.5° | 68.1 |
| 85° | 37.1 |
| 87.5° | 18.6 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)