

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P205124

Luminaire Tested: **LE_6B40D010 EC6B30509050 6LBMLI1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P205124
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509050 6LBML1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
MEDIUM DISTRIBUTION WITH SPECULAR CLEAR TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4072.2 lumens
Efficiency: N/A
Efficacy: 97.4 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P205124

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBMLI1

Luminous Intensity Polar Plot

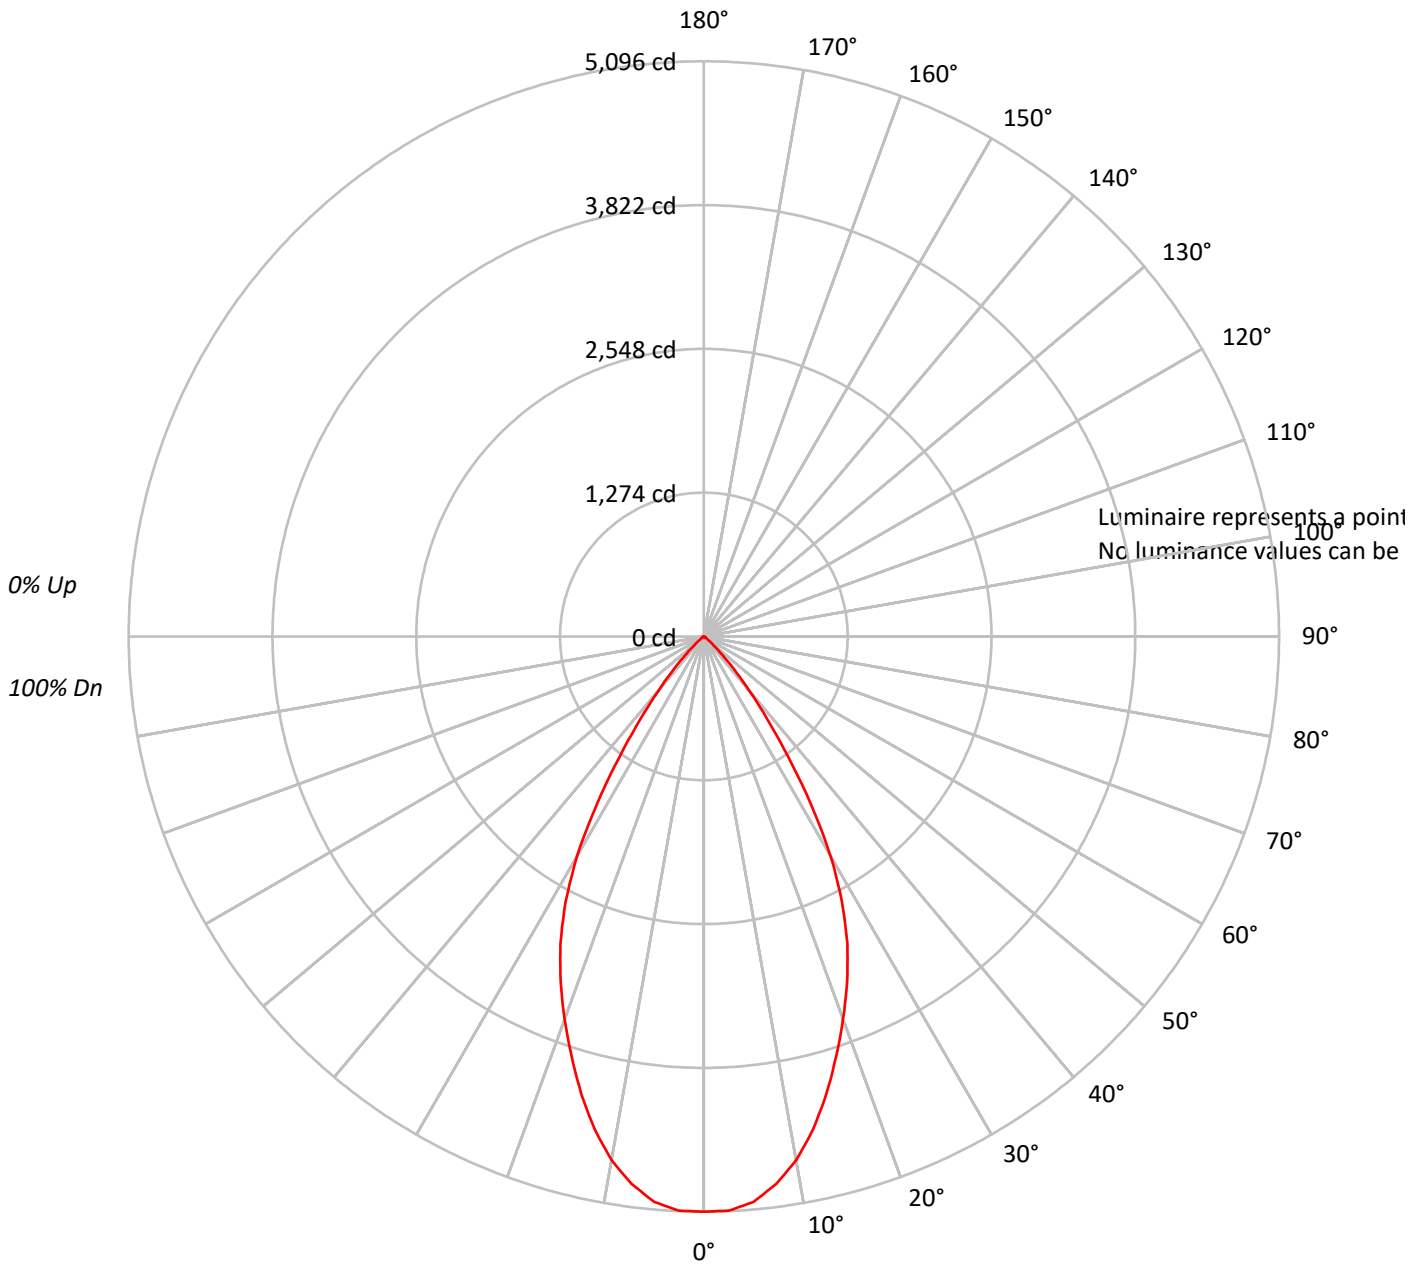



TEST NUMBER: P205124

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBMLI1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94			
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88			
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82			
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76			
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71			
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67			
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63			
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59			
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P205124

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBMLI1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	469.5	11.5
10°-20°	1168.8	28.7
20°-30°	1358.7	33.4
30°-40°	832.1	20.4
40°-50°	206.6	5.1
50°-60°	24.2	0.6
60°-70°	9.0	0.2
70°-80°	3.4	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2997.0	73.6
0°-40°	3829.1	94.0
0°-60°	4059.9	99.7
0°-90°	4072.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4072.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5096	
5°	5028	469
15°	4195	1169
25°	3007	1359
35°	1303	832
45°	229	207
55°	21	24
65°	10	9
75°	5	3
85°	0	0
90°	0	



TEST NUMBER: P205124

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBMLI1

CANDELA DISTRIBUTION (FULL):

0°	
0°	5096.2
2.5°	5091.0
5°	5028.5
7.5°	4893.0
10°	4710.6
12.5°	4471.0
15°	4194.8
17.5°	3897.8
20°	3606.0
22.5°	3314.1
25°	3006.8
27.5°	2652.4
30°	2245.9
32.5°	1771.8
35°	1302.8
37.5°	917.1
40°	625.2
42.5°	390.9
45°	229.2
47.5°	130.2
50°	67.8
52.5°	31.2
55°	20.9
57.5°	15.6
60°	15.6
62.5°	10.4
65°	10.4
67.5°	5.2
70°	5.2
72.5°	5.2
75°	5.2
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)