

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P203374

Luminaire Tested: **LE_6B40D010 EC6B30509050 6LBMWH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P203374
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509050 6LBMWH1
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT
MEDIUM DISTRIBUTION WITH WHEAT TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3592.6 lumens
Efficiency: N/A
Efficacy: 85.9 lumens/watt
Spacing Criteria (0/90/45): 0.83 / 0.83 / 0.85
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P203374

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBMWH1

Luminous Intensity Polar Plot

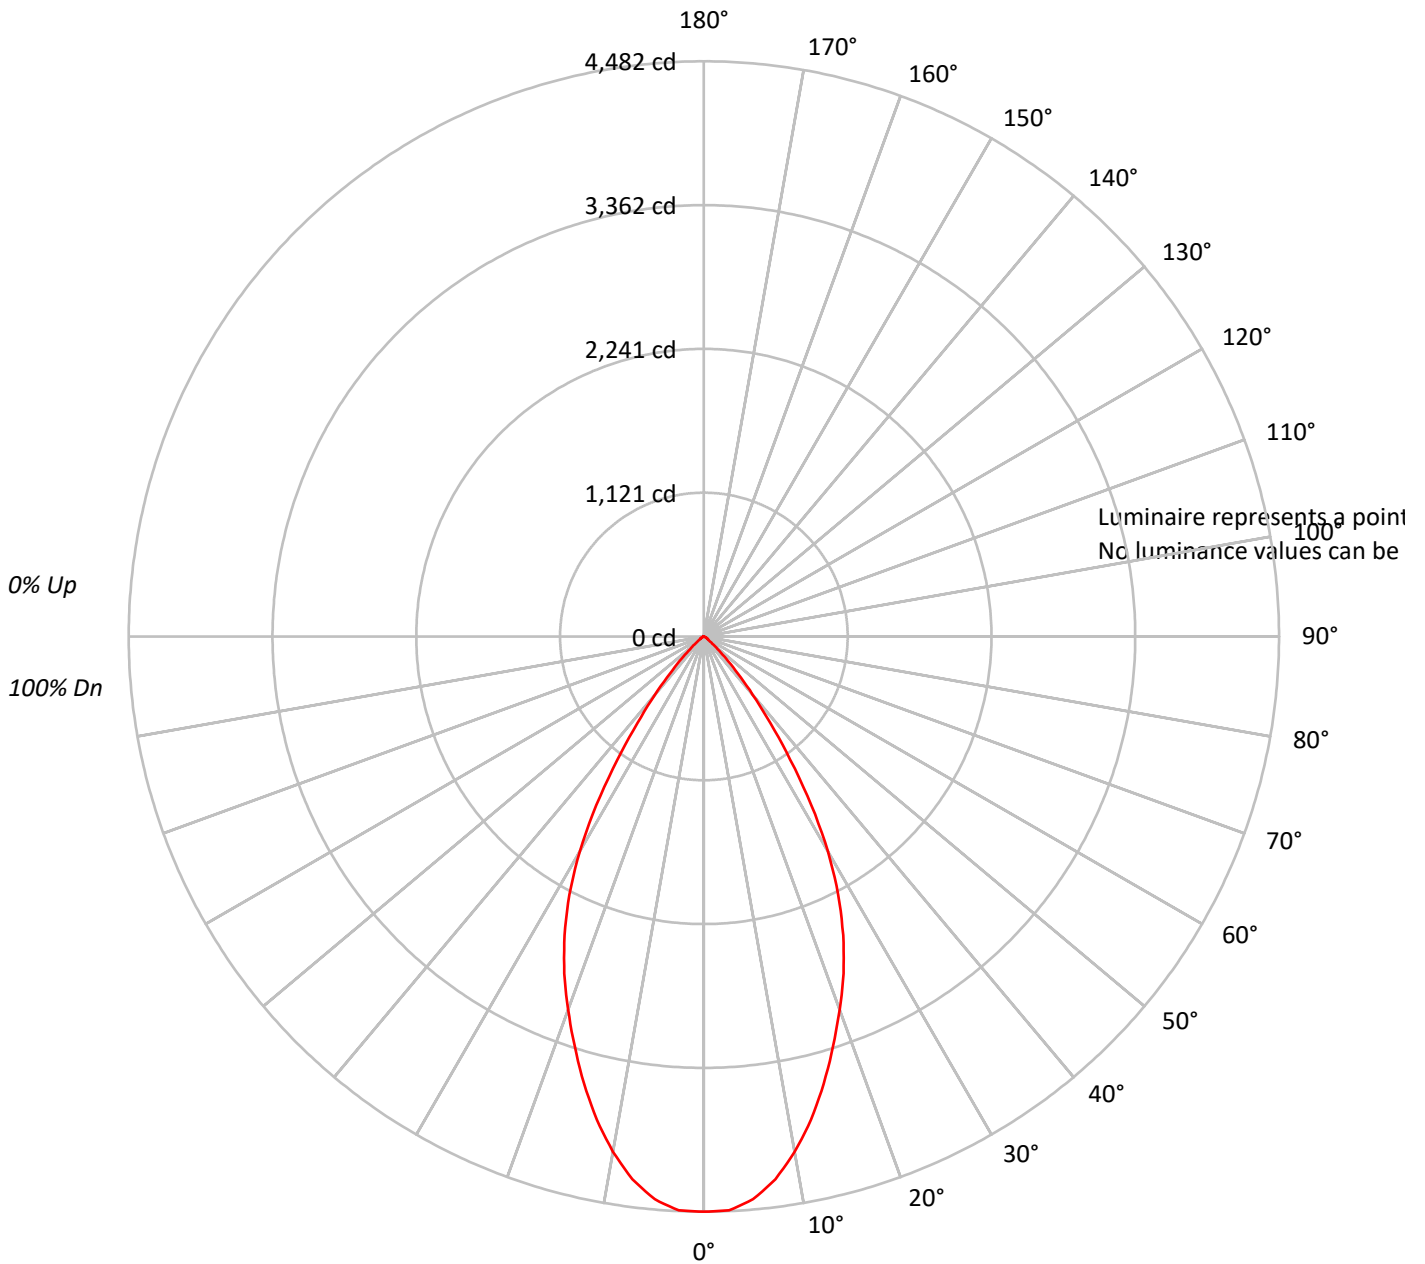



TEST NUMBER: P203374

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBMWH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	92	91	89	87			
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	88	85	83	81			
4	97	90	85	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76			
5	93	84	79	74	91	83	78	74	82	77	73	80	76	73	78	75	72	71			
6	88	79	73	69	87	78	73	69	77	72	68	76	71	68	74	70	67	66			
7	84	75	69	64	82	74	68	64	73	68	64	71	67	64	70	66	63	62			
8	80	70	64	60	78	70	64	60	69	64	60	68	63	60	67	62	59	58			
9	76	66	61	57	75	66	60	57	65	60	56	64	59	56	63	59	56	55			
10	72	63	57	53	71	62	57	53	62	57	53	61	56	53	60	56	53	52			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P203374

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBMWH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	409.7	11.4
10°-20°	1005.9	28.0
20°-30°	1163.8	32.4
30°-40°	743.9	20.7
40°-50°	211.0	5.9
50°-60°	37.7	1.0
60°-70°	15.4	0.4
70°-80°	5.3	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2579.4	71.8
0°-40°	3323.3	92.5
0°-60°	3572.0	99.4
0°-90°	3592.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3592.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4482	
5°	4402	410
15°	3607	1006
25°	2568	1164
35°	1174	744
45°	245	211
55°	35	38
65°	15	15
75°	5	5
85°	0	0
90°	0	



TEST NUMBER: P203374

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBMWH1

CANDELA DISTRIBUTION (FULL):

	0°
0°	4481.8
2.5°	4476.8
5°	4401.9
7.5°	4266.9
10°	4077.0
12.5°	3857.2
15°	3607.4
17.5°	3347.6
20°	3092.8
22.5°	2843.0
25°	2568.1
27.5°	2268.4
30°	1933.6
32.5°	1558.9
35°	1174.1
37.5°	849.4
40°	589.6
42.5°	389.8
45°	244.9
47.5°	144.9
50°	85.0
52.5°	50.0
55°	35.0
57.5°	30.0
60°	25.0
62.5°	20.0
65°	15.0
67.5°	10.0
70°	10.0
72.5°	5.0
75°	5.0
77.5°	5.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)