

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204404

Luminaire Tested: **LE_6B40D010 EC6B30509050 6LBSGPH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204404
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B40D010 EC6B30509050 6LBSGPH1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH GRAPHITE HAZE TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4348.6 lumens
Efficiency: N/A
Efficacy: 104.0 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.26
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204404

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBSGPH1

Luminous Intensity Polar Plot

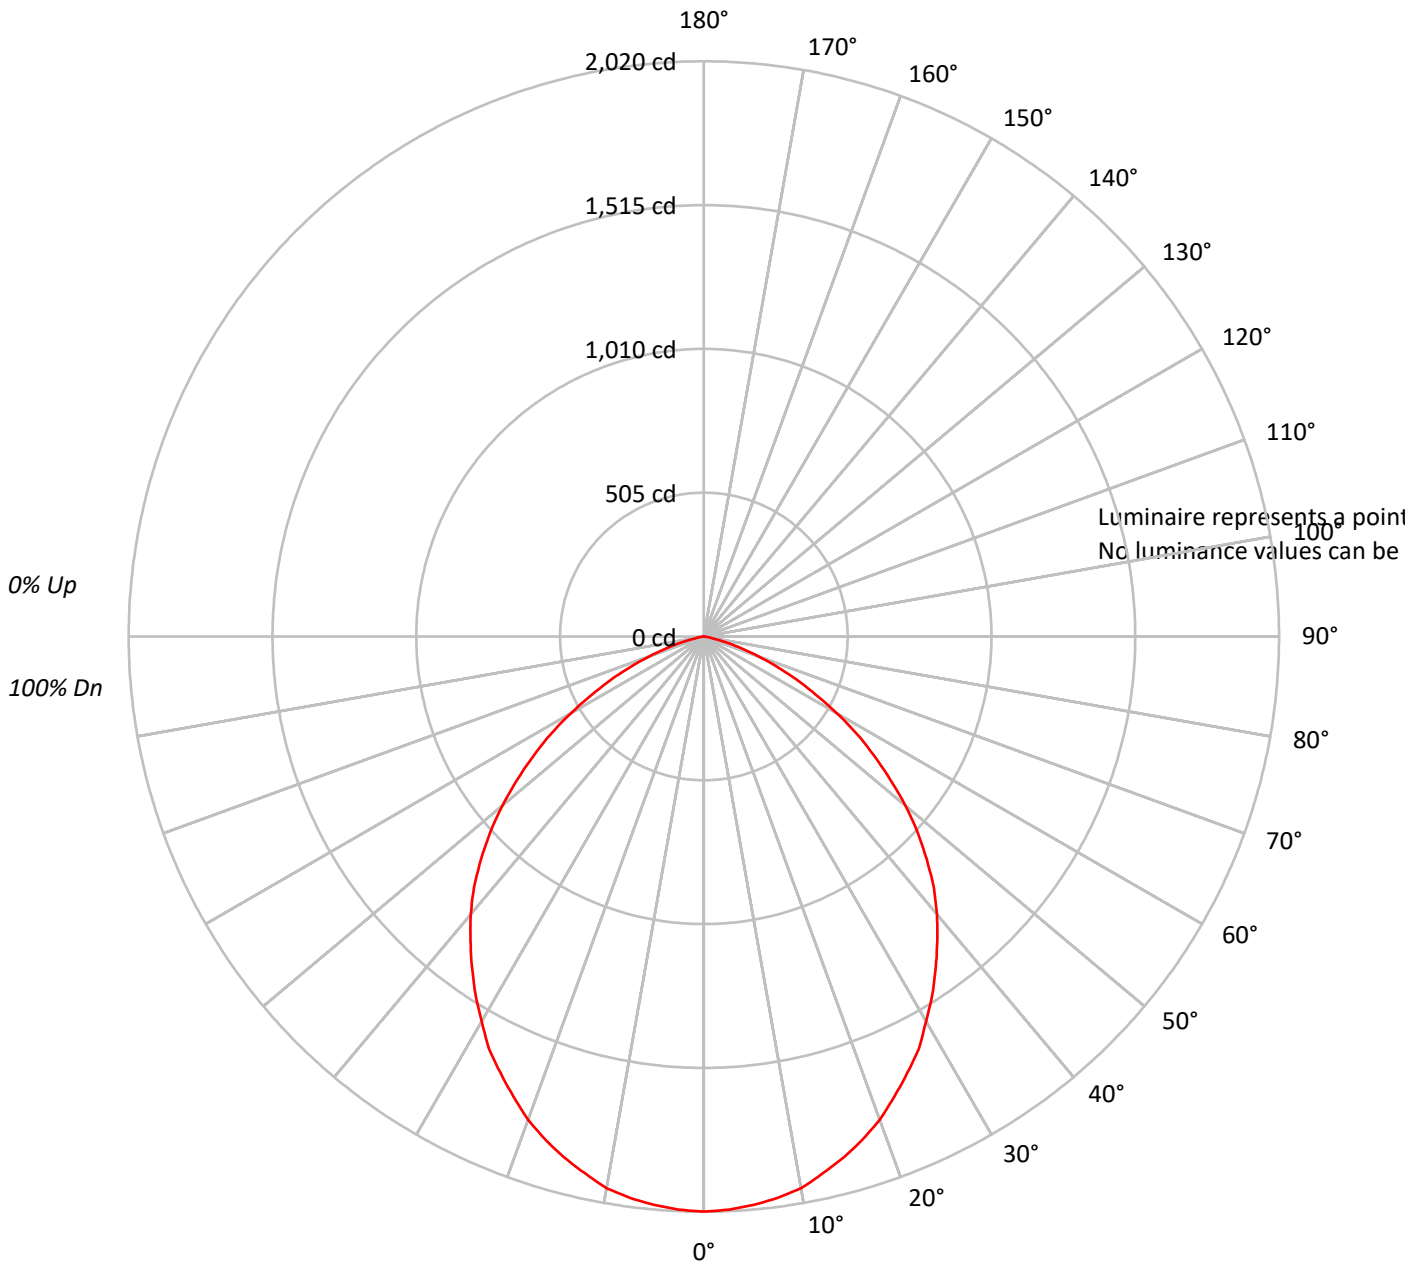



TEST NUMBER: P204404

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBSGPH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	111	107	103	100	108	105	102	99	101	98	96	97	95	93	93	91	90	88			88
2	102	95	89	84	100	93	88	83	90	85	82	87	83	80	84	81	78	76			76
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66			66
4	87	76	68	62	85	75	67	62	72	66	61	70	65	60	68	63	59	57			57
5	80	68	60	54	78	67	60	54	65	59	53	63	58	53	62	56	52	50			50
6	74	62	54	48	73	61	53	48	59	52	47	58	52	47	56	51	47	45			45
7	69	57	48	43	68	56	48	43	54	47	42	53	47	42	52	46	42	40			40
8	65	52	44	38	63	51	44	38	50	43	38	49	42	38	48	42	38	36			36
9	60	48	40	35	59	47	40	35	46	39	35	45	39	34	44	38	34	32			32
10	57	44	37	32	56	44	36	32	43	36	31	42	36	31	41	35	31	30			30

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204404

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBSGPH1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	190.1	4.4
10°-20°	533.8	12.3
20°-30°	778.5	17.9
30°-40°	887.8	20.4
40°-50°	851.6	19.6
50°-60°	652.2	15.0
60°-70°	357.9	8.2
70°-80°	95.2	2.2
80°-90°	1.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1502.5	34.6
0°-40°	2390.3	55.0
0°-60°	3894.1	89.5
0°-90°	4348.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4348.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2020	
5°	2004	190
15°	1894	534
25°	1691	779
35°	1420	888
45°	1106	852
55°	731	652
65°	360	358
75°	84	95
85°	0	1
90°	0	



TEST NUMBER: P204404

CATALOG NUMBER: LE_6B40D010 EC6B30509050 6LBSGPH1

CANDELA DISTRIBUTION (FULL):

	0°
0°	2019.8
2.5°	2014.5
5°	2004.0
7.5°	1988.4
10°	1967.5
12.5°	1931.0
15°	1894.5
17.5°	1852.8
20°	1805.8
22.5°	1748.4
25°	1690.9
27.5°	1633.5
30°	1560.4
32.5°	1492.6
35°	1419.5
37.5°	1346.5
40°	1273.4
42.5°	1195.1
45°	1106.4
47.5°	1017.6
50°	923.8
52.5°	824.6
55°	730.6
57.5°	636.8
60°	537.5
62.5°	443.6
65°	360.1
67.5°	276.6
70°	203.5
72.5°	135.8
75°	83.5
77.5°	36.5
80°	10.5
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)