

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204522

Luminaire Tested: **LE_6B50D010R EC6B30509730 6LBSB1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P204522
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LE_6B50D010R EC6B30509730 6LBSB1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH SPECULAR BLACK TRIM
SINGLE DRIVER D010TE
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4565.8 lumens
Efficiency: N/A
Efficacy: 77.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.3
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 58.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P204522

CATALOG NUMBER: LE_6B50D010R EC6B30509730 6LBSB1

Luminous Intensity Polar Plot

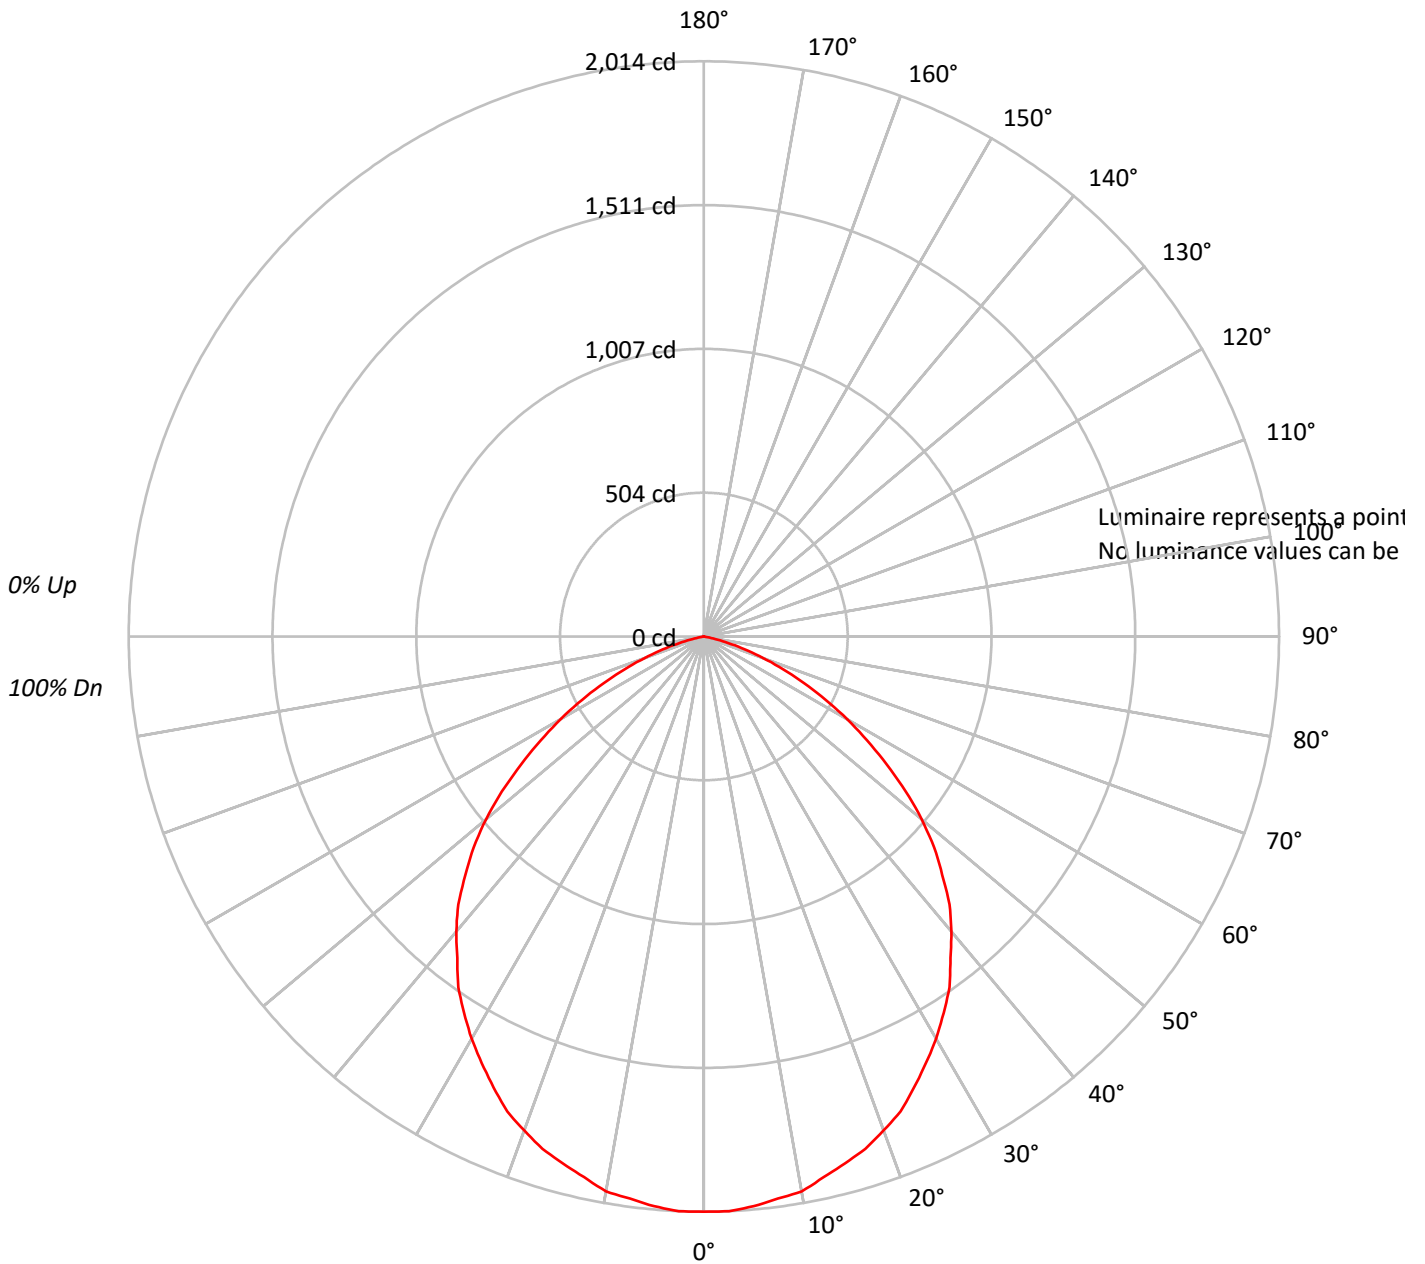



TEST NUMBER: P204522

CATALOG NUMBER: LE_6B50D010R EC6B30509730 6LBSB1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	107	103	100	108	105	101	98	100	98	95	97	94	93	93	91	90	88																			
2	102	95	89	84	100	93	88	83	90	85	81	86	83	79	84	80	78	76																			
3	94	84	77	72	91	83	76	71	80	74	70	77	73	68	75	71	67	65																			
4	86	76	68	62	84	74	67	61	72	65	60	70	64	60	68	63	59	57																			
5	80	68	60	54	78	67	59	53	65	58	53	63	57	52	61	56	52	50																			
6	74	62	53	47	72	61	53	47	59	52	47	57	51	46	56	50	46	44																			
7	69	56	48	42	67	55	48	42	54	47	42	52	46	41	51	45	41	39																			
8	64	51	43	38	63	51	43	38	49	42	37	48	42	37	47	41	37	35																			
9	60	47	39	34	59	47	39	34	46	39	34	45	38	34	44	38	34	32																			
10	56	44	36	31	55	43	36	31	42	36	31	41	35	31	40	35	31	29																			

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P204522

CATALOG NUMBER: LE_6B50D010R EC6B30509730 6LBSB1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	190.1	4.2
10°-20°	539.4	11.8
20°-30°	802.4	17.6
30°-40°	933.7	20.4
40°-50°	910.0	19.9
50°-60°	700.0	15.3
60°-70°	387.0	8.5
70°-80°	102.5	2.2
80°-90°	0.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1531.8	33.6
0°-40°	2465.5	54.0
0°-60°	4075.5	89.3
0°-90°	4565.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4565.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2014	
5°	2002	190
15°	1910	539
25°	1742	802
35°	1499	934
45°	1181	910
55°	781	700
65°	388	387
75°	87	103
85°	0	1
90°	0	



TEST NUMBER: P204522

CATALOG NUMBER: LE_6B50D010R EC6B30509730 6LBSB1

CANDELA DISTRIBUTION (FULL):

	0°
0°	2014.1
2.5°	2014.1
5°	2002.5
7.5°	1985.1
10°	1973.6
12.5°	1938.9
15°	1909.9
17.5°	1881.0
20°	1840.5
22.5°	1800.0
25°	1742.1
27.5°	1684.2
30°	1626.4
32.5°	1562.6
35°	1499.0
37.5°	1418.0
40°	1348.5
42.5°	1273.2
45°	1180.6
47.5°	1093.9
50°	995.5
52.5°	891.2
55°	781.4
57.5°	677.1
60°	578.8
62.5°	480.4
65°	387.8
67.5°	301.0
70°	219.9
72.5°	150.5
75°	86.9
77.5°	40.5
80°	5.8
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)