

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P204824

Luminaire Tested: **LE\_6B50D010R EC6B30508040 6LBCSMW1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P204824  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LE\_6B50D010R EC6B30508040 6LBCSMW1  
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT  
SHALLOW DISTRIBUTION WITH CAST MATTE WHITE TRIM  
SINGLE DRIVER D010TE  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 7601.4 lumens  
Efficiency: N/A  
Efficacy: 129.3 lumens/watt  
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.33  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 58.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P204824

CATALOG NUMBER: LE\_6B50D010R EC6B30508040 6LBCSMW1

### Luminous Intensity Polar Plot

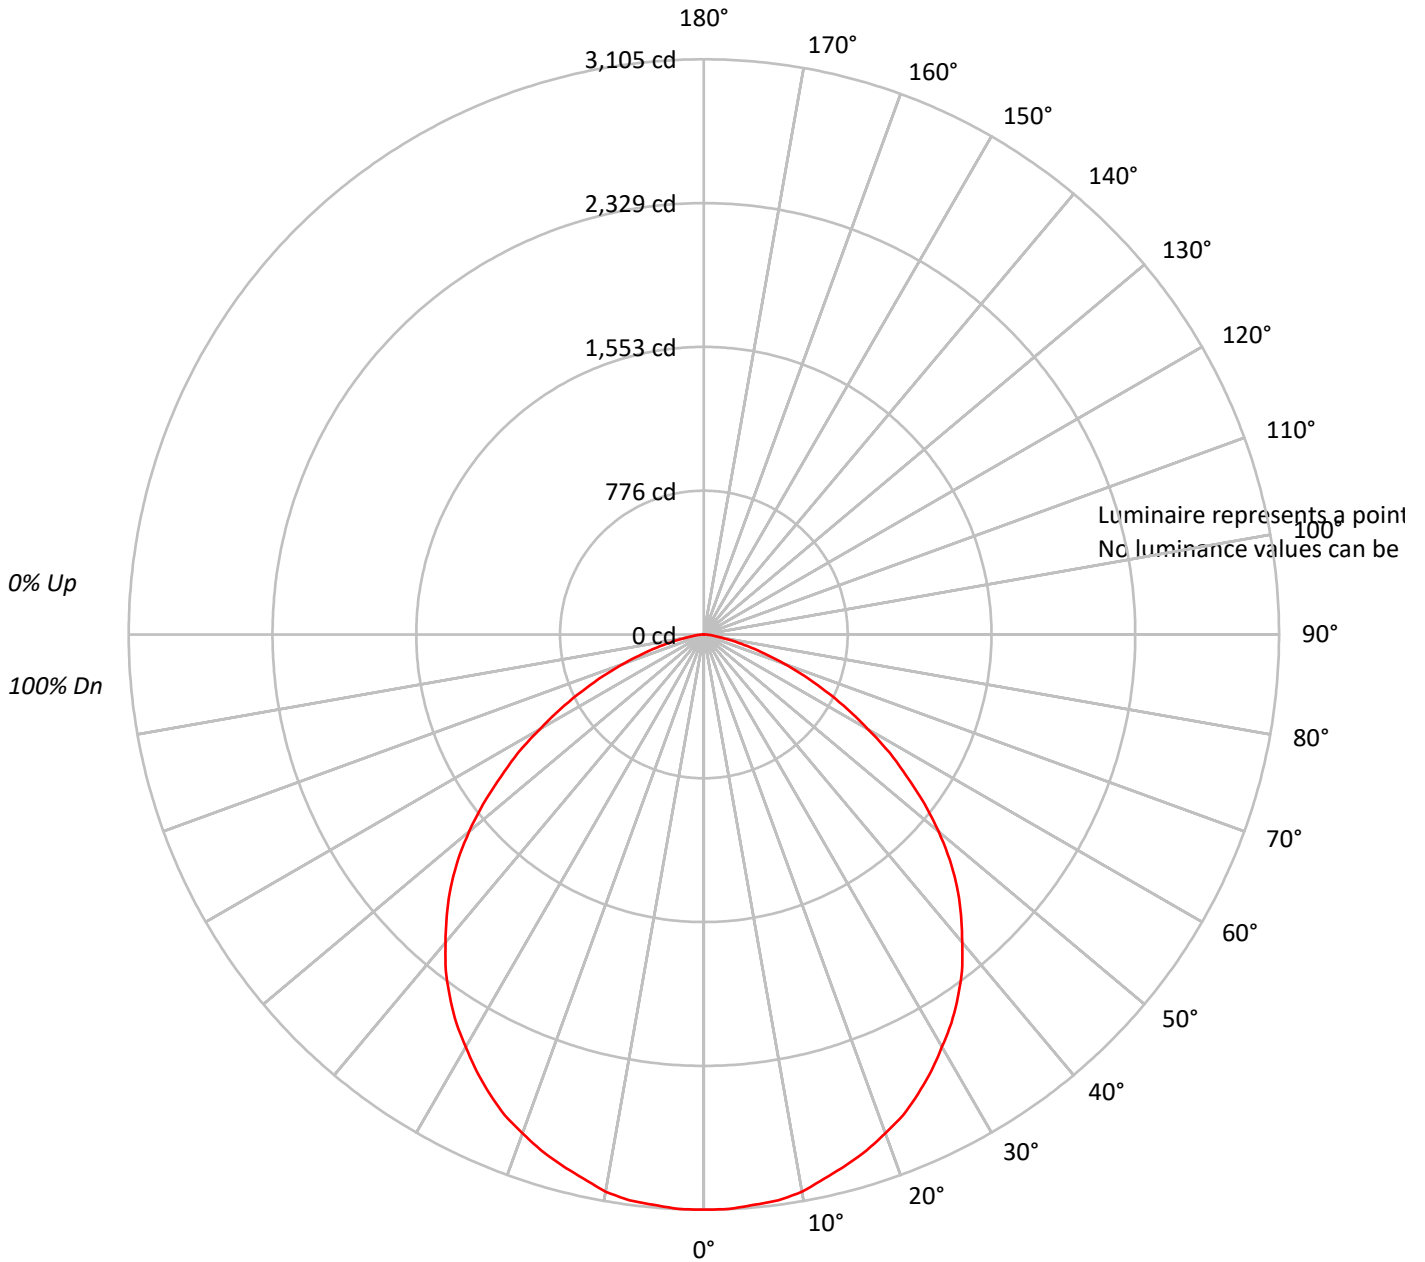



TEST NUMBER: P204824

CATALOG NUMBER: LE\_6B50D010R EC6B30508040 6LBSCMW1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	110	106	102	99	108	104	100	97	100	97	94	96	93	91	92	90	89	87																			
2	101	94	87	82	99	92	86	81	88	84	79	85	81	78	82	79	76	74																			
3	93	83	75	70	90	81	74	69	79	73	68	76	71	67	73	69	65	63																			
4	85	74	66	60	83	73	65	59	70	64	58	68	62	58	66	61	57	55																			
5	79	66	58	52	77	65	57	51	63	56	51	61	55	50	60	54	50	48																			
6	73	60	52	45	71	59	51	45	57	50	45	56	49	44	54	49	44	42																			
7	68	55	46	40	66	54	46	40	52	45	40	51	44	40	50	44	39	37																			
8	63	50	42	36	61	49	41	36	48	41	36	47	40	36	46	40	35	33																			
9	59	46	38	33	57	45	38	32	44	37	32	43	37	32	42	36	32	30																			
10	55	42	35	30	54	42	34	30	41	34	29	40	34	29	39	33	29	27																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P204824

CATALOG NUMBER: LE\_6B50D010R EC6B30508040 6LBSCMW1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	294.1	3.9
10°-20°	837.4	11.0
20°-30°	1259.8	16.6
30°-40°	1493.0	19.6
40°-50°	1485.7	19.5
50°-60°	1197.7	15.8
60°-70°	724.6	9.5
70°-80°	269.0	3.5
80°-90°	40.1	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2391.4	31.5
0°-40°	3884.3	51.1
0°-60°	6567.7	86.4
0°-90°	7601.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7601.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3105	
5°	3091	294
15°	2966	837
25°	2736	1260
35°	2391	1493
45°	1935	1486
55°	1336	1198
65°	728	725
75°	244	269
85°	32	40
90°	0	



TEST NUMBER: P204824

CATALOG NUMBER: LE\_6B50D010R EC6B30508040 6LBSCMW1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3104.6
2.5°	3104.6
5°	3090.9
7.5°	3081.6
10°	3054.0
12.5°	3007.9
15°	2966.5
17.5°	2920.4
20°	2865.1
22.5°	2809.9
25°	2736.1
27.5°	2657.9
30°	2570.4
32.5°	2487.4
35°	2390.6
37.5°	2289.4
40°	2169.6
42.5°	2054.4
45°	1934.6
47.5°	1801.1
50°	1653.6
52.5°	1501.6
55°	1335.9
57.5°	1188.4
60°	1022.6
62.5°	875.2
65°	727.8
67.5°	589.6
70°	460.6
72.5°	345.5
75°	244.1
77.5°	156.6
80°	92.1
82.5°	55.2
85°	32.2
87.5°	13.9
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)