

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P208919

Luminaire Tested: **LDSQA6A55840D010TE LARH20SP 6LSQA1H**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P208919
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26676)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDSQA6A55840D010TE LARH20SP 6LSQA1H
Description: PORTFOLIO 6" SQUARE ADJUSTABLE REFLECTOR, ANGLE-CUT TRIM,
SELF-FLANGED, 20° SPOT
Light Source: (1) HIGH LUMEN LED 80CRI / 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4648.7 lumens
Efficiency: N/A
Efficacy: 76.5 lumens/watt
Spacing Criteria (0/90/45): 0.4 / 0.4 / 0.48
Luminous Opening: Rectangular (W 0.5' x L: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 60.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P208919

CATALOG NUMBER: LDSQA6A55840D010TE LARH20SP 6LSQA1H

Luminous Intensity Polar Plot

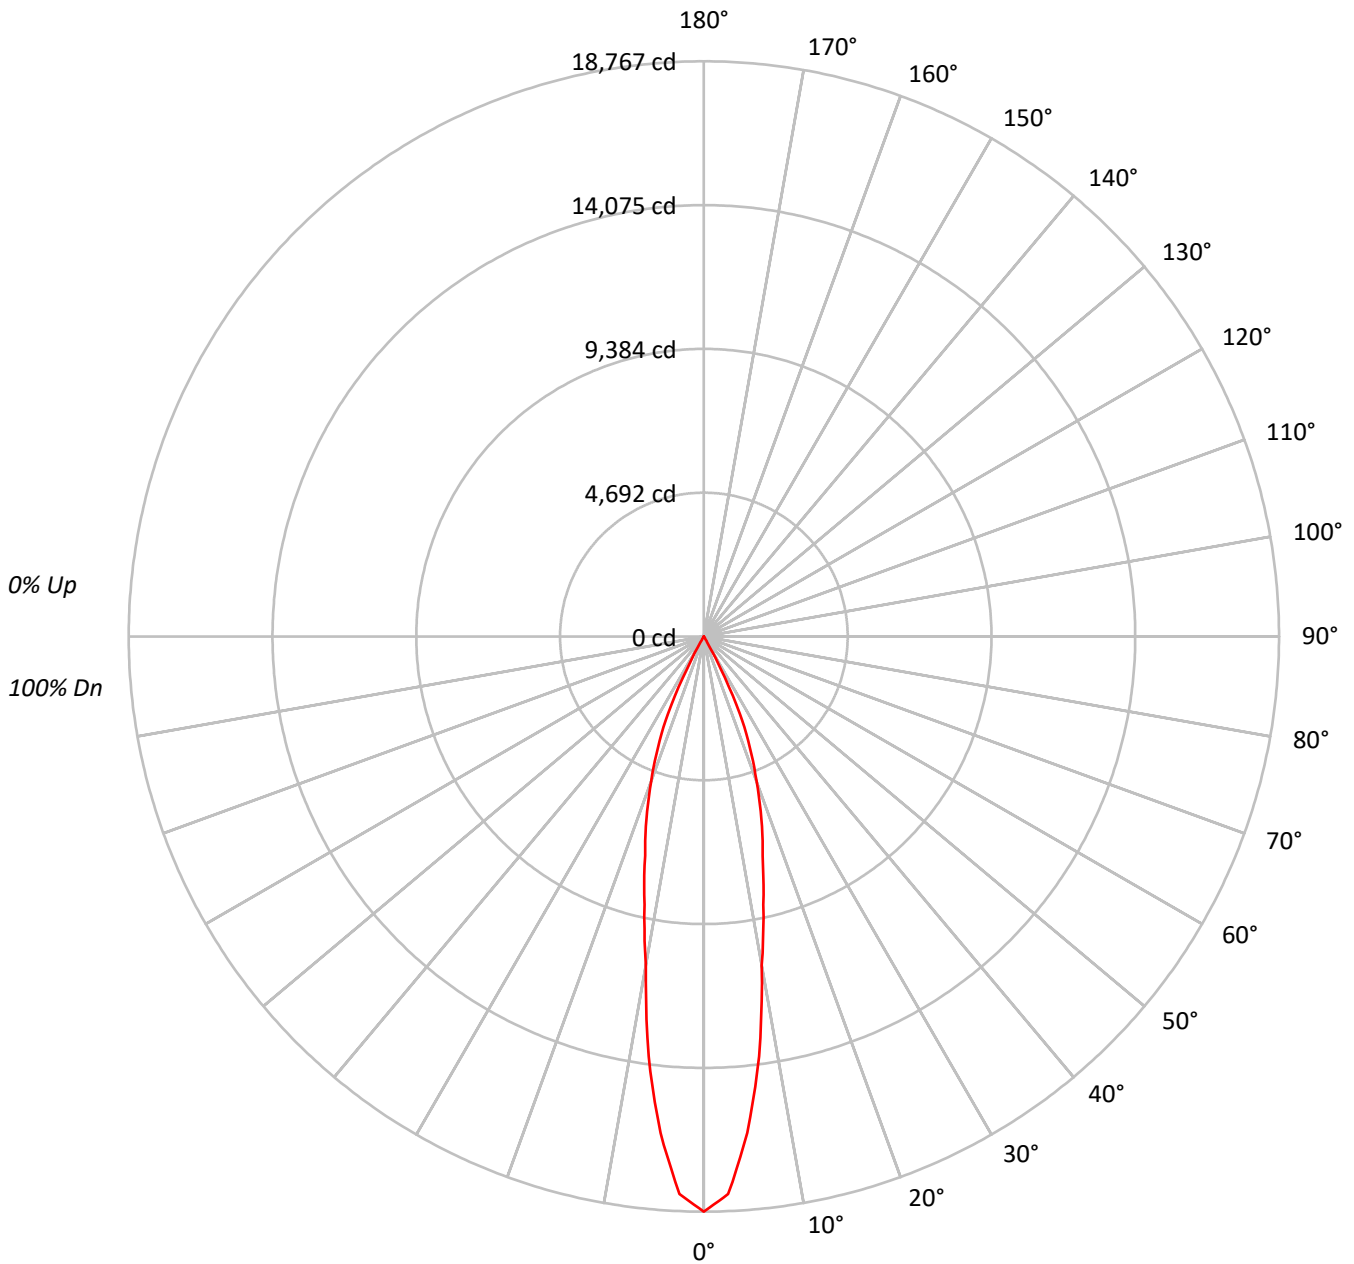



TEST NUMBER: P208919

CATALOG NUMBER: LDSQA6A55840D010TE LARH20SP 6LSQA1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	111	109	113	111	109	107	107	105	104	103	102	101	100	99	98	96	96	96	96
2	111	107	104	102	109	106	103	101	103	100	98	100	98	96	97	96	94	93	93	93	93
3	107	103	99	96	106	101	98	95	99	96	94	97	94	92	94	93	91	90	90	90	90
4	104	98	94	91	102	97	94	91	95	92	90	94	91	89	92	90	88	87	87	87	87
5	101	95	90	87	99	94	90	87	92	89	86	91	88	86	89	87	85	84	84	84	84
6	98	91	87	84	96	91	87	84	89	86	83	88	85	83	87	84	82	81	81	81	81
7	95	88	84	81	94	87	83	81	86	83	80	85	82	80	84	82	79	78	78	78	78
8	92	85	81	78	91	85	81	78	84	80	78	83	80	77	82	79	77	76	76	76	76
9	89	82	78	75	88	82	78	75	81	78	75	80	77	75	80	77	75	74	74	74	74
10	87	80	76	73	86	80	76	73	79	75	73	78	75	73	78	75	72	71	71	71	71

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	808038
5°	702487
10°	475991
15°	329958
20°	229942
25°	132316
30°	10376
35°	851
40°	427
45°	292
50°	255
55°	218
60°	250
65°	295
70°	239
75°	166
80°	248
85°	0



TEST NUMBER: P208919

CATALOG NUMBER: LDSQA6A55840D010TE LARH20SP 6LSQA1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1383.2	29.8
10°-20°	2083.5	44.8
20°-30°	1147.8	24.7
30°-40°	23.7	0.5
40°-50°	3.8	0.1
50°-60°	2.9	0.1
60°-70°	2.5	0.1
70°-80°	1.2	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4614.5	99.3
0°-40°	4638.2	99.8
0°-60°	4644.9	99.9
0°-90°	4648.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4648.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	18767	
5°	16254	###
15°	7402	2083
25°	2785	1148
35°	16	24
45°	5	4
55°	3	3
65°	3	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P208919

CATALOG NUMBER: LDSQA6A55840D010TE LARH20SP 6LSQA1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	18767.3
2.5°	18205.8
5°	16253.7
7.5°	13815.5
10°	10887.3
12.5°	8965.7
15°	7402.4
17.5°	6240.5
20°	5018.5
22.5°	3925.2
25°	2785.2
27.5°	1188.6
30°	208.7
32.5°	26.7
35°	16.2
37.5°	10.5
40°	7.6
42.5°	5.7
45°	4.8
47.5°	3.8
50°	3.8
52.5°	3.8
55°	2.9
57.5°	2.9
60°	2.9
62.5°	2.9
65°	2.9
67.5°	1.9
70°	1.9
72.5°	1.0
75°	1.0
77.5°	1.0
80°	1.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)