

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P244872

Luminaire Tested: **LSR8B10D010 EC8B10930 8LBM0WMH**

Issue Date: 03/03/2020

Test Information

Test Method: LM-79-08
Report Number: P244872
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P201704)
Test Lab: INNOVATION CENTER-P1
Issue Date: 03/03/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LSR8B10D010 EC8B10930 8LBM0WMH
Description: PORTFOLIO 8 INCH MEDIUM DISTRIBUTION 55 DEG CUTOFF RECESSED
DOWNLIGHT- CYLINDEC
97 CRI 3000 CCT WITH WARM HAZE TRIM
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 890.1 lumens
Efficiency: N/A
Efficacy: 87.3 lumens/watt
Spacing Criteria (0/90/45): 0.83 / 0.83 / 0.83
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 10.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P244872

CATALOG NUMBER: LSR8B10D010 EC8B10930 8LBM0WMH

Luminous Intensity Polar Plot

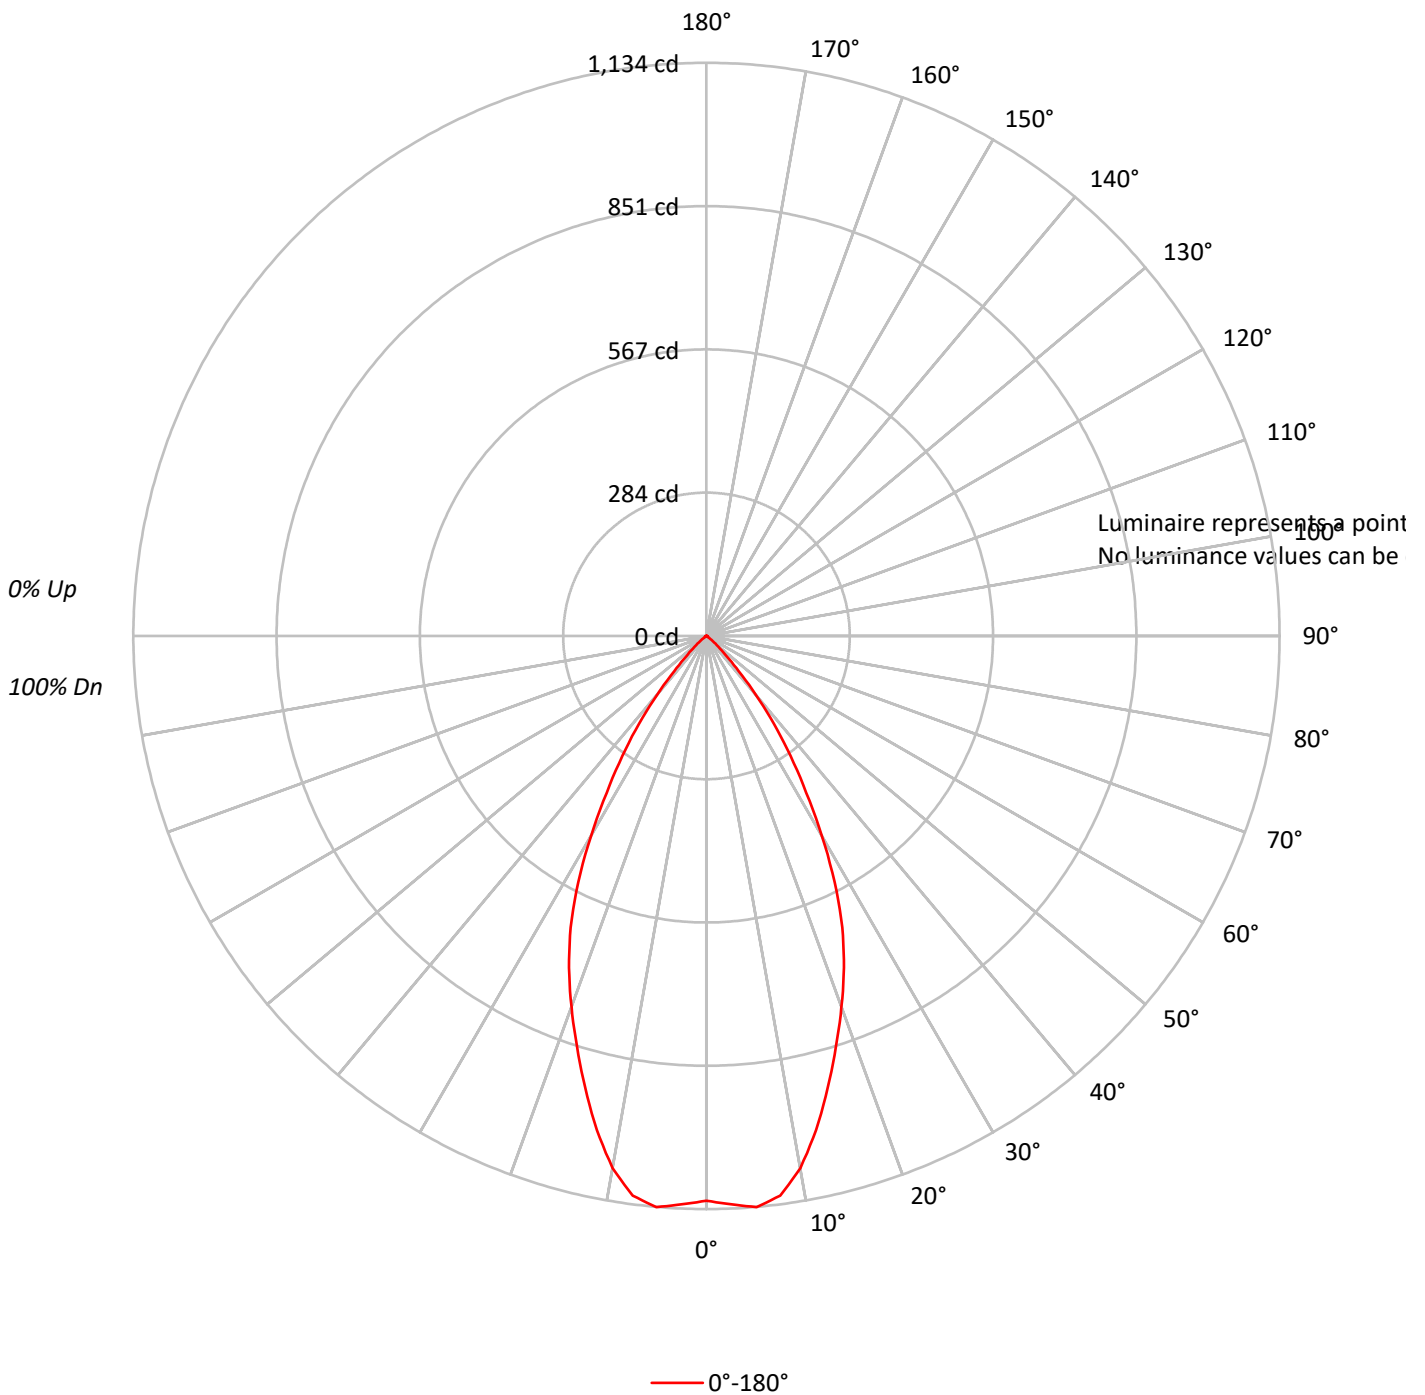



TEST NUMBER: P244872

CATALOG NUMBER: LSR8B10D010 EC8B10930 8LBM0WMH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76
5	93	85	79	75	92	84	79	75	82	78	74	81	77	73	79	76	73	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	71	65	61	69	64	61	68	64	61	67	63	60	59
9	77	67	61	58	76	67	61	57	66	61	57	65	60	57	64	60	57	56
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P244872

CATALOG NUMBER: LSR8B10D010 EC8B10930 8LBM0WMH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	106.1	11.9
10°-20°	258.3	29.0
20°-30°	286.6	32.2
30°-40°	181.6	20.4
40°-50°	50.4	5.7
50°-60°	5.8	0.6
60°-70°	1.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	651.1	73.2
0°-40°	832.7	93.6
0°-60°	888.8	99.9
0°-90°	890.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	890.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1117	
5°	1134	106
15°	926	258
25°	636	287
35°	289	182
45°	56	50
55°	4	6
65°	2	1
75°	0	0
85°	0	0
90°	0	0
95°	0	0
105°	0	0
115°	0	0
125°	0	0
135°	0	0
145°	0	0
155°	0	0
165°	0	0
175°	0	0
180°	0	0



TEST NUMBER: P244872

CATALOG NUMBER: LSR8B10D010 EC8B10930 8LBM0WMH

CANDELA DISTRIBUTION (FULL):

0°	
0°	1117.3
2.5°	1125.6
5°	1134.5
7.5°	1116.7
10°	1069.3
12.5°	1001.5
15°	926.1
17.5°	852.0
20°	780.7
22.5°	710.8
25°	636.3
27.5°	549.1
30°	456.9
32.5°	367.6
35°	289.3
37.5°	218.7
40°	151.6
42.5°	94.3
45°	56.2
47.5°	32.3
50°	17.7
52.5°	8.6
55°	4.4
57.5°	3.3
60°	2.1
62.5°	1.1
65°	1.6
67.5°	0.8
70°	0.0
72.5°	0.2
75°	0.0
77.5°	0.2
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0
92.5°	0.0
95°	0.0
97.5°	0.0
100°	0.0
102.5°	0.0
105°	0.0
107.5°	0.0
110°	0.0



TEST NUMBER: P244872

CATALOG NUMBER: LSR8B10D010 EC8B10930 8LBM0WMH

CANDELA DISTRIBUTION (continued):

	0°
112.5°	0.0
115°	0.0
117.5°	0.0
120°	0.0
122.5°	0.0
125°	0.0
127.5°	0.0
130°	0.0
132.5°	0.0
135°	0.0
137.5°	0.0
140°	0.0
142.5°	0.0
145°	0.0
147.5°	0.0
150°	0.0
152.5°	0.0
155°	0.0
157.5°	0.0
160°	0.0
162.5°	0.0
165°	0.0
167.5°	0.0
170°	0.0
172.5°	0.0
175°	0.0
177.5°	0.0
180°	0.0

(END OF REPORT)