

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P250591

Luminaire Tested: **LSR8B100D010 EC8B100935 8LBM0B**

Issue Date: 03/03/2020

Test Information

Test Method: LM-79-08
Report Number: P250591
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P13928)
Test Lab: INNOVATION CENTER-P1
Issue Date: 03/03/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LSR8B100D010 EC8B100935 8LBM0B
Description: PORTFOLIO 8 INCH MEDIUM DISTRIBUTION 55 DEG CUTOFF RECESSED
DOWNLIGHT- CYLINDEC
90 CRI 3500 CCT WITH SPECULAR BLACK TRIM
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5913.0 lumens
Efficiency: N/A
Efficacy: 55.6 lumens/watt
Spacing Criteria (0/90/45): 0.79 / 0.79 / 0.87
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 106.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P250591

CATALOG NUMBER: LSR8B100D010 EC8B100935 8LBM0B

Luminous Intensity Polar Plot

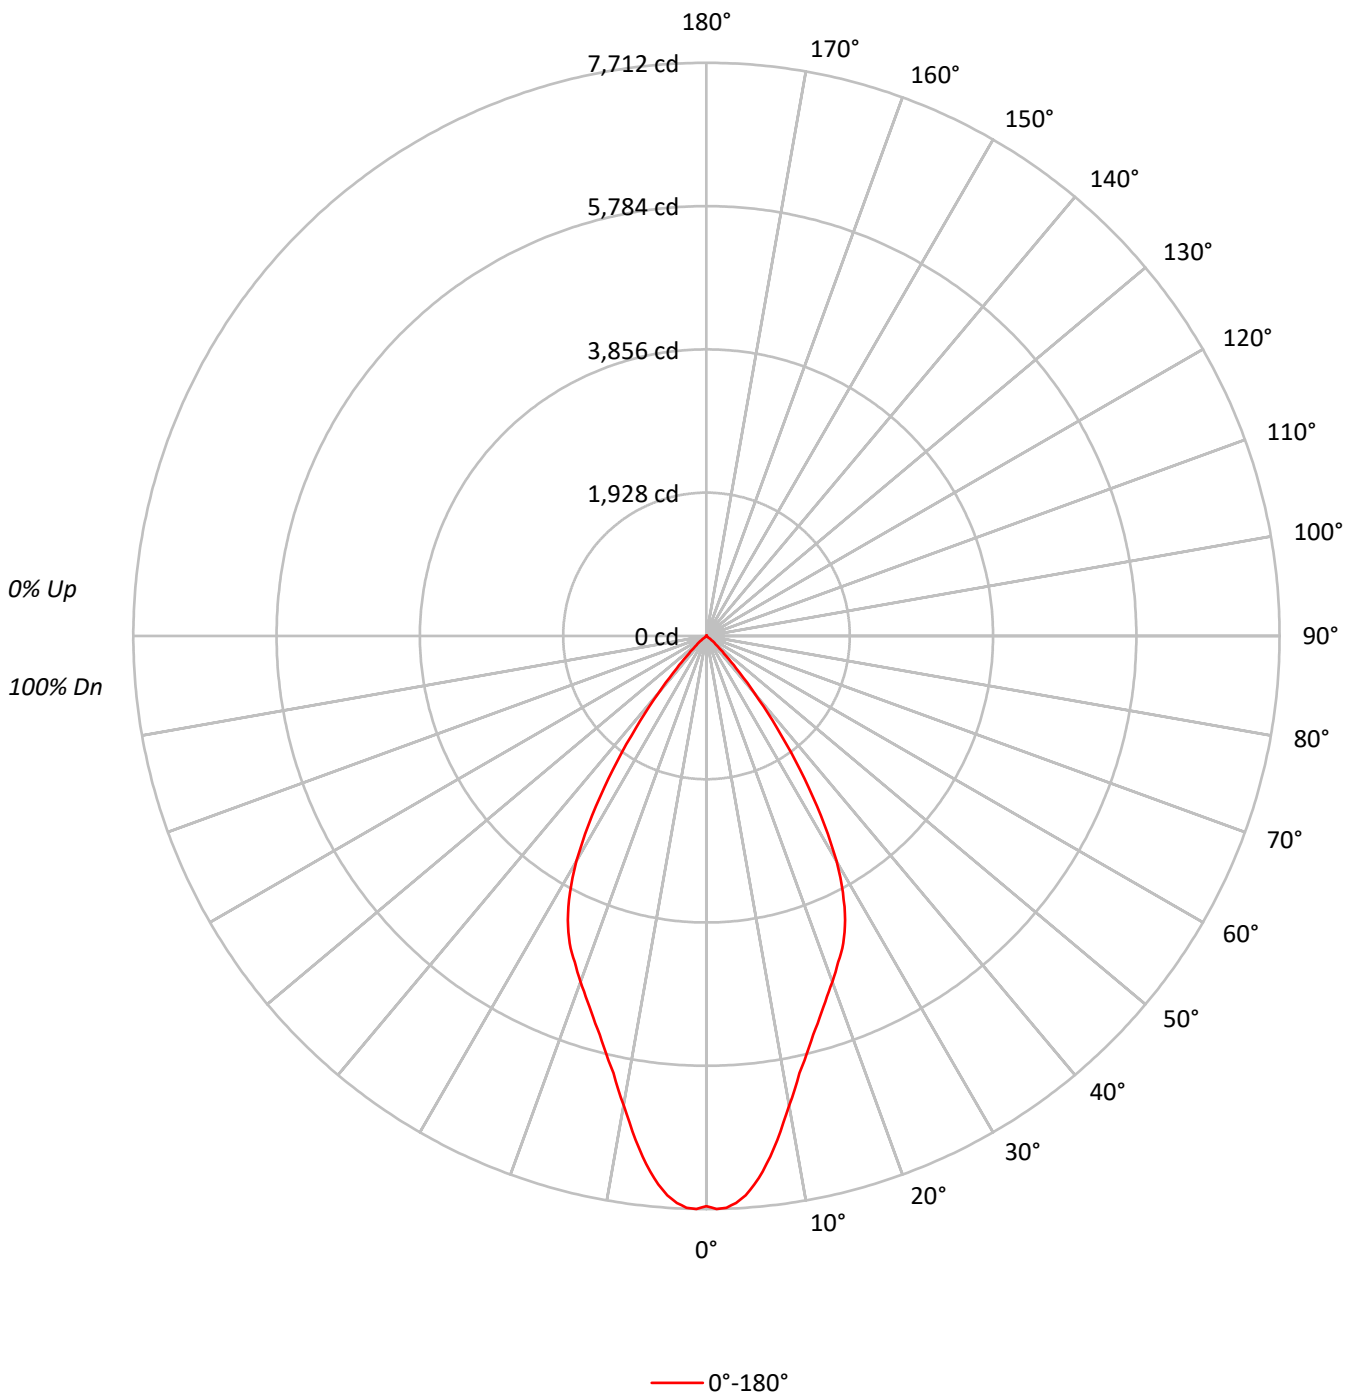



TEST NUMBER: P250591

CATALOG NUMBER: LSR8B100D010 EC8B100935 8LBM0B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	111	108	106	111	109	107	105	105	103	101		101	100	98		98	97	96	94
2	108	103	99	96	106	102	98	95	98	95	93		95	93	91		93	91	89	87
3	103	96	92	88	101	95	91	87	92	89	86		90	87	84		88	85	83	81
4	98	90	85	81	96	89	84	80	87	83	79		85	81	78		83	80	77	76
5	93	85	79	75	91	84	78	74	82	77	74		80	76	73		79	75	72	71
6	88	79	74	69	87	79	73	69	77	72	69		76	71	68		74	71	68	66
7	84	75	69	65	83	74	68	64	73	68	64		72	67	64		70	66	63	62
8	80	70	64	60	79	70	64	60	69	64	60		68	63	60		67	63	60	58
9	76	66	61	57	75	66	60	57	65	60	56		64	60	56		63	59	56	55
10	72	63	57	53	71	62	57	53	62	57	53		61	56	53		60	56	53	51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	236585
5°	229351
10°	200867
15°	177335
20°	162501
25°	149628
30°	124534
35°	82719
40°	40258
45°	14579
50°	4390
55°	306
60°	0
65°	212
70°	0
75°	0
80°	515
85°	0



TEST NUMBER: P250591

CATALOG NUMBER: LSR8B100D010 EC8B100935 8LBM0B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	673.9	11.4
10°-20°	1565.0	26.5
20°-30°	1985.5	33.6
30°-40°	1360.2	23.0
40°-50°	310.0	5.2
50°-60°	15.4	0.3
60°-70°	0.7	0.0
70°-80°	1.1	0.0
80°-90°	1.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4224.4	71.4
0°-40°	5584.6	94.4
0°-60°	5910.0	99.9
0°-90°	5913.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5913.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7672	
5°	7409	674
15°	5555	1565
25°	4398	1985
35°	2197	1360
45°	334	310
55°	6	15
65°	3	1
75°	0	1
85°	0	1
90°	0	



TEST NUMBER: P250591

CATALOG NUMBER: LSR8B100D010 EC8B100935 8LBM0B

CANDELA DISTRIBUTION (FULL):

0°	
0°	7672.3
1°	7712.3
2°	7698.0
3°	7640.9
4°	7543.7
5°	7409.4
6°	7246.5
7°	7058.0
8°	6849.3
9°	6626.4
10°	6415.0
11°	6220.7
12°	6012.1
13°	5860.7
14°	5700.6
15°	5554.9
16°	5423.5
17°	5294.8
18°	5174.9
19°	5057.7
20°	4952.0
21°	4843.4
22°	4731.9
23°	4634.8
24°	4526.2
25°	4397.7
26°	4254.8
27°	4089.1
28°	3911.9
29°	3714.7
30°	3497.5
31°	3251.8
32°	2997.5
33°	2731.7
34°	2460.3
35°	2197.4
37.5°	1551.6
40°	1000.1
42.5°	588.6
45°	334.3
47.5°	180.0
50°	91.5
52.5°	17.1
55°	5.7
57.5°	2.9



TEST NUMBER: P250591

CATALOG NUMBER: LSR8B100D010 EC8B100935 8LBM0B

CANDELA DISTRIBUTION (continued):

	0°
60°	0.0
62.5°	0.0
65°	2.9
67.5°	0.0
70°	0.0
72.5°	2.9
75°	0.0
77.5°	0.0
80°	2.9
82.5°	0.0
85°	0.0
87.5°	2.9
90°	0.0

(END OF REPORT)