

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P250312

Luminaire Tested: **LSR8B120D010 EC8B120840 8LBN0GPH**

Issue Date: 03/03/2020

Test Information

Test Method: LM-79-08
Report Number: P250312
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P13948)
Test Lab: INNOVATION CENTER-P1
Issue Date: 03/03/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LSR8B120D010 EC8B120840 8LBN0GPH
Description: PORTFOLIO 8 INCH NARROW DISTRIBUTION 50 DEGREE CUTOFF RECESSED
DOWNLIGHT- CYLINDEC
80 CRI 4000 CCT WITH GRAPHITE TRIM
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9929.0 lumens
Efficiency: N/A
Efficacy: 83.9 lumens/watt
Spacing Criteria (0/90/45): 0.69 / 0.69 / 0.77
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 118.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P250312

CATALOG NUMBER: LSR8B120D010 EC8B120840 8LBN0GPH

Luminous Intensity Polar Plot

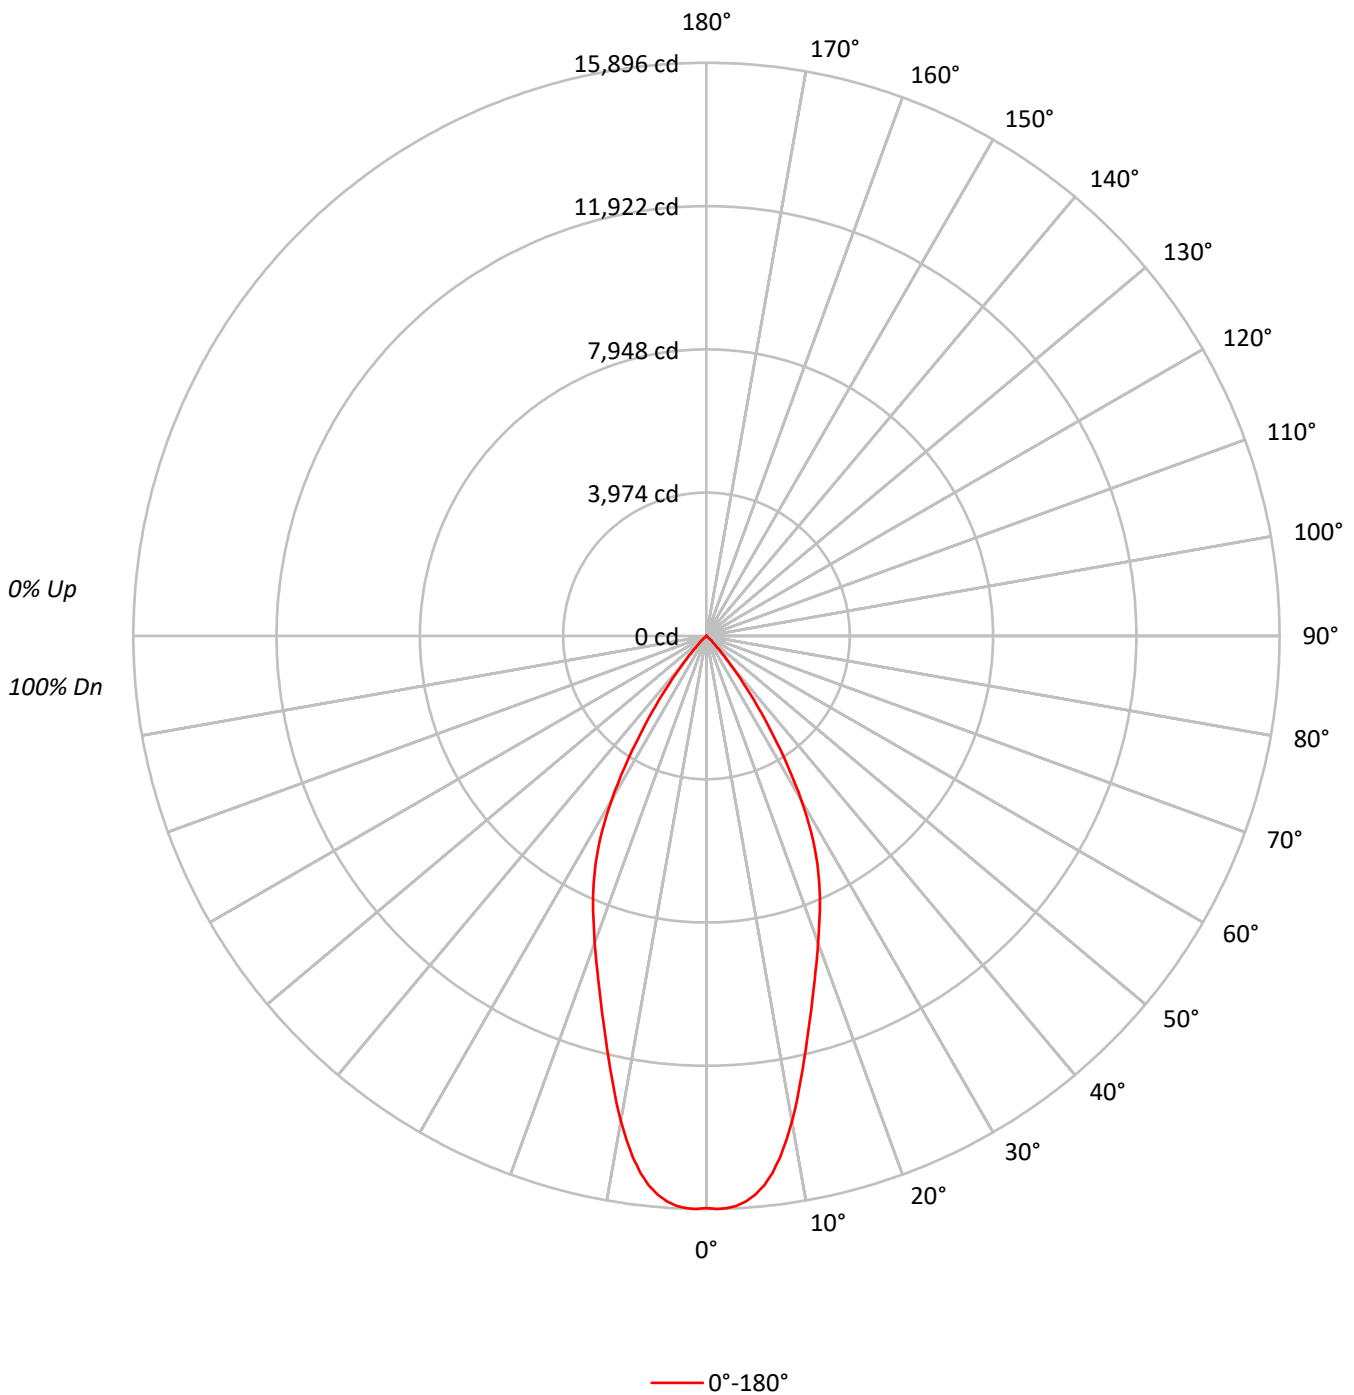



TEST NUMBER: P250312

CATALOG NUMBER: LSR8B120D010 EC8B120840 8LBN0GPH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	107	112	109	107	105	105	104	102	101	100	99	98	97	96	94
2	109	104	101	97	107	103	99	96	99	97	94	96	94	92	94	92	90	89
3	104	98	93	90	102	97	92	89	94	90	88	92	89	86	89	87	85	83
4	99	92	87	83	97	91	86	83	89	85	82	87	84	81	85	82	80	78
5	95	87	82	78	93	86	81	77	84	80	77	83	79	76	81	78	75	74
6	90	82	77	73	89	81	76	72	80	75	72	79	75	71	77	74	71	70
7	86	78	72	68	85	77	72	68	76	71	68	75	71	67	74	70	67	66
8	83	74	68	64	81	73	68	64	72	67	64	71	67	64	70	66	63	62
9	79	70	65	61	78	70	64	61	69	64	61	68	63	60	67	63	60	59
10	76	67	61	58	75	66	61	58	65	61	57	65	60	57	64	60	57	56

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	489237
5°	481417
10°	427728
15°	352838
20°	297162
25°	250639
30°	187665
35°	106206
40°	41993
45°	11273
50°	2159
55°	0
60°	315
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P250312

CATALOG NUMBER: LSR8B120D010 EC8B120840 8LBN0GPH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1424.2	14.3
10°-20°	3095.5	31.2
20°-30°	3323.3	33.5
30°-40°	1796.1	18.1
40°-50°	280.2	2.8
50°-60°	7.7	0.1
60°-70°	1.9	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7843.1	79.0
0°-40°	9639.2	97.1
0°-60°	9927.1	100.0
0°-90°	9929.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9929.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	15866	
5°	15553	###
15°	11052	3096
25°	7366	3323
35°	2821	1796
45°	258	280
55°	0	8
65°	0	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P250312

CATALOG NUMBER: LSR8B120D010 EC8B120840 8LBN0GPH

CANDELA DISTRIBUTION (FULL):

0°	
0°	15865.6
1°	15895.7
2°	15880.7
3°	15826.4
4°	15721.9
5°	15552.6
6°	15319.7
7°	15006.2
8°	14613.9
9°	14162.4
10°	13660.2
11°	13133.6
12°	12587.2
13°	12041.3
14°	11534.1
15°	11052.4
16°	10610.3
17°	10183.0
18°	9785.6
19°	9413.5
20°	9055.6
21°	8707.7
22°	8379.6
23°	8052.3
24°	7709.5
25°	7366.5
26°	7018.7
27°	6621.5
28°	6184.2
29°	5737.7
30°	5270.5
31°	4768.9
32°	4266.7
33°	3770.2
34°	3268.5
35°	2821.3
37.5°	1803.1
40°	1043.2
42.5°	556.5
45°	258.5
47.5°	139.4
50°	45.0
52.5°	5.1
55°	0.0
57.5°	5.1



TEST NUMBER: P250312

CATALOG NUMBER: LSR8B120D010 EC8B120840 8LBN0GPH

CANDELA DISTRIBUTION (continued):

	0°
60°	5.1
62.5°	0.0
65°	0.0
67.5°	5.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)