

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P249948

Luminaire Tested: **LSR8B120D010 EC8B120930 8LBM0H**

Issue Date: 03/03/2020

Test Information

Test Method: LM-79-08
Report Number: P249948
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P13954)
Test Lab: INNOVATION CENTER-P1
Issue Date: 03/03/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LSR8B120D010 EC8B120930 8LBM0H
Description: PORTFOLIO 8 INCH MEDIUM DISTRIBUTION 55 DEG CUTOFF RECESSED
DOWNLIGHT- CYLINDEC
97 CRI 3000 CCT WITH SEMI-SPECULAR CLEAR TRIM
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9899.5 lumens
Efficiency: N/A
Efficacy: 83.7 lumens/watt
Spacing Criteria (0/90/45): 0.92 / 0.92 / 0.93
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 118.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P249948

CATALOG NUMBER: LSR8B120D010 EC8B120930 8LBM0H

Luminous Intensity Polar Plot

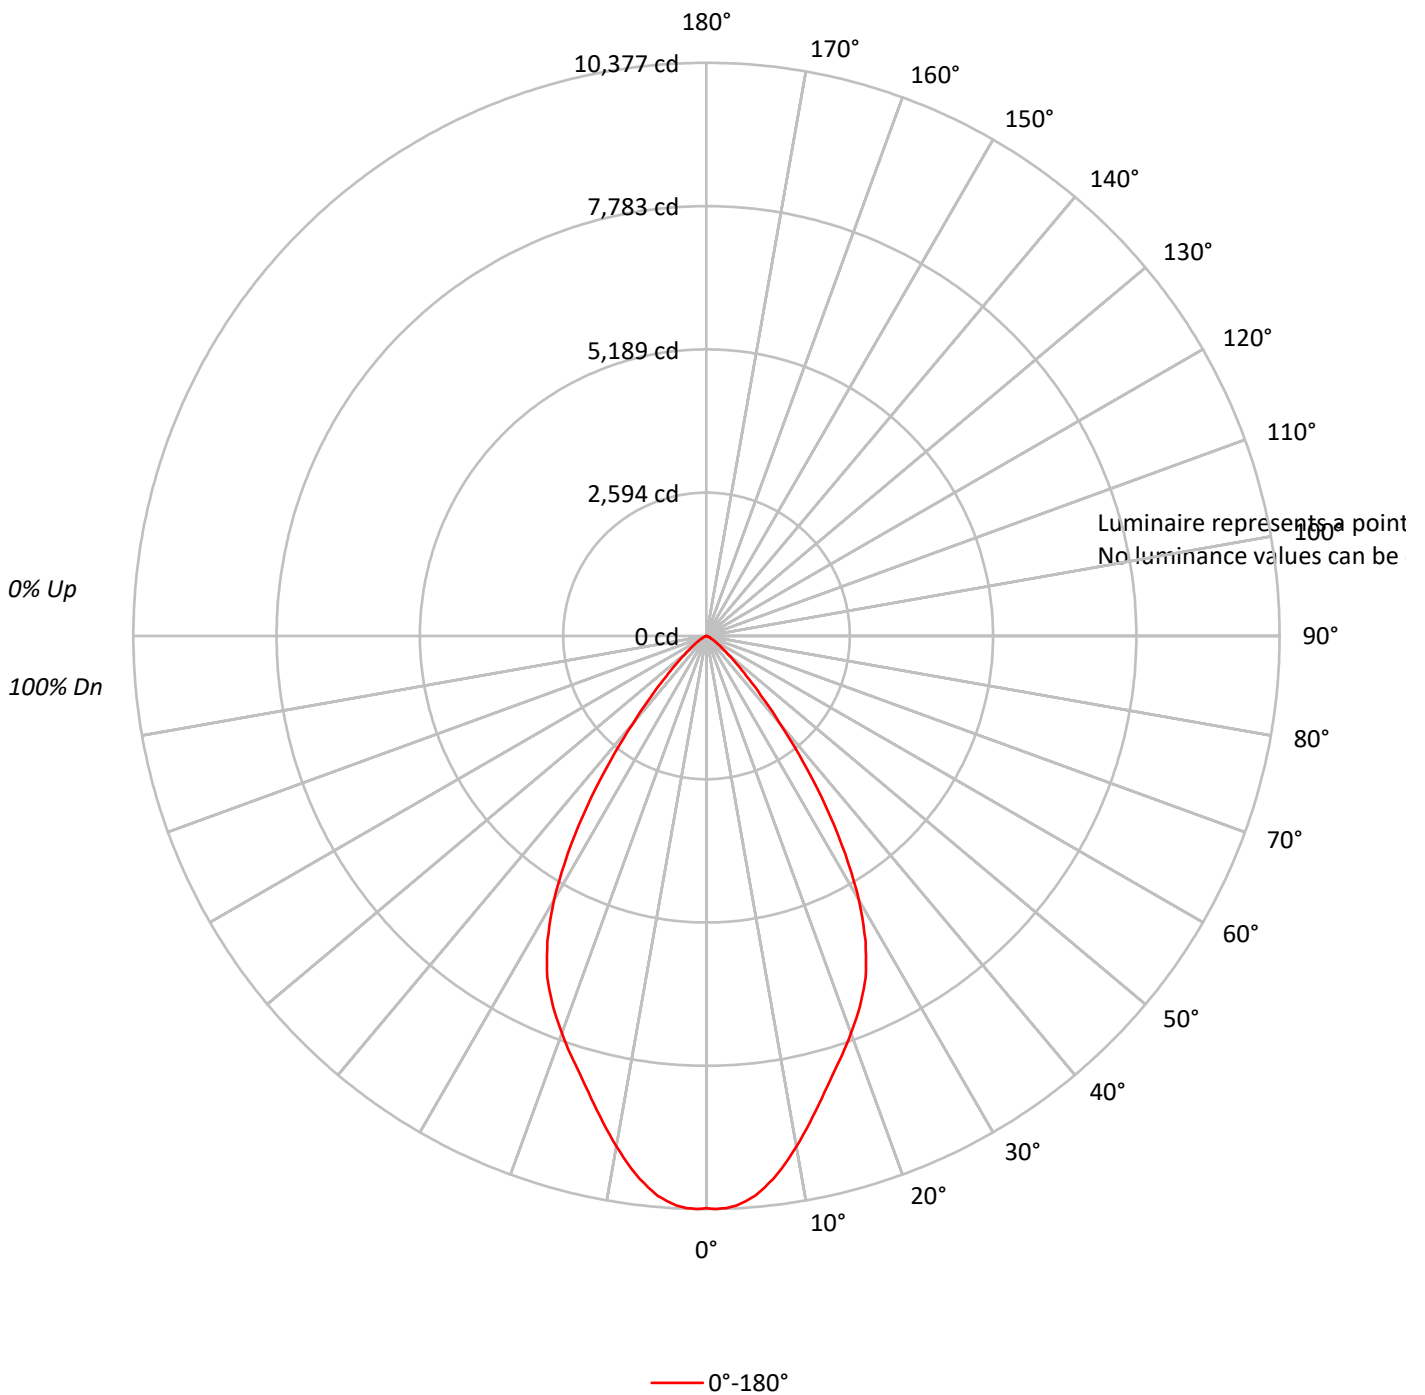



TEST NUMBER: P249948

CATALOG NUMBER: LSR8B120D010 EC8B120930 8LBM0H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|--|--|
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | | 0 | | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 | | | |
| 1 | 113 | 110 | 108 | 105 | 111 | 108 | 106 | 104 | 104 | 102 | 101 | 100 | 99 | 98 | 97 | 96 | 95 | 93 | 93 | 93 | 93 | | | |
| 2 | 107 | 102 | 98 | 94 | 105 | 100 | 97 | 93 | 97 | 94 | 91 | 94 | 92 | 89 | 91 | 89 | 87 | 86 | 86 | 86 | 86 | | | |
| 3 | 101 | 95 | 90 | 85 | 99 | 93 | 89 | 85 | 91 | 87 | 83 | 88 | 85 | 82 | 86 | 83 | 81 | 79 | 79 | 79 | 79 | | | |
| 4 | 96 | 88 | 82 | 78 | 94 | 87 | 82 | 77 | 85 | 80 | 76 | 83 | 79 | 76 | 81 | 77 | 75 | 73 | 73 | 73 | 73 | | | |
| 5 | 91 | 82 | 76 | 71 | 89 | 81 | 75 | 71 | 79 | 74 | 70 | 78 | 73 | 70 | 76 | 72 | 69 | 68 | 68 | 68 | 68 | | | |
| 6 | 86 | 77 | 70 | 66 | 84 | 76 | 70 | 66 | 74 | 69 | 65 | 73 | 68 | 65 | 71 | 67 | 64 | 63 | 63 | 63 | 63 | | | |
| 7 | 81 | 72 | 65 | 61 | 80 | 71 | 65 | 61 | 70 | 64 | 60 | 68 | 64 | 60 | 67 | 63 | 60 | 58 | 58 | 58 | 58 | | | |
| 8 | 77 | 67 | 61 | 57 | 76 | 67 | 61 | 56 | 65 | 60 | 56 | 64 | 60 | 56 | 63 | 59 | 56 | 54 | 54 | 54 | 54 | | | |
| 9 | 73 | 63 | 57 | 53 | 72 | 63 | 57 | 53 | 62 | 56 | 53 | 61 | 56 | 52 | 60 | 55 | 52 | 51 | 51 | 51 | 51 | | | |
| 10 | 70 | 60 | 53 | 49 | 69 | 59 | 53 | 49 | 58 | 53 | 49 | 57 | 53 | 49 | 57 | 52 | 49 | 48 | 48 | 48 | 48 | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P249948

CATALOG NUMBER: LSR8B120D010 EC8B120930 8LBM0H

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 944.6 | 9.5 |
| 10°-20° | 2376.7 | 24.0 |
| 20°-30° | 3085.5 | 31.2 |
| 30°-40° | 2328.8 | 23.5 |
| 40°-50° | 852.1 | 8.6 |
| 50°-60° | 238.2 | 2.4 |
| 60°-70° | 62.6 | 0.6 |
| 70°-80° | 10.6 | 0.1 |
| 80°-90° | 0.4 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 6406.8 | 64.7 |
| 0°-40° | 8735.6 | 88.2 |
| 0°-60° | 9826.0 | 99.3 |
| 0°-90° | 9899.5 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 9899.5 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-------|------|
| 0° | 10362 | |
| 5° | 10170 | 945 |
| 15° | 8447 | 2377 |
| 25° | 6820 | 3085 |
| 35° | 3761 | 2329 |
| 45° | 1022 | 852 |
| 55° | 244 | 238 |
| 65° | 59 | 63 |
| 75° | 9 | 11 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P249948

CATALOG NUMBER: LSR8B120D010 EC8B120930 8LBM0H

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|---------|
| 0° | 10361.6 |
| 1° | 10377.1 |
| 2° | 10364.8 |
| 3° | 10324.6 |
| 4° | 10256.7 |
| 5° | 10170.3 |
| 6° | 10043.6 |
| 7° | 9904.7 |
| 8° | 9744.2 |
| 9° | 9568.2 |
| 10° | 9382.9 |
| 11° | 9197.7 |
| 12° | 9006.2 |
| 13° | 8811.7 |
| 14° | 8626.4 |
| 15° | 8447.4 |
| 16° | 8277.6 |
| 17° | 8113.9 |
| 18° | 7965.7 |
| 19° | 7811.4 |
| 20° | 7654.0 |
| 22.5° | 7261.8 |
| 25° | 6820.3 |
| 27.5° | 6236.8 |
| 30° | 5526.6 |
| 32.5° | 4671.4 |
| 35° | 3760.6 |
| 37.5° | 2871.3 |
| 40° | 2071.7 |
| 42.5° | 1466.6 |
| 45° | 1022.0 |
| 47.5° | 719.3 |
| 50° | 484.7 |
| 52.5° | 355.0 |
| 55° | 243.9 |
| 57.5° | 176.0 |
| 60° | 117.4 |
| 62.5° | 86.4 |
| 65° | 58.6 |
| 67.5° | 40.1 |
| 70° | 21.6 |
| 72.5° | 15.5 |
| 75° | 9.3 |
| 77.5° | 3.1 |
| 80° | 3.1 |



TEST NUMBER: P249948

CATALOG NUMBER: LSR8B120D010 EC8B120930 8LBM0H

CANDELA DISTRIBUTION (continued):

| | 0° |
|-------|-----|
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |

(END OF REPORT)